

CHAPTER 1 [CE]

SCOPE AND ADMINISTRATION

SECTION C101 SCOPE AND GENERAL REQUIREMENTS

C101.1 Title. This code shall be known as the *Washington State Energy Code*, and shall be cited as such. It is referred to herein as "this code."

C101.2 Scope. This code applies to *commercial buildings* and the buildings sites and associated systems and equipment. References in this code to Group R shall include Group I-1, Condition 2 assisted living facilities licensed by Washington state under chapter 388-78A WAC and Group I-1, Condition 2 residential treatment facilities licensed by Washington state under Chapter 246-337 WAC.

Exception: The provisions of this code do not apply to *temporary growing structures* used solely for the commercial production of horticultural plants including ornamental plants, flowers, vegetables, and fruits. A temporary growing structure is not considered a building for the purposes of this code. However, the installation of other than listed, portable mechanical equipment or listed, portable lighting fixtures is not allowed.

C101.3 Intent. This code shall regulate the design and construction of buildings for the use and conservation of energy over the life of each building. This code is intended to provide flexibility to permit the use of innovative approaches and techniques to achieve this objective. This code is not intended to abridge safety, health or environmental requirements contained in other applicable codes or ordinances.

C101.4 Applicability. Where, in any specific case, different sections of this code specify different materials, methods of construction or other requirements, the most restrictive shall govern. Where there is a conflict between a general requirement and a specific requirement, the specific requirement shall govern.

C101.4.1 ~~Mixed occupancy~~ Mixed residential and commercial buildings. Where a building includes both *residential building* and *commercial building* ~~occupancies~~ portions, each ~~occupancy-portion~~ shall be separately considered and meet the applicable provisions of WSEC--Commercial Provisions or WSEC--Residential Provisions.

C101.5 Compliance. *Residential buildings* shall meet the provisions of WSEC--Residential Provisions. *Commercial buildings* shall meet the provisions of WSEC--Commercial Provisions.

C101.5.1 Compliance materials. The *code official* shall be permitted to approve specific computer software, worksheets, compliance manuals and other similar materials that meet the intent of this code.

C101.6 Appendices. Appendices A, B, C and D are included in the adoption of this code. Provisions in appendices E and F shall not apply unless specifically adopted by the local jurisdiction.

SECTION C102 ~~ALTERNATIVE MATERIALS, DESIGN AND METHODS~~ ~~OF CONSTRUCTION, DESIGN~~ ~~OR INSULATING SYSTEMS AND EQUIPMENT~~

C102.1 General. ~~The provisions of this code is are~~ not intended to prevent the ~~use installation~~ of any material, ~~or to prohibit any design or~~ method of construction, ~~design or insulating system~~ not specifically prescribed ~~herein by this code~~, provided that ~~any such construction alternative has been approved. An alternative material, design or insulating system method of construction has been shall be approved by where~~ the *code official* ~~as meeting the intent of this code~~ finds that ~~the proposed design is satisfactory and complies with the intent of the provisions of this code, and that the material, method or work offered is, for the purpose intended, not less than the equivalent of that prescribed in this code in quality, strength, effectiveness, fire resistance, durability and safety. Where the alternative material, design or method of construction is not approved, the code official shall respond in writing, stating the reasons why the alternative was not approved. Building areas that contain Group R sleeping units, regardless of the number of stories in height, are required to comply with the commercial building sections of the energy code.~~

SECTION C103 CONSTRUCTION DOCUMENTS

C103.1 General. Construction documents and other supporting data shall be submitted in one or more sets with each

Commented [BK(1): E
G001-2018

application for a permit. The construction documents shall be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed. Where special conditions exist, the *code official* is authorized to require necessary construction documents to be prepared by a registered design professional.

Exception: The *code official* is authorized to waive the requirements for construction documents or other supporting data if the *code official* determines they are not necessary to confirm compliance with this code.

C103.2 Information on construction documents. Construction documents shall be drawn to scale upon suitable material. Electronic media documents are permitted to be submitted when *approved* by the *code official*. Construction documents shall be of sufficient clarity to indicate the location, nature and extent of the work proposed, and show in sufficient detail pertinent data and features of the building, systems and equipment as herein governed. Details shall include, but are not limited to, as applicable:

1. Insulation materials and their *R*-values.
2. Fenestration *U*-factors and SHGCs.
3. Area-weighted *U*-factor and SHGC calculations.
4. Mechanical system design criteria.
5. Mechanical and service water heating system and equipment types, sizes and efficiencies.
6. Economizer description.
7. Equipment and systems controls.
8. Fan motor horsepower (hp) and controls.
9. Duct sealing, duct and pipe insulation and location.
10. Lighting fixture schedule with wattage and control narrative.
11. Location of daylight zones on floor plan.
12. Air barrier details including all air barrier boundaries and associated square foot calculations on all six sides of the air barrier as applicable.

C103.2.1 Building thermal envelope depiction. The building's thermal envelope shall be represented on the construction documents.

C103.3 Examination of documents. The *code official* shall examine or cause to be examined the accompanying construction documents and shall ascertain whether the construction indicated and described is in accordance with the requirements of this code and other pertinent laws or ordinances.

C103.3.1 Approval of construction documents. When the *code official* issues a permit where construction documents are required, the construction documents shall be endorsed in writing and stamped "Reviewed for Code Compliance." Such *approved* construction documents shall not be changed, modified or altered without authorization from the *code official*. Work shall be done in accordance with the *approved* construction documents.

One set of construction documents so reviewed shall be retained by the *code official*. The other set shall be returned to the applicant, kept at the site of work and shall be open to inspection by the *code official* or a duly authorized representative.

C103.3.2 Previous approvals. This code shall not require changes in the construction documents, construction or designated occupancy of a structure for which a lawful permit has been heretofore issued or otherwise lawfully authorized, and the construction of which has been pursued in good faith within 180 days after the effective date of this code and has not been abandoned.

C103.3.3 Phased approval. The *code official* shall have the authority to issue a permit for the construction of part of an energy conservation system before the construction documents for the entire system have been submitted or *approved*, provided adequate information and detailed statements have been filed complying with all pertinent requirements of this code. The holders of such permit shall proceed at their own risk without assurance that the permit for the entire energy conservation system will be granted.

C103.4 Amended construction documents. Changes made during construction that are not in compliance with the *approved* construction documents shall be resubmitted for approval as an amended set of construction documents.

C103.5 Retention of construction documents. One set of *approved* construction documents shall be retained by the *code official* for a period of not less than 180 days from date of completion of the permitted work, or as required by state or local laws.

C103.6 Building documentation and close out submittal requirements. The construction documents shall specify that the documents described in this section be provided to the building owner or owner's authorized agent within a maximum of 180-90 days of the date of receipt of the certificate of occupancy.

Commented [BK(2): E
G003-2018

C103.6.1 Record documents. Construction documents shall be updated by the installing contractor and architect or engineer of record to convey a record of the completed work. Such updates shall include building envelope, mechanical, plumbing, electrical and control drawings red-lined, or redrawn if specified, that show all changes to size, type and locations of components, equipment and assemblies. Record documents shall include the location and model number of each piece of equipment as installed. The architect, engineer of record or installing contractor is required to provide consolidated record drawings in compliance with this section to the building owner or owner's authorized agent with the timeline specified in Section C103.6.

Commented [BK(3)]: E
G003-2018

Commented [BK(4)]: E
G003-2018

Commented [BK(5)]: E
G003-2018

Commented [BK(6)]: E
G003-2018

C103.6.2 Building operations and maintenance information. Required regular maintenance actions for equipment and systems shall be clearly stated on a readily visible label on the equipment. The label shall include the title or publication number for the operation and maintenance manual for that particular model and type of product and the manufacture date or installation date.

Commented [BK(7)]: E
C148-2018

C103.6.2.1 Manuals. An operating and maintenance manual shall be provided for each component, device, piece of equipment, and system governed by this code. The manual shall include all of the following:

1. Submittal data indicating all selected options for each piece of equipment and control device.
2. Manufacturer's operation manuals and maintenance manuals for each device, piece of equipment, and system requiring maintenance, except equipment not furnished as part of the project. Required routine maintenance actions, cleaning and recommended relamping shall be clearly identified.
3. Name and address of at least one service agency.
4. Controls system inspection schedule, maintenance and calibration information, wiring diagrams, schematics, and control sequence descriptions. A schedule for inspecting and recalibrating all lighting controls. Desired or field-determined setpoints shall be PERMANENTLY recorded on control drawings at control devices or, for digital control systems, on the graphic where settings may be changed.
5. A narrative of how each system is intended to operate, including recommended setpoints. Sequence of operation alone is not acceptable for this requirement.

C103.6.3 Compliance documentation. All energy code compliance forms and calculations shall be delivered in one document to the building owner as part of the project record documents ~~or~~ manuals, or as a standalone document. This document shall include the specific energy code year utilized for compliance determination for each system, NFRC certificates for the installed windows, list of total area for each NFRC certificate, the interior lighting power compliance path (building area, space-by-space) used to calculate the lighting power allowance.

For projects complying with Section C401.2 item 1, the documentation shall include:

1. The envelope insulation compliance path (prescriptive or component performance).
2. All completed code compliance forms, and all compliance calculations including, but not limited to, those required by sections C402.1.5, C403.2.12.1, C405.4, and C405.5.

For projects complying with C401.2 item 2, the documentation shall include:

1. A list of all proposed envelope component types, areas and *U*-values.
2. A list of all lighting area types with areas, lighting power allowance, and installed lighting power density.
3. A list of each HVAC system modeled with the assigned and proposed system type.
4. Electronic copies of the baseline and proposed model input and output file. The input files shall be in a format suitable for rerunning the model and shall not consist solely of formatted reports of the inputs

C103.6.4 Systems operation training. Training of the maintenance staff for equipment included in the manuals required by Section C103.6.2 shall include at a minimum:

1. Review of manuals and permanent certificate.
2. Hands-on demonstration of all normal maintenance procedures, normal operating modes, and all emergency shutdown and start-up procedures.
3. Training completion report.

SECTION C104 INSPECTIONS

C104.1 General. Construction or work for which a permit is required shall be subject to inspection by the *code official*, ~~or~~ his or her designated agent, or an approved agency, and such construction or work shall remain ~~accessible and exposed~~ visible and able to be accessed for inspection purposes until *approved*. Approval as a result of an inspection shall not be construed to be an approval of a violation of the provisions of this code or of other ordinances of the jurisdiction.

Inspections presuming to give authority to violate or cancel the provisions of this code or of other ordinances of the jurisdiction shall not be valid. It shall be the duty of the permit applicant to cause the work to remain ~~accessible and exposed~~ visible and able to be accessed for inspection purposes. Neither the *code official* nor the jurisdiction shall be liable for expense entailed in the removal or replacement of any material, product, system or building component required to allow inspection to validate compliance with this code.

C104.2 Required inspections. The *code official*, ~~or~~ his or her designated agent, or an approved agency, upon notification, shall make the inspections set forth in Sections C104.2.1 through C104.2.6.

C104.2.1 Footing and foundation ~~inspection~~insulation. Inspections ~~associated with footings and foundations~~ shall verify ~~compliance with the code as to footing and/or foundation insulation~~ R-value, location, thickness, depth of burial and protection of insulation as required by the code, and approved plans and specifications.

C104.2.2 ~~Insulation and fenestration inspection~~Thermal envelope. Inspections shall be made before application of interior finish and shall verify that envelope components with the correct type of insulation, the R-values, the correct location of insulation, the correct fenestration, the U-factor, SHGC, VT, and air leakage controls are properly installed as required by the code, approved plans and specification~~compliance with the code as to types of insulation and corresponding R-values and their correct location and proper installation; fenestration properties (U factor, SHGC and VT) and proper installation; and air leakage controls as required by the code and approved plans and specifications,~~ including envelope components in future tenant spaces of multi-tenant buildings.

C104.2.3 Plumbing ~~inspections~~system. Inspections shall verify ~~compliance as required by the code and approved plans and specifications as to types of insulation and corresponding R-values and protection, required controls and required heat traps~~ the type of insulation, the R-values, the protection required, controls, and heat traps as required by the code, approved plans and specifications.

C104.2.4 Mechanical ~~inspections~~system. Inspections shall verify ~~compliance as required by the code and approved plans and specifications as to the~~ installed HVAC equipment for the correct type and size, ~~required~~ controls, duct and piping ~~system~~ insulation and corresponding R-values, duct system and damper air leakage, minimum fan efficiency, energy recovery and ~~required energy recovery and/or economizer~~ as required by the code, approved plans and specifications.

C104.2.5 Electrical ~~and lighting inspections~~system. Inspections shall verify ~~compliance as required by the code and approved plans and specifications as to installed~~ lighting system controls, components, and controls meters; motors and installation of an electric meter for each dwelling unit as required by the code, approved plans and specifications.

C104.2.6 Final inspection. ~~The building shall have a final inspection and not be occupied until approved~~ The final inspection shall include verification of the installation and proper operation of all required building controls, and documentation verifying activities associated with required building commissioning have been conducted in accordance with Section C408.

Commented [BK(8)]: E
nv005-2018

C104.3 Reinspection. A building shall be reinspected when determined necessary by the *code official*.

C104.4 Approved inspection agencies. The *code official* is authorized to accept reports of *approved* inspection agencies, provided such agencies satisfy the requirements as to qualifications and reliability relevant to the building components and systems they are inspecting.

C104.5 Inspection requests. It shall be the duty of the holder of the permit or their duly authorized agent to notify the *code official* when work is ready for inspection. It shall be the duty of the permit holder to provide access to and means for inspections of such work that are required by this code.

C104.6 Reinspection and testing. Where any work or installation does not pass an initial test or inspection, the necessary corrections shall be made so as to achieve compliance with this code. The work or installation shall then be resubmitted to the *code official* for inspection and testing.

C104.7 Approval. After the prescribed tests and inspections indicate that the work complies in all respects with this code, a notice of approval shall be issued by the *code official*.

C104.7.1 Revocation. The *code official* is authorized to, in writing, suspend or revoke a notice of approval issued under the provisions of this code wherever the certificate is issued in error, or on the basis of incorrect information supplied, or where it is determined that the building or structure, premise, or portion thereof is in violation of any ordinance or regulation or any of the provisions of this code.

SECTION C105 VALIDITY

C105.1 General. If a portion of this code is held to be illegal or void, such a decision shall not affect the validity of the remainder of this code.

SECTION C106 REFERENCED STANDARDS

C106.1 Referenced codes and standards. The codes and standards referenced in this code shall be those listed in Chapter 5, and such codes and standards shall be considered as part of the requirements of this code to the prescribed extent of each such reference and as further regulated in Sections C106.1.1 and C106.1.2.

C106.1.1 Conflicts. Where differences occur between provisions of this code and referenced codes and standards, the provisions of this code shall apply.

C106.1.2 Provisions in referenced codes and standards. Where the extent of the reference to a referenced code or standard includes subject matter that is within the scope of this code, the provisions of this code, as applicable, shall take precedence over the provisions in the referenced code or standard.

C106.2 Application of references. References to chapter or section numbers, or to provisions not specifically identified by number, shall be construed to refer to such chapter, section or provision of this code.

C106.3 Other laws. The provisions of this code shall not be deemed to nullify any provisions of local, state or federal law. In addition to the requirements of this code, all occupancies shall conform to the provisions included in the State Building Code (chapter 19.27 RCW). In case of conflicts among the codes enumerated in RCW 19.27.031 (1) through (4) and this code, an earlier named code shall govern over those following. In the case of conflict between the duct sealing and insulation requirements of this code and the duct insulation requirements of Sections 603 and 604 of the *International Mechanical Code*, the duct insulation requirements of this code, or where applicable, a local jurisdiction's energy code shall govern.

SECTION C107 FEES

C107.1 Fees. A permit shall not be issued until the fees prescribed in Section C107.2 have been paid, nor shall an amendment to a permit be released until the additional fee, if any, has been paid.

C107.2 Schedule of permit fees. A fee for each permit shall be paid as required, in accordance with the schedule as established by the applicable governing authority.

C107.3 Work commencing before permit issuance. Any person who commences any work before obtaining the necessary permits shall be subject to an additional fee established by the *code official*, which shall be in addition to the required permit fees.

C107.4 Related fees. The payment of the fee for the construction, *alteration*, removal or demolition of work done in connection to or concurrently with the work or activity authorized by a permit shall not relieve the applicant or holder of the permit from the payment of other fees that are prescribed by law.

C107.5 Refunds. The *code official* is authorized to establish a refund policy.

SECTION C108 STOP WORK ORDER

C108.1 Authority. Whenever the *code official* finds any work regulated by this code being performed in a manner either contrary to the provisions of this code or dangerous or unsafe, the *code official* is authorized to issue a stop work order.

C108.2 Issuance. The stop work order shall be in writing and shall be given to the owner of the property involved, the owner's authorized agent, or to the person doing the work. Upon issuance of a stop work order, the cited work shall immediately cease. The stop work order shall state the reason for the order, and the conditions under which the cited work will be permitted to resume.

C108.3 Emergencies. Where an emergency exists, the *code official* shall not be required to give a written notice prior to stopping the work.

C108.4 Failure to comply. Any person who shall continue any work after having been served with a stop work order, except such work as that person is directed to perform to remove a violation or unsafe condition, shall be liable to a fine as set by the applicable governing authority.

SECTION C109 BOARD OF APPEALS

C109.1 General. In order to hear and decide appeals of orders, decisions or determinations made by the *code official* relative to the application and interpretation of this code, there shall be and is hereby created a board of appeals. The *code official* shall be an ex officio member of said board but shall have no vote on any matter before the board. The board of appeals shall be appointed by the governing body and shall hold office at its pleasure. The board shall adopt rules of procedure for conducting its business, and shall render all decisions and findings in writing to the appellant with a duplicate copy to the *code official*.

C109.2 Limitations on authority. An application for appeal shall be based on a claim that the true intent of this code or the rules legally adopted thereunder have been incorrectly interpreted, the provisions of this code do not fully apply or an equally good or better form of construction is proposed. The board shall have no authority to waive requirements of this code.

C109.3 Qualifications. The board of appeals shall consist of members who are qualified by experience and training and are not employees of the jurisdiction.

SECTION C110 VIOLATIONS

It shall be unlawful for any person, firm, or corporation to erect or construct any building, or remodel or rehabilitate any existing building or structure in the state, or allow the same to be done, contrary to or in violation of any of the provisions of this code.

SECTION C111 LIABILITY

Nothing contained in this code is intended to be nor shall be construed to create or form the basis for any liability on the part of any city or county or its officers, employees or agents for any injury or damage resulting from the failure of a building to conform to the provisions of this code.

CHAPTER 2 [CE]

DEFINITIONS

SECTION C201 GENERAL

C201.1 Scope. Unless stated otherwise, the following words and terms in this code shall have the meanings indicated in this chapter.

C201.2 Interchangeability. Words used in the present tense include the future; words in the masculine gender include the feminine and neuter; the singular number includes the plural and the plural includes the singular.

C201.3 Terms defined in other codes. Terms that are not defined in this code but are defined in the *International Building Code*, *International Fire Code*, *International Fuel Gas Code*, *International Mechanical Code*, *Uniform Plumbing Code* or the *International Residential Code* shall have the meanings ascribed to them in those codes.

C201.4 Terms not defined. Terms not defined by this chapter shall have ordinarily accepted meanings such as the context implies.

SECTION C202 GENERAL DEFINITIONS

ABOVE-GRADE WALL. A wall enclosing *conditioned space* that is not a below-grade wall. This includes between-floor spandrels, peripheral edges of floors, roof and basement knee walls, dormer walls, gable end walls, walls enclosing a mansard roof and skylight shafts.

ACCESS (TO). That which enables a device, appliance or equipment to be reached by ready access or by a means that first requires the removal or movement of a panel or similar obstruction.

ACCESSIBLE. ~~Admitting close approach as a result of not being guarded by locked doors, elevation or other effective means (see "Readily accessible").~~

ADDITION. An extension or increase in the *conditioned space* floor area, number of stories, or height of a building or structure.

AIR BARRIER. ~~Material(s) assembled and~~ One or more materials joined together in a continuous manner to ~~provide a barrier to air leakage through the building envelope. An air barrier may be a single material or a combination of materials~~ restrict or prevent the passage of air through the building thermal envelope and its assemblies.

AIR CURTAIN. A device, installed at the building entrance, that generates and discharges a laminar air stream intended to prevent the infiltration of external, unconditioned air into the conditioned spaces, or the loss of interior, conditioned air to the outside.

ALTERATION. Any construction, retrofit or renovation to an existing structure other than repair or addition ~~that requires a permit~~. Also, a change in a building, electrical, gas, mechanical or plumbing system that involves an extension, addition or change to the arrangement, type or purpose of the original installation ~~that requires a permit~~.

APPROVED. ~~Approval by Acceptable to the code official as a result of investigation and tests conducted by him or her, or by reason of accepted principles or tests by nationally recognized organizations.~~

APPROVED AGENCY. An established and recognized agency regularly engaged in conducting tests or furnishing inspection services, or furnishing product certification research reports, when such agency has been *approved* by the code official.

ATTIC AND OTHER ROOFS. All other roofs, including roofs with insulation entirely below (inside of) the roof structure (i.e., attics, cathedral ceilings, and single-rafter ceilings), roofs with insulation both above and below the roof structure, and roofs without insulation but excluding roofs with insulation entirely above deck and metal building roofs.

AUTOMATIC. Self-acting, operating by its own mechanism when actuated by some impersonal influence, as, for example, a change in current strength, pressure, temperature or mechanical configuration (see "Manual").

BELOW-GRADE WALL. That portion of a wall in the building envelope that is entirely below the finish grade and in

contact with the ground.

BLOCK. A generic concept used in energy simulation. It can include one or more thermal zones. It represents a whole building or portion of a building with the same use type served by the same HVAC system type.

Commented [BK(9)]: E
M050-2018

BOILER, MODULATING. A boiler that is capable of more than a single firing rate in response to a varying temperature or heating load.

BOILER SYSTEM. One or more boilers, their piping and controls that work together to supply steam or hot water to heat output devices remote from the boiler.

BUBBLE POINT. The refrigerant liquid saturation temperature at a specified pressure.

BUILDING. Any structure used or intended for supporting or sheltering any use or occupancy, including any mechanical systems, service water heating systems and electric power and lighting systems located on the building site and supporting the building.

BUILDING COMMISSIONING. A process that verifies and documents that the ~~selected~~ building systems have been designed, installed, and function according to the ~~owner's project requirements and approved~~ construction documents, ~~and to minimum code requirements.~~

Commented [BK(10)]:
C146-2018

BUILDING ENTRANCE. ~~Any door, set of doors, doorway, or other form of portal that is used to gain access to the building from the outside by the public~~ Any doorway, set of doors, revolving door, vestibule, or other form of portal that is ordinarily used to gain access to the building or to exit from the building by its users and occupants. This does not include doors solely used to directly enter mechanical, electrical, and other building utility service equipment rooms, or doors for emergency egress only.

Commented [BK(11)]:
nv006-2018

BUILDING SITE. A contiguous area of land that is under the ownership or control of one entity.

BUILDING THERMAL ENVELOPE. The below-grade walls, above-grade walls, floors, ceilings, roofs, and any other building element assemblies that enclose conditioned space or provides a boundary between conditioned space, semiheated space and exempt or unconditioned space.

C-FACTOR (THERMAL CONDUCTANCE). The coefficient of heat transmission (surface to surface) through a building component or assembly, equal to the time rate of heat flow per unit area and the unit temperature difference between the warm side and cold side surfaces (Btu/h ft² x °F) [W/(m² x K)].

CAPTIVE KEY DEVICE. A lighting control that will not release the key that activates the override when the lighting is on.

CAVITY INSULATION. Insulating material located between framing members.

CERTIFIED COMMISSIONING PROFESSIONAL. An individual who is certified by an ANSI/ISO/IEC 17024:2012 accredited organization to lead, plan, coordinate, and manage commissioning teams and implement the commissioning processes, ~~or a licensed professional engineer in Washington state.~~

Commented [BK(12)]:
C146-2018

CHANGE OF OCCUPANCY. A change in the use of a building or a portion of a building that results in any of the following:

1. A change of occupancy classification.
2. A change from one group to another group within an occupancy classification.
3. Any change in use within a group for which there is a change in the application of the requirements of this code.

CIRCULATING HOT WATER SYSTEM. A specifically designed water distribution system where one or more pumps are operated in the service hot water piping to circulate heated water from the water-heating equipment to the fixture supply and back to the water-heating equipment.

CLERESTORY FENESTRATION. See "Fenestration."

CLIMATE ZONE. A geographical region based on climatic criteria as specified in this code.

CODE OFFICIAL. The officer or other designated authority charged with the administration and enforcement of this code, or a duly authorized representative.

COEFFICIENT OF PERFORMANCE (COP) - COOLING. The ratio of the rate of heat removal to the rate of energy input, in consistent units, for a complete refrigerating system or some specific portion of that system under designated operating conditions.

COEFFICIENT OF PERFORMANCE (COP) - HEATING. The ratio of the rate of heat removal to the rate of heat delivered to the rate of energy input, in consistent units, for a complete heat pump system, including the compressor and, if applicable, auxiliary heat, under designated operating conditions.

COMMERCIAL BUILDING. For this code, all buildings not included in the definition of "Residential buildings."

COMPUTER ROOM. A room whose primary function is to house equipment for the processing and storage of electronic data and that has a design ~~electronic data~~ information technology equipment (ITE) equipment power density exceeding 20 watts per square foot of conditioned area and a design ITE equipment load less than or equal to 10 kW.

Commented [BK(13)]:
AG initially recommended deletion of this definition. It was reinstated and modified by EM051-2018

CONDENSING UNIT. A factory-made assembly of refrigeration components designed to compress and liquefy a specific refrigerant. The unit consists of one or more refrigerant compressors, refrigerant condensers (air-cooled, evaporatively cooled, or water-cooled), condenser fans and motors (where used) and factory-supplied accessories.

CONDITIONED FLOOR AREA. The horizontal projection of the floors associated with the *conditioned space*.

CONDITIONED SPACE. An area, room or space that is enclosed within the building thermal envelope and that is directly heated or cooled or that is indirectly heated or cooled. Spaces are indirectly heated or cooled where they communicate through openings with conditioned spaces, where they are separated from conditioned spaces by uninsulated walls, floors or ceilings, or where they contain uninsulated ducts, piping or other sources of heating or cooling.

~~**CONTINUOUS AIR BARRIER.** A combination of materials and assemblies that restrict or prevent the passage of air through the building thermal envelope.~~

CONTINUOUS INSULATION (CI). Insulating material that is continuous across all structural members without metal thermal bridges other than fasteners that have a total cross-sectional area not greater than 0.04 percent of the envelope surface through which they penetrate, and service openings. It is installed on the interior or exterior or is integral to any opaque surface of the building envelope.

Commented [BK(14)]:
nv009-2018

Commented [BK(15)]:
nv009-2018

CONTROLLED PLANT GROWTH ENVIRONMENT. Group F and U buildings or spaces that are specifically controlled to facilitate and enhance plant growth and production by manipulating various indoor environmental conditions. Technologies include indoor agriculture, cannabis growing, hydroponics, aquaculture and aquaponics. Controlled indoor environment variables include, but are not limited to, temperature, air quality, humidity and carbon dioxide.

CURTAIN WALL. Fenestration products used to create an external nonload-bearing wall that is designed to separate the exterior and interior environments.

DATA ACQUISITION SYSTEM. An electronic system managed by the building owner to collect, tabulate and display metering information.

DATA CENTER. A room or series of rooms that share *Data Center Systems* whose primary function is to house equipment for the processing and storage of electronic data, which has a design total *information technology equipment (ITE)* equipment power density exceeding 20 watts per square foot of conditioned area and a total design ITE equipment load greater than 10 kW.

DATA CENTER SYSTEMS. HVAC systems, electrical systems, equipment, or portions thereof used to condition *ITE* or electrical systems in a *data center*. *Data center systems* may also be shared, serving other *data center* additions or non-*data-center* loads.

Commented [BK(16)]:
M051-2018

DAYLIGHT RESPONSIVE CONTROL. A device or system that provides automatic control of electric light levels based on the amount of daylight in a space.

DAYLIGHT ZONE. The portion of the building interior floor area that is illuminated by natural daylight through sidelit and toplit fenestration.

DECORATIVE APPLIANCE, VENTED. A vented appliance wherein the primary function lies in the aesthetic effect of the flames.

Commented [BK(17)]:
M075-2018

DEMAND CONTROL VENTILATION (DCV). A ventilation system capability that provides for the automatic reduction of outdoor air intake below design rates when the actual occupancy of spaces served by the system is less than design occupancy.

~~**DEMAND RECIRCULATION WATER SYSTEM.** A water distribution system where pumps prime the service hot water piping with heated water upon demand for hot water having one or more recirculation pumps that pump water from a~~

heated water supply pipe back to the heated water source through a cold water supply pipe.

DOOR, NONSWINGING. Roll-up, tilt-up, metal coiling and sliding doors, access hatches, and all other doors that are not swinging doors.

DOORS, SWINGING. Doors that are hinged on one side and revolving doors.

DUCT. A tube or conduit utilized for conveying air. The air passages of self-contained systems are not to be construed as air ducts.

DUCT SYSTEM. A continuous passageway for the transmission of air that, in addition to ducts, includes duct fittings, dampers, plenums, fans and accessory air-handling equipment and appliances.

DWELLING UNIT. A single unit providing complete independent living facilities for one or more persons, including permanent provisions for living, sleeping, eating, cooking and sanitation.

DYNAMIC GLAZING. Any fenestration product that has the fully reversible ability to change its performance properties, including *U*-factor, SHGC, or VT.

ECONOMIZER, AIR. A duct and damper arrangement and automatic control system that allows a cooling system to supply outside air to reduce or eliminate the need for mechanical cooling during mild or cold weather.

ECONOMIZER, WATER. A system where the supply air of a cooling system is cooled indirectly with water that is itself cooled by heat or mass transfer to the environment without the use of mechanical cooling.

ENCLOSED SPACE. A volume surrounded by solid surfaces such as walls, floors, roofs, and openable devices such as doors and operable windows.

ELECTRICAL LOAD COEFFICIENT (ELC). In a *data center*, the ratio of the sum of three specific electrical losses (or losses calculated from efficiencies), to the *information technology equipment (ITE)* load itself. Specifically, *ELC* equals the sum of the incoming (to *ITE*) electrical service losses, UPS losses, and *ITE* distribution losses all divided by this peak *ITE* load. The design *ELC* is calculated at the full load design condition with active redundant equipment engaged, and the annual *ELC* is calculated the same way because it is assumed that *ITE* runs constantly at full power all year.

Commented [BK(18):
M051-2018

END USE CATEGORY. A load or group of loads that consume energy in a common or similar manner.

ENERGY ANALYSIS. A method for estimating the annual energy use of the *proposed design* and *standard reference design* based on estimates of energy use.

ENERGY COST. The total estimated annual cost for purchased energy for the building functions regulated by this code, including applicable demand charges.

ENERGY RECOVERY VENTILATION SYSTEM. Systems that employ air-to-air heat exchangers to recover energy from exhaust air for the purpose of preheating, precooling, humidifying or dehumidifying outdoor ventilation air prior to supplying the air to a space, either directly or as part of an HVAC system.

ENERGY SIMULATION TOOL. An *approved* software program or calculation-based methodology that projects the annual energy use of a building.

ENERGY SOURCE METER. A meter placed at the source of the incoming energy that measures the energy delivered to the whole building or metered space.

ENTRANCE DOOR. A vertical fenestration products used for *occupant* ingress, egress and access in nonresidential buildings including, but not limited to, exterior entrances ~~that utilize utilizing~~ latching hardware and automatic closers and containing over 50 percent ~~glass-glazing~~ specifically designed to withstand heavy ~~use and possibly-abused~~ duty usage.

EQUIPMENT ROOM. A space that contains either electrical equipment, mechanical equipment, machinery, water pumps or hydraulic pumps that are a function of the building's services.

EXTERIOR WALL. Walls including both above-grade walls and below-grade walls.

FAN BRAKE HORSEPOWER (BHP). The horsepower delivered to the fan's shaft. Brake horsepower does not include the mechanical drive losses (belts, gears, etc.).

FAN EFFICIENCY GRADE (FEG). A numerical rating identifying the fan's aerodynamic ability to convert shaft power, or impeller power in the case of a direct-driven fan, to air power.

FAN SYSTEM BHP. The sum of the fan brake horsepower of all fans that are required to operate at fan system design conditions to supply air from the heating or cooling source to the *conditioned space(s)* and return it to the source or exhaust it to the outdoors.

FAN SYSTEM DESIGN CONDITIONS. Operating conditions that can be expected to occur during normal system operation that result in the highest supply fan airflow rate to conditioned spaces served by the system, other than during air economizer operation.

FAN SYSTEM MOTOR NAMEPLATE HP. The sum of the motor nameplate horsepower of all fans that are required to operate at design conditions to supply air from the heating or cooling source to the *conditioned space(s)* and return it to the source or exhaust it to the outdoors.

FENESTRATION. Products classified as either skylights or vertical fenestration ~~or skylights.~~

SKYLIGHTS. Glass or other transparent or translucent glazing material installed at a slope of less than 60 degrees (91.05 rad) from horizontal, including unit skylights, tubular daylighting devices and glazing materials in solariums, sunrooms, roofs and sloped walls.

VERTICAL FENESTRATION. Windows ~~(fixed or moveable)~~ that are fixed or operable, glazed doors, glazed block and combination opaque/glazed doors composed of glass or other transparent or translucent glazing materials and installed at a slope of at least not less than 60 degrees (91.05 rad) from horizontal. Opaque areas such as spandrel panels are not considered vertical fenestration.

CLERESTORY FENESTRATION. An upper region of vertical fenestration provided for the purpose of admitting daylight beyond the perimeter of a space. The entire clerestory fenestration assembly is installed at a height greater than 8 feet above the finished floor.

FENESTRATION AREA. Total area of the fenestration measured using the rough opening, and including the glazing, sash and frame.

FENESTRATION PRODUCT, FIELD-FABRICATED. A fenestration product whose frame is made at the construction site of standard dimensional lumber or other materials that were not previously cut, or otherwise formed with the specific intention of being used to fabricate a fenestration product or exterior door. Field fabricated does not include site-built fenestration.

FENESTRATION PRODUCT, SITE-BUILT. A fenestration designed to be made up of field-glazed or field-assembled units using specific factory cut or otherwise factory-formed framing and glazing units. Examples of site-built fenestration include storefront systems, curtain walls, and atrium roof systems.

F-FACTOR. The perimeter heat loss factor for slab-on-grade floors (Btu/h x ft x °F) [W/(m x K)].

FLOOR AREA, NET. The actual occupied area not including unoccupied accessory areas such as corridors, stairways, toilet rooms, mechanical rooms and closets.

FURNACE ELECTRICITY RATIO. The ratio of furnace electricity use to total furnace energy computed as ratio $. = (3.412 \times E_{AE}) / (1000 \times E_F + 3.412 \times E_{AE})$ where E_{AE} (average annual auxiliary electrical consumption) and E_F (average annual fuel energy consumption) are defined in Appendix N to Subpart B of Part 430 of Title 10 of the Code of Federal Regulations and E_F is expressed in millions of Btus per year.

GENERAL LIGHTING. Lighting that provides a substantially uniform level of illumination throughout an area. General lighting shall not include lighting that provides a dissimilar level of illumination to serve a specific application or decorative feature within such area.

~~**GENERAL PURPOSE ELECTRIC MOTOR (SUBTYPE I).** A motor that is designed in standard ratings with either of the following:~~

- ~~1.—Standard operating characteristics and standard mechanical construction for use under usual service conditions, such as those specified in NEMA MG1, paragraph 14.02, “Usual Service Conditions,” and without restriction to a particular application or type of application.~~
 - ~~2.—Standard operating characteristics or standard mechanical construction for use under unusual service conditions, such as those specified in NEMA MG1, paragraph 14.03, “Unusual Service Conditions,” or for a particular type of application, and that can be used in most general purpose applications.~~
- ~~—General purpose electric motors (Subtype I) are constructed in NEMA T-frame sizes or IEC metric equivalent, starting at 143T.~~

~~GENERAL PURPOSE ELECTRIC MOTOR (SUBTYPE II). A motor incorporating the design elements of a general-purpose electric motor (Subtype I) that is configured as one of the following:~~

- ~~1. A U-frame motor.~~
- ~~2. A Design C motor.~~
- ~~3. A close-coupled pump motor.~~
- ~~4. A footless motor.~~
- ~~5. A vertical, solid-shaft, normal-thrust motor (as tested in a horizontal configuration).~~
- ~~6. An 8-pole motor (900 rpm).~~
- ~~7. A polyphase motor with voltage of not more than 600 volts (other than 230 or 460 volts).~~

GREENHOUSE. A structure or a thermally isolated area of a building that maintains a specialized sunlit environment that is used exclusively for, and essential to, the cultivation, protection or maintenance of plants. Greenhouses are those that are erected for a period of 180 days or more.

GROUP R. Buildings or portions of buildings that contain any of the following occupancies as established in the *International Building Code*:

1. Group R-1.
2. Group R-2 where located more than three stories in height above grade plane.

HEAT TRAP. An arrangement of piping and fittings, such as elbows, or a commercially available heat trap that prevents thermosiphoning of hot water during standby periods.

HEAT TRAP, PIPE CONFIGURED. A pipe configured heat trap is either, as applicable:

1. A device specifically designed for the purpose or an arrangement of tubing that forms a loop of 360 degrees, or
2. Piping that from the point of connection to the water heater (inlet or outlet) includes a length of piping directed downward before connection to the vertical piping of the supply water or hot-water distribution system.

HEATED SLAB-ON-GRADE FLOOR. Slab-on-grade floor construction in which the heating elements, hydronic tubing, or hot air distribution system is in contact with, or placed within or under, the slab.

HIGH SPEED DOOR. A nonswinging door used primarily to facilitate vehicular access or material transportation, with a minimum opening rate of 32 inches (813 mm) per second, a minimum closing rate of 24 inches (610 mm) per second and that includes an automatic-closing device.

HISTORIC BUILDINGS. Buildings that are listed in or eligible for listing in the National Register of Historic Places, or designated as historic under an appropriate state or local law.

HUMIDISTAT. A regulatory device, actuated by changes in humidity, used for automatic control of relative humidity.

HVAC TOTAL SYSTEM PERFORMANCE RATIO (HVAC TSPR). The ratio of the sum of a building's annual heating and cooling load in thousands of Btus to the sum of annual carbon emissions in pounds from energy consumption of the building HVAC systems. Carbon emissions shall be calculated by multiplying site energy consumption by the carbon emission factors from Table C407.1.

IEC DESIGN H MOTOR. An electric motor that meets all of the following:

1. It is an induction motor designed for use with three-phase power.
2. It contains a cage rotor.
3. It is capable of direct-on-line starting.
4. It has 4, 6 or 8 poles.
5. It is rated from 0.4 kW to 1600 kW at a frequency of 60 Hz.

IEC DESIGN N MOTOR. An electric motor that meets all of the following:

1. It is an inductor motor designed for use with three-phase power.
2. It contains a cage rotor.
3. It is capable of direct-on-line starting.
4. It has 2, 4, 6 or 8 poles.
5. It is rated from 0.4 kW to 1600 kW at a frequency of 60 Hz.

Commented [BK(19):
W104-2018

Commented [BK(20):
M050-2018

INFILTRATION. The uncontrolled inward air leakage into a building caused by the pressure effects of wind or the effect of differences in the indoor and outdoor air density or both.

INFORMATION TECHNOLOGY EQUIPMENT (ITE). ITE includes computers, data storage, servers, and network/communication equipment.

Commented [BK(21):
M051-2018

INSULATION ENTIRELY ABOVE DECK. A roof with all insulation:

1. Installed above (outside of) the roof structure; and
2. Continuous (i.e., uninterrupted by framing members).

INTEGRATED ENERGY EFFICIENCY RATIO (IEER). A single-number figure of merit expressing cooling part-load EER efficiency for unitary air-conditioning and heat pump equipment on the basis of weighted operation at various load capacities for the equipment.

INTEGRATED PART LOAD VALUE (IPLV). A single number figure of merit based on part-load EER, COP, or kW/ton expressing part-load efficiency for air conditioning and heat pump equipment on the basis of weighted operation at various load capacities for equipment.

ISOLATION DEVICES. Devices that isolate HVAC zones so they can be operated independently of one another. Isolation devices include separate systems, isolation dampers and controls providing shutoff at terminal boxes.

LABELED. Equipment, materials or products to which have been affixed a label, seal, symbol or other identifying mark of a nationally recognized testing laboratory, ~~inspection-approved~~ agency or other organization concerned with product evaluation that maintains periodic inspection of the production of the above-labeled items and whose labeling indicates either that the equipment, material or product meets identified standards or has been tested and found suitable for a specified purpose.

LINER SYSTEM (LS). A system that includes the following:

1. A continuous vapor barrier liner membrane that is installed below the purlins and that is uninterrupted by framing members.
2. An uncompressed, unfaced insulation resting on top of the liner membrane and located between the purlins.

For multilayer installations, the last rated *R-value* of insulation is for unfaced insulation draped over purlins and then compressed when the metal roof panels are attached.

LISTED. Equipment, materials, products or services included in a list published by an organization acceptable to the *code official* and concerned with evaluation of products or services that maintains periodic inspection of production of *listed* equipment or materials or periodic evaluation of services and whose listing states either that the equipment, material, product or service meets identified standards or has been tested and found suitable for a specified purpose.

LOW SLOPED ROOF. A roof having a slope less than 2 units vertical in 12 units horizontal.

LOW-VOLTAGE DRY-TYPE DISTRIBUTION TRANSFORMER. A transformer that is air-cooled, does not use oil as a coolant, has an input voltage less than or equal to 600 volts and is rated for operation at a frequency of 60 hertz.

LOW-VOLTAGE LIGHTING. A lighting system consisting of an isolating power supply, the low voltage luminaires, and associated equipment that are all identified for the use. The output circuits of the power supply operate at 30-volts (42.4 volts peak) or less under all load conditions.

Commented [BK(22):
L119-2018 -
Deleted in IECC
2018

LUMINAIRE. A complete lighting unit consisting of a lamp or lamps together with the housing designed to distribute the light, position and protect the lamps, and connect the lamps to the power supply.

LUMINAIRE-LEVEL LIGHTING CONTROL. A lighting system consisting of one or more *luminaire(s)*, each with where each luminaire has embedded lighting control logic, occupancy and ambient light sensors, ~~local or central wireless networking capabilities~~, and local override switching capability, where required. Each luminaire shall also have wireless networking capabilities to detect and share information with other luminaires to adjust to occupancy and/or daylight in the space.


Commented [BK(23):
L114-2018

MANUAL. Capable of being operated by personal intervention (see "Automatic").

MASS TRANSFER DECK SLAB EDGE. That portion of the above-grade wall made up of the concrete slab where it extends past the footprint of the floor above, and there is space (conditioned or unconditioned) below the slab. The area of the slab edge shall be defined as the thickness of the slab multiplied by the perimeter of the edge condition. Examples of this condition include, but are not limited to, the transition from an above-grade structure to a below-grade structure or the transition from a tower to a podium. Cantilevered balconies do not meet this definition.

Commented [BK(24):
nv007-2018

Commented [BK(25):
nv007-2018

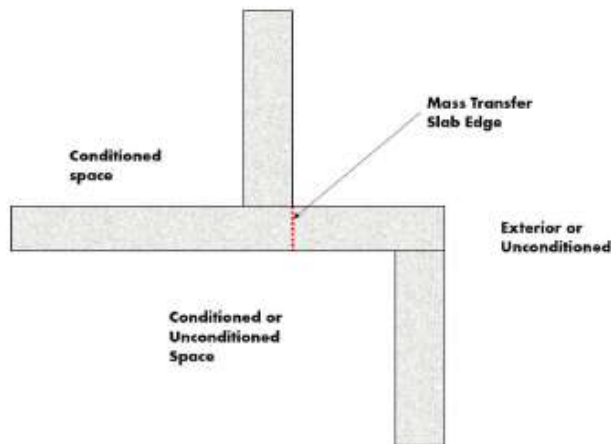

MECHANICAL COOLING. Reducing the temperature of a gas or liquid by using vapor compression, absorption, desiccant dehumidification combined with evaporative cooling, or another energy-driven thermodynamic cycle. Indirect or direct evaporative cooling alone is not considered mechanical cooling.

MECHANICAL HEATING. Raising the temperature of a gas or liquid by use of fossil fuel burners, electric resistance heaters, heat pumps, or other systems that require energy to operate.

MECHANICAL LOAD COEFFICIENT (MLC). In a data center, the ratio of the cooling system's net use of energy to that of the ITE. The design MLC is calculated for a local peak weather condition (stipulated in the ASHRAE 90.4-2016 Standard) and equals the sum of all active cooling equipment input power, divided by total power into the ITE. The annual MLC is calculated using hourly TMY3 weather data for the data center's location and equals the sum of all energy flowing into the cooling system to respond to that weather, minus any energy successfully recovered to avoid any new energy use, all divided by the energy flowing into the ITE during the same period.

Commented [BK(26):
M049-2018

Commented [BK(27):
M049-2018

Commented [BK(28):
M051-2018

METAL BUILDING ROOF. A roof that:

1. Is constructed with a metal, structural, weathering surface;
2. Has no ventilated cavity; and
3. Has the insulation entirely below deck (i.e., does not include composite concrete and metal deck construction nor a roof framing system that is separated from the superstructure by a wood substrate) and whose structure consists of one or more of the following configurations:
 - a. Metal roofing in direct contact with the steel framing members;
 - b. Metal roofing separated from the steel framing members by insulation;
 - c. Insulated metal roofing panels installed as described in item a. or b.

METAL BUILDING WALL. A wall whose structure consists of metal spanning members supported by steel structural members (i.e., does not include spandrel glass or metal panels in curtain wall systems).

METER. A device that measures the flow of energy.

MICROCELL. A wireless communication facility consisting of an antenna that is either: (a) Four (4) feet in height and with an area of not more than 580 square inches; or (b) if a tubular antenna, no more than four (4) inches in diameter and no more than six (6) feet in length; and the associated equipment cabinet that is six (6) feet or less in height and no more than 48 square feet in floor area.

NAMEPLATE HORSEPOWER. The nominal motor ~~horsepower~~ output power rating stamped on the motor nameplate.

NEMA DESIGN A MOTOR. A squirrel-cage motor that meets all of the following:

1. It is designed to withstand full-voltage starting and developing locked-rotor torque as shown in paragraph 12.38.1 of NEMA MG 1.
2. It has pull-up torque not less than the values shown in paragraph 12.40.1 of NEMA MG 1.
3. It has breakdown torque not less than the values shown in paragraph 12.39.1 of NEMA MG 1.
4. It has a locked-rotor current higher than the values shown in paragraph 12.35.1 of NEMA MG 1 for 60 Hz and paragraph 12.35.2 of NEMA MG 1 for 50 Hz.
5. It has a slip at rated load of less than 5 percent for motors with fewer than 10 poles.

NEMA DESIGN B MOTOR. A squirrel-cage motor that meets all of the following:

1. It is designed to withstand full-voltage starting.
2. It develops locked-rotor, breakdown and pull-up torques adequate for general application as specified in Sections 12.38, 12.39 and 12.40 of NEMA MG 1.
3. It draws locked-rotor current not to exceed the values shown in paragraph 12.35.1 of NEMA MG 1 for 60 Hz and paragraph 12.35.2 of NEMA MG 1 for 50 Hz.
4. It has a slip at rated load of less than 5 percent for motors with fewer than 10 poles.

NEMA DESIGN C MOTOR. A squirrel-cage motor that meets all of the following:

1. It is designed to withstand full-voltage starting and developing locked-rotor torque for high-torque applications up to the values shown in paragraph 12.38.2 of NEMA MG 1 (incorporated by reference; see §431.15).
2. It has pull-up torque not less than the values shown in paragraph 12.40.2 of NEMA MG 1.
3. It has breakdown torque not less than the values shown in paragraph 12.39.2 of NEMA MG 1.
4. It has a locked-rotor current not to exceed the values shown in paragraph 12.35.1 of NEMA MG 1 for 60 Hz and paragraph 12.35.2 of NEMA MG 1 for 50 Hz.
5. It has a slip at rated load of less than 5 percent.

NETWORKED GUEST ROOM CONTROL SYSTEM. A control system, accessible from the front desk or other central location associated with a Group R-1 building, that is capable of identifying the occupancy status of each guest room according to a timed schedule, and is capable of controlling HVAC in each hotel and motel guest room separately.

NONSTANDARD PART LOAD VALUE (NPLV). A single-number part-load efficiency figure of merit calculated and referenced to conditions other than IPLV conditions, for units that are not designed to operate at ARI standard rating conditions.

OCCUPANT SENSOR CONTROL. An automatic control device or system that detects the presence or absence of people within an area and causes lighting, equipment or appliances to be regulated accordingly.

ON-SITE RENEWABLE ENERGY. Energy derived from solar radiation, wind, waves, tides, landfill gas, biogas, biomass, or the internal heat of the earth. The energy system providing on-site renewable energy shall be located on the project site.

OPAQUE DOOR. A door that is not less than 50 percent opaque in surface area.

PERSONAL WIRELESS SERVICE FACILITY. A wireless communication facility (WCF), including a microcell, which is a facility for the transmission and/or reception of radio frequency signals and which may include antennas, equipment shelter or cabinet, transmission cables, a support structure to achieve the necessary elevation, and reception and/or transmission devices or antennas.

POWERED ROOF/WALL VENTILATORS. A fan consisting of a centrifugal or axial impeller with an integral driver in a weather-resistant housing and with a base designed to fit, usually by means of a curb, over a wall or roof opening.

POWER-OVER-ETHERNET LIGHTING (POE). Lighting sources powered by DC current utilizing Ethernet cables.

PROPOSED DESIGN. A description of the proposed building used to estimate annual energy use and carbon emissions from energy consumption for determining compliance based on total building performance and HVAC total performance ratio.

PUBLIC LAVATORY FAUCET. A lavatory faucet that is not intended for private use as defined by the *Uniform Plumbing Code* and that is supplied with both potable cold and hot water.

RADIANT HEATING SYSTEM. A heating system that transfers heat to objects and surfaces within a conditioned space, primarily by infrared radiation.

~~**READILY ACCESSIBLE.** Capable of being reached quickly for operation, renewal or inspection without requiring those to whom ready access is requisite to climb over or remove obstacles or to resort to portable ladders or access equipment (see "Accessible").~~

READY ACCESS (TO). That which enables a device, appliance or equipment to be directly reached, without requiring the removal or movement of any panel or similar obstruction.

REFRIGERANT DEW POINT. The refrigerant vapor saturation temperature at a specified pressure.

Commented [BK(29):
L119-2018

Commented [BK(30):
M050-2018

Commented [BK(31):
W102-2018

REFRIGERATED WAREHOUSE COOLER. An enclosed storage space that has a total chilled storage area of 3,000 square feet or greater and is designed to maintain a temperature of greater than 32°F but less than 55°F.

REFRIGERATED WAREHOUSE FREEZER. An enclosed storage space that has a total chilled storage area of 3,000 ft² and is designed to maintain temperatures at or below 32°F.

REFRIGERATION SYSTEM, LOW TEMPERATURE. Systems for maintaining food product in a frozen state in refrigeration applications.

REFRIGERATION SYSTEM, MEDIUM TEMPERATURE. Systems for maintaining food product above freezing in refrigeration applications.

REGISTERED DESIGN PROFESSIONAL. An individual who is registered or licensed to practice their respective design profession as defined by the statutory requirements of the professional registration laws of the state or jurisdiction in which the project is to be constructed.

REPAIR. The reconstruction or renewal of any part of an existing building.

REPLACEMENT AIR. Outdoor air that is used to replace air removed from a building through an exhaust system. Replacement air may be derived from one or more of the following: makeup air, supply air, transfer air and infiltration. However, the ultimate source of all replacement air is outdoor air. When replacement air exceeds exhaust, the result is exfiltration.

Commented [BK(32):
M090-2018

REROOFING. The process of recovering or replacing an existing roof covering. See “Roof Recover” and “Roof Replacement.”

RESIDENTIAL BUILDING. For this code, includes detached one- and two-family dwellings and multiple single-family dwellings (townhouses) as well as Group R-2 ~~and~~, R-3 ~~and R-4~~ buildings three stories or less in height above grade plane.

RETROFIT, BUILDING ENVELOPE. Includes building envelope alterations and building envelope upgrades required for an area undergoing a change in space conditioning or a change in occupancy.

Commented [BK(33):
161-2018

ROOF ASSEMBLY. A system designed to provide weather protection and resistance to design loads. The system consists of a roof covering and roof deck or a single component serving as both the roof covering and the roof deck. A roof assembly includes the roof covering, underlayment, roof deck, insulation, vapor retarder and interior finish. See also attic and other roofs, metal building roof, roof with insulation entirely above deck and single-rafter roof.

Commented [BK(34):
nv008-2018

ROOF RECOVER. The process of installing an additional *roof covering* over a prepared existing roof covering without removing the existing roof covering.

ROOF REPAIR. Reconstruction or renewal of any part of an existing roof for the purposes of its maintenance.

ROOF REPLACEMENT. The process of removing the existing roof covering, repairing any damaged substrate and installing a new *roof covering*.

ROOFTOP MONITOR. A raised section of a roof containing vertical fenestration along one or more sides.

R-VALUE (THERMAL RESISTANCE). The inverse of the time rate of heat flow through a body from one of its bounding surfaces to the other surface for a unit temperature difference between the two surfaces, under steady state conditions, per unit area ($h \times \text{ft}^2 \times ^\circ\text{F}/\text{Btu}$) [$(\text{m}^2 \times \text{K})/\text{W}$].

SATURATED CONDENSING TEMPERATURE. The saturation temperature corresponding to the measured refrigerant pressure at the condenser inlet for single component and azeotropic refrigerants, and the arithmetic average of the dew point and *bubble point* temperatures corresponding to the refrigerant pressure at the condenser entrance for zeotropic refrigerants.

SCREW LAMP HOLDERS. ~~A lamp base that requires a screw-in type lamp, such as a compact fluorescent, incandescent, or tungsten-halogen bulb.~~

SEMI-HEATED SPACE. An enclosed space within a building, including adjacent connected spaces separated by an uninsulated component (e.g., basements, utility rooms, garages, corridors), which:

1. Is heated but not cooled, and has an ~~an~~ maximum-installed heating system output capacity ~~of greater than or equal to~~ 3.4 Btu/(h-ft²) but not greater than 8 Btu/(h-ft²);
2. Is not a walk-in or warehouse cooler or freezer space.

SENSIBLE RECOVERY EFFECTIVENESS. Change in the dry-bulb temperature of the outdoor air supply divided by the difference between the outdoor air and return air dry-bulb temperatures, expressed as a percentage, governed by

AHRI Standard 1060.

SERVICE WATER HEATING. Heating water for domestic or commercial purposes other than space heating and process requirements.

SIDELIT. See Section C405.2.4.2.

SINGLE-RAFTER ROOF. A roof where the roof above and the ceiling below are both attached to the same wood rafter and where insulation is located in the space between these wood rafters.

SKYLIGHT. See “Fenestration.”

SLAB BELOW GRADE. Any portion of a slab floor in contact with the ground which is more than 24 inches below the final elevation of the nearest exterior grade.

SLAB-ON-GRADE FLOOR. That portion of a slab floor of the building envelope that is in contact with the ground and that is either above grade or is less than or equal to 24 inches below the final elevation of the nearest exterior grade.

SLEEPING UNIT. A room or space in which people sleep, which can also include permanent provisions for living, eating, and either sanitation or kitchen facilities but not both. Such rooms and spaces that are also part of a dwelling unit are not *sleeping units*.

SMALL BUSINESS. Any business entity (including a sole proprietorship, corporation, partnership or other legal entity) which is owned and operated independently from all other businesses, which has the purpose of making a profit, and which has fifty or fewer employees.

SMALL ELECTRIC MOTOR. A general purpose, alternating current, single speed induction motor.

SOLAR HEAT GAIN COEFFICIENT (SHGC). The ratio of the solar heat gain entering the space through the fenestration assembly to the incident solar radiation. Solar heat gain includes directly transmitted solar heat and absorbed solar radiation which is then reradiated, conducted or convected into the space.

SPACE CONDITIONING CATEGORY. Categories are based on the allowed peak space conditioning output capacity per square foot of conditioned floor area, or the design setpoint temperature, for a building or space. Space conditioning categories from lowest to highest include: low energy, semi-heated, conditioned, refrigerated walk-in and warehouse coolers, and refrigerated walk-in and warehouse freezers.

STANDARD REFERENCE DESIGN. A version of the *proposed design* that meets the minimum requirements of this code and is used to determine the maximum annual energy use requirement **and carbon emissions from energy consumption** for compliance based on total building performance **and HVAC total system performance ratio**.

STEEL-FRAMED WALL. A *wall* with a cavity (insulated or otherwise) whose exterior surfaces are separated by steel framing members (i.e., typical steel stud *walls* and curtain *wall systems*).

STOREFRONT. A ~~nonresidential~~ system of doors and windows mullied as a composite fenestration structure that has been designed to resist heavy use. *Storefront* systems include, but are not limited to, exterior fenestration systems that span from the floor level or above to the ceiling of the same story on commercial buildings, with or without mullied windows and doors.

SUBSYSTEM METER. A meter placed downstream of the energy supply meter that measures the energy delivered to a load or a group of loads.

TEMPORARY GROWING STRUCTURE. A temporary growing structure has sides and roof covered with polyethylene, polyvinyl or similar flexible synthetic material and is used to provide plants with either frost protection or increased heat retention. Temporary structures are those that are erected for a period of less than 180 days.

THERMOSTAT. An automatic control device used to maintain temperature at a fixed or adjustable set point.

TIME SWITCH CONTROL. An automatic control device or system that controls lighting or other loads, including switching off, based on time schedules.

TOPLIT. See Section C405.2.4.3

TUBULAR DAYLIGHTING DEVICE (TDD). A non-operable skylight device primarily designed to transmit daylight from a roof surface to an interior ceiling surface via a tubular conduit. The device consists of an exterior glazed weathering surface, a light transmitting tube with a reflective inside surface and an interior sealing device, such as a translucent ceiling panel.

Commented [BK(35):
M065-2018

Commented [BK(36):
nv008-2018

Commented [BK(37):
nv037-2018

Commented [BK(38):
M050-2018

Commented [BK(39):
nv043-2018

U-FACTOR (THERMAL TRANSMITTANCE). The coefficient of heat transmission (air to air) through a building component or assembly, equal to the time rate of heat flow per unit area and unit temperature difference between the warm side and cold side air films (Btu/h × ft² × °F) [W/(m² × K)].

UNHEATED SLAB-ON-GRADE FLOOR. A slab-on-grade floor that is not a heated slab-on-grade floor.

UNIFORM ILLUMINATION. A quality of illumination delivered by a lighting system typically comprised of similar fixtures mounted at a regular spacing interval. This lighting system provides a uniform contrast ratio of no greater than 5:1 maximum-to-minimum ratio throughout the entire area served, including task areas.

VARIABLE REFRIGERANT FLOW SYSTEM. An engineered direct-expansion (DX) refrigerant system that incorporates a common condensing unit, at least one variable capacity compressor, a distributed refrigerant piping network to multiple indoor fan heating and cooling units each capable of individual zone temperature control, through integral zone temperature control devices and a common communications network. Variable refrigerant flow utilizes three or more steps of control on common interconnecting piping.

VENTILATION. The natural or mechanical process of supplying conditioned or unconditioned air to, or removing such air from, any space.

VENTILATION AIR. That portion of supply air that comes from outside (outdoors) plus any recirculated air that has been treated to maintain the desired quality of air within a designated space.

VERTICAL FENESTRATION. See “Fenestration.”

VISIBLE TRANSMITTANCE [VT]. The ratio of visible light entering the space through the fenestration product assembly to the incident visible light, visible transmittance, includes the effects of glazing material and frame and is expressed as a number between 0 and 1. For skylights, VT shall be measured and rated in accordance with NFRC 202.

VISIBLE TRANSMITTANCE – ANNUAL [VT-ANNUAL]. The ratio of visible light entering the space through the fenestration product assembly to the incident visible light during the course of a year, visible transmittance, which includes the effects of glazing material, frame, and light well or tubular conduit, and is expressed as a number between 0 and 1. For tubular daylighting devices, VT-annual shall be measured and rated in accordance with NFRC 203.

VOLTAGE DROP. A decrease in voltage caused by losses in the wiring system that connect the power source to the load.

WALK-IN COOLER. An enclosed storage space capable of being refrigerated to temperatures above 32°F but less than 55°F that can be walked into, has a ceiling height of not less than 7 feet (2134 mm) and has a total chilled storage area of less than 3,000 ft².

WALK-IN FREEZER. An enclosed storage space capable of being refrigerated to temperatures at or below 32°F that can be walked into, has a ceiling height of not less than 7 feet and has a total chilled storage area of less than 3,000 ft².

WALL. That portion of the *building envelope*, including opaque area and *fenestration*, that is vertical or tilted at an angle of 60 degrees from horizontal or greater. This includes *above-grade walls* and *below-grade walls*, between floor spandrels, peripheral edges of floors, and foundation *walls*.

WATER HEATER. Any heating appliance or equipment that heats potable water and supplies such water to the potable hot water distribution system.

WOOD-FRAMED AND OTHER WALLS. All other *wall* types, including wood stud *walls*.

ZONE. A space or group of spaces within a building with heating or cooling requirements that are sufficiently similar so that desired conditions can be maintained throughout using a single controlling device.

Commented [BK(40):
nv043-2018

Commented [BK(41):
nv043-2018

CHAPTER 3 [CE]

GENERAL REQUIREMENTS

SECTION C301 CLIMATE ZONES

C301.1 General. Climate zones from Table C301.1 shall be used in determining the applicable requirements from Chapter 4.

**TABLE C301.1
CLIMATE ZONES, MOISTURE REGIMES,
AND WARM-HUMID DESIGNATIONS
BY STATE AND COUNTY**

Key: A - Moist, B - Dry, C - Marine.
Absence of moisture designation indicates
moisture regime is irrelevant.

WASHINGTON

5B Adams	4C Lewis
5B Asotin	5B Lincoln
5B Benton	4C Mason
5B Chelan	5B Okanogan
4C Clallam	4C Pacific
4C Clark	5B Pend Oreille
5B Columbia	4C Pierce
4C Cowlitz	4C San Juan
5B Douglas	4C Skagit
5B Ferry	5B Skamania
5B Franklin	4C Snohomish
5B Garfield	5B Spokane
5B Grant	5B Stevens
4C Grays Harbor	4C Thurston
4C Island	4C Wahkiakum
4C Jefferson	5B Walla Walla
4C King	4C Whatcom
4C Kitsap	5B Whitman
5B Kittitas	5B Yakima
5B Klickitat	

SECTION C302 DESIGN CONDITIONS

C302.1 Interior design conditions. The interior design temperatures used for heating and cooling load calculations shall be a maximum of 72°F (22°C) for heating and minimum of 75°F (24°C) for cooling.

C302.2 Exterior design conditions. The heating or cooling outdoor design temperatures shall be selected from Appendix C.

SECTION C303 MATERIALS, SYSTEMS AND EQUIPMENT

C303.1 Identification. Materials, systems and equipment shall be identified in a manner that will allow a determination of compliance with the applicable provisions of this code.

C303.1.1 Building thermal envelope insulation. An *R*-value identification mark shall be applied by the manufacturer to each piece of *building thermal envelope* insulation 12 inches (305 mm) or greater in width. Alternatively, the insulation installers shall provide a certification listing the type, manufacturer and *R*-value of insulation installed in each element of the *building thermal envelope*. For blown or sprayed insulation (fiberglass and cellulose), the initial installed thickness, settled thickness, settled *R*-value, installed density, coverage area and number of bags installed shall be *listed* on the certification. For sprayed polyurethane foam (SPF) insulation, the installed thickness of the areas covered and *R*-value of installed thickness shall be *listed* on the certification. For insulated siding, the *R*-value shall be labeled on the product's package and shall be listed on the certification. The insulation installer shall sign, date and post the certification in a conspicuous location on the job site.

Exception: For roof insulation installed above the deck, the *R*-value shall be labeled as required by the material standards specified in Table 1508.2 of the *International Building Code*.

C303.1.1.1 Blown or sprayed roof/ceiling insulation. The thickness of blown-in or sprayed fiberglass and cellulose roof/ceiling insulation (~~fiberglass or cellulose~~) shall be written in inches (mm) on markers ~~that are installed at least one~~ for every 300 square feet (28 m²) of attic area throughout the attic space. The markers shall be affixed to the trusses or joists and marked with the minimum initial installed thickness with numbers of not less than 1 inch (25 mm) in height. Each marker shall face the attic access opening. Spray polyurethane foam thickness and installed *R*-value shall be *listed* on certification provided by the insulation installer.

C303.1.2 Insulation mark installation. Insulating materials shall be installed such that the manufacturer's *R*-value mark is readily observable upon inspection.

C303.1.3 Fenestration product rating. *U*-factors of fenestration ~~products (windows, doors and skylights)~~ shall be determined ~~in accordance with NFRC 100~~ as follows:

Exception: Where required, garage door *U*-factors shall be determined in accordance with either NFRC 100 or ANSI/SASMA 105.1. For windows, doors and skylights, *U*-factor ratings shall be determined in accordance with NFRC 100.

2. Where required for garage doors and rolling doors, *U*-factor ratings shall be determined in accordance with either NFRC 100 or ANSI/DASMA 105.

U-factors shall be determined by an accredited, independent laboratory, and labeled and certified by the manufacturer.

Products lacking such a labeled *U*-factor shall be assigned a default *U*-factor from Table C303.1.3(1), C303.1.3(2) or C303.1.3(4). The solar heat gain coefficient (SHGC) and visible transmittance (VT) of glazed fenestration products (windows, glazed doors and skylights) shall be determined in accordance with NFRC 200 by an accredited, independent laboratory, and labeled and certified by the manufacturer. Products lacking such a labeled SHGC or VT shall be assigned a default SHGC or VT from Table C303.1.3(3).

Exception: Units without NFRC ratings produced by a *small business* may be assigned default *U*-factors from Table C303.1.3(5) for vertical fenestration.

TABLE C303.1.3(1)
DEFAULT GLAZED ~~FENESTRATION-WINDOW, GLASS DOOR AND SKYLIGHT~~ *U*-FACTORS

FRAME TYPE	<u>Window and Glass Door</u>		SKYLIGHT
	SINGLE PANE	DOUBLE PANE	
Metal	1.20	0.80	See Table C303.1.3(4)
Metal with Thermal Break ¹	1.10	0.65	
Nonmetal or Metal Clad	0.95	0.55	
Glazed Block	0.60		

¹ Metal Thermal Break = A metal thermal break framed window shall incorporate the following minimum design characteristics:

- a) The thermal conductivity of the thermal break material shall be not more than 3.6 Btu-in/h/ft²/°F;
- b) The thermal break material must produce a gap in the frame material of not less than 0.210 inches; and
- c) All metal framing members of the products exposed to interior and exterior air shall incorporate a thermal break meeting the criteria in a) and b) above.

C303.1.4 Insulation product rating. The thermal resistance (*R*-value) of insulation shall be determined in accordance with the U.S. Federal Trade Commission *R*-value rule (C.F.R. Title 16, Part 460) in units of h × ft² × °F/Btu at a mean temperature of 75°F (24°C).

C303.1.4.1 Insulated siding. The thermal resistance (*R*-value) shall be determined in accordance with ASTM C1363. Installation for testing shall be in accordance with the manufacturer's installation instructions.

C303.1.5 Spandrel panels in glass curtain walls. Table C303.1.5 provides default U-factors for the spandrel section of glass and other curtain wall systems. Design factors that affect performance are the type of framing, the type of spandrel panel and the *R*-value of insulation. Four framing conditions are considered in the table. The first is the common case where standard aluminum mullions are used. Standard mullions provide a thermal bridge through the insulation, reducing its effectiveness. The second case is for metal framing members that have a thermal break. A thermal break frame uses a urethane or other non-metallic element to separate the metal exposed to outside conditions from the metal that is exposed to interior conditions. The third case is for structural glazing or systems where there are no exposed mullions on the exterior. The fourth case is for the condition where there is no framing or the insulation is continuous and uninterrupted by framing. The columns in the table can be used for any specified level of insulation between framing members installed in framed curtain walls or spandrel panels.

Commented [BK(42):
nv010-2018

C303.1.5.1 Window wall application. Where "window wall" or similar assembly that is discontinuous at intermediate slab edges is used, the slab edge U-value shall be as listed in Appendix Table A103.3.7.1(3) or as determined using an approved calculation.

303.1.5.2 Table value assumptions. In addition to the spandrel panel assembly, the construction assembly U-factors assume an air gap between the spandrel panel (with an *R*-value of 1.39) and one layer of 5/8-inch gypsum board (with an *R*-value of 0.56) that provides the interior finish. The gypsum board is assumed to span between the window sill and a channel at the floor. For assemblies that differ from these assumptions, custom U-factors can be calculated to account for any amount of continuous insulation or for unusual construction assemblies using Equations 3-1, 3-2 or 3-3 where appropriate. Spandrel panel U-factors for assemblies other than those covered by this table or Equations 1-3 may be determined using an alternate approved methodology. Equations 3-1 through 3-3 do not calculate the value of any insulation inboard of the curtain wall assembly.

Aluminum without Thermal Break

(Equation 3-1)

$$U_{\text{overall}} = \left[(R_{\text{gypsum}} + R_{\text{airgap}}) + \left[\frac{1}{0.2798 + \left(R_{\text{added insulation}} + \frac{0.8829}{\left(\frac{1}{U_{\text{center of glass}}} \right)} \right)} \right] \right]$$

Aluminum with Thermal Break

(Equation 3-2)

$$U_{\text{overall}} = \left[(R_{\text{gypsum}} + R_{\text{airgap}}) + \left[\frac{1}{0.1808 + \left(R_{\text{added insulation}} + \frac{0.8874}{\left(\frac{1}{U_{\text{center of glass}}} \right)} \right)} \right] \right]$$

$$U_{\text{overall}} = \left[(R_{\text{gypsum}} + R_{\text{airgap}}) + \left[\frac{1}{0.1151 + \left(\frac{0.3487}{R_{\text{added insulation}} + \left(\frac{1}{U_{\text{center of glass}}} \right)} \right)} \right] \right]$$

Table C303.1.5
U-Factors for Spandrel Panels and Glass Curtain Walls

		Rated R-Value of Insulation Between Framing Members								
			None	R-4	R-7	R-10	R-15	R-20	R-25	R-30
Frame Type	Spandrel Panel		A	B	C	D	E	F	G	H
Aluminum without Thermal Break	Single glass pane, stone or metal panel	1	0.360	0.242	0.222	0.212	0.203	0.198	0.195	0.193
	Double glass with no low-e coatings	2	0.297	0.233	0.218	0.209	0.202	0.197	0.194	0.192
	Triple or low-e glass	3	0.267	0.226	0.214	0.207	0.200	0.196	0.194	0.192
Aluminum with Thermal Break	Single glass pane, stone or metal panel	4	0.350	0.211	0.186	0.173	0.162	0.155	0.151	0.149
	Double glass with no low-e coatings	5	0.278	0.200	0.180	0.170	0.160	0.154	0.151	0.148
	Triple or low-e glass	6	0.241	0.191	0.176	0.167	0.159	0.153	0.150	0.148
Structural Glazing	Single glass pane, stone or metal panel	7	0.354	0.195	0.163	0.147	0.132	0.123	0.118	0.114
	Double glass with no low-e coatings	8	0.274	0.180	0.156	0.142	0.129	0.122	0.117	0.114
	Triple or low-e glass	9	0.231	0.169	0.150	0.138	0.127	0.121	0.116	0.113
No Framing, or Insulation is Continuous	Single glass pane, stone or metal panel	10	0.360	0.148	0.102	0.078	0.056	0.044	0.036	0.031
	Double glass with no low-e coatings	11	0.297	0.136	0.097	0.075	0.054	0.043	0.035	0.030
	Triple or low-e glass	12	0.267	0.129	0.093	0.073	0.053	0.042	0.035	0.030

C303.2 Installation. Materials, systems and equipment shall be installed in accordance with the manufacturer's instructions and the *International Building Code* or *International Residential Code*, as applicable.

C303.2.1 Protection of exposed foundation insulation. Insulation applied to the exterior of basement walls, crawlspace walls and the perimeter of slab-on-grade floors shall have a rigid, opaque and weather-resistant protective covering to prevent the degradation of the insulation's thermal performance. The protective covering shall cover the exposed exterior insulation and extend not less than 6 inches (153 mm) below grade.

C303.2.2 Multiple layers of continuous insulation. Where two or more layers of continuous insulation board are used in a construction assembly, the continuous insulation boards shall be installed in accordance with Section C303.2. Where the continuous insulation board manufacturer's instructions do not address installation of two or more layers, the edge joints between each layer of continuous insulation boards shall be staggered.

C303.3 Maintenance information. Maintenance instructions shall be furnished for equipment and systems that require preventive maintenance. Required regular maintenance actions shall be clearly stated and incorporated on a readily

~~accessible label. The label shall include the title or publication number for the operation and maintenance manual for that particular model and type of product.~~

TABLE C303.1.3(2)
DEFAULT OPAQUE DOOR U-FACTORS

See Appendix A, Section A107

TABLE C303.1.3(3)
DEFAULT GLAZED FENESTRATION
SHGC AND VT

	SINGLE GLAZED		DOUBLE GLAZED		GLAZED BLOCK
	Clear	Tinted	Clear	Tinted	
SHGC	0.40	0.40	0.40	0.40	0.40
VT	0.6	0.3	0.6	0.3	0.6

TABLE C303.1.3(4)
DEFAULT U-FACTORS FOR SKYLIGHTS

Fenestration Type	Frame Type			
	Aluminum Without Thermal Break	Aluminum With Thermal Break	Reinforced Vinyl/ Aluminum-Clad Wood or Vinyl	Wood or Vinyl-Clad Wood/ Vinyl without Reinforcing
Single Glazing glass acrylic/polycarb	U-1.58 U-1.52	U-1.51 U-1.45	U-1.40 U-1.34	U-1.18 U-1.11
Double Glazing air argon	U-1.05 U-1.02	U-0.89 U-0.86	U-0.84 U-0.80	U-0.67 U-0.64
Double Glazing, $e=0.20$ air argon	U-0.96 U-0.91	U-0.80 U-0.75	U-0.75 U-0.70	U-0.59 U-0.54
Double Glazing, $e=0.10$ air argon	U-0.94 U-0.89	U-0.79 U-0.73	U-0.74 U-0.68	U-0.58 U-0.52
Double Glazing, $e=0.05$ air argon	U-0.93 U-0.87	U-0.78 U-0.71	U-0.73 U-0.66	U-0.56 U-0.50
Triple Glazing air argon	U-0.90 U-0.87	U-0.70 U-0.69	U-0.67 U-0.64	U-0.51 U-0.48
Triple Glazing, $e=0.20$ air argon	U-0.86 U-0.82	U-0.68 U-0.63	U-0.63 U-0.59	U-0.47 U-0.43
Triple Glazing, $e=0.20$ on 2 surfaces air argon	U-0.82 U-0.79	U-0.64 U-0.60	U-0.60 U-0.56	U-0.44 U-0.40
Triple Glazing, $e=0.10$ on 2 surfaces air argon	U-0.81 U-0.77	U-0.62 U-0.58	U-0.58 U-0.54	U-0.42 U-0.38
Quadruple Glazing, $e=0.10$ on 2 surfaces air argon krypton	U-0.78 U-0.74 U-0.70	U-0.59 U-0.56 U-0.52	U-0.55 U-0.52 U-0.48	U-0.39 U-0.36 U-0.32

Notes for Table C303.1.3(4)

1. U-factors are applicable to both glass and plastic, flat and domed units, all spacers and gaps.
2. Emissivities shall be less than or equal to the value specified.
3. Gap fill shall be assumed to be air unless there is a minimum of 90% argon or krypton.
4. Aluminum frame with thermal break is as defined in footnote 1 to Table C303.1.3(1).

TABLE C303.1.3(5)
SMALL BUSINESS COMPLIANCE TABLE
DEFAULT U-FACTORS FOR VERTICAL FENESTRATION

Vertical Fenestration Description				Frame Type		
				Any Frame	Aluminum Thermal Break ²	Wood/Vinyl/Fiberglass
Panes	Low-e ¹	Spacer	Fill			
Double ³	A	Any	Argon	0.48	0.41	0.32
	B	Any	Argon	0.46	0.39	0.30
	C	Any	Argon	0.44	0.37	0.28
	C	High Performance	Argon	0.42	0.35	Deemed to comply ⁵
Triple ⁴	A	Any	Air	0.50	0.44	0.26
	B	Any	Air	0.45	0.39	0.22
	C	Any	Air	0.41	0.34	0.20
	Any double low-e	Any	Air	0.35	0.32	0.18

¹ Low-eA (emissivity) shall be 0.24 to 0.16.
Low-eB (emissivity) shall be 0.15 to 0.08.
Low-eC (emissivity) shall be 0.07 or less.

² Aluminum Thermal Break = An aluminum thermal break framed window shall incorporate the following minimum design characteristics:

- a) The thermal conductivity of the thermal break material shall be not more than 3.6 Btu-in/h/ft²/°F;
- b) The thermal break material must produce a gap in the frame material of not less than 0.210 inches; and
- c) All metal framing members of the products exposed to interior and exterior air shall incorporate a thermal break meeting the criteria in a) and b) above.

³ A minimum air space of 0.375 inches between panes of glass is required for double glazing.

⁴ A minimum air space of 0.25 inches between panes of glass is required for triple glazing.

⁵ Deemed to comply glazing shall not be used for performance compliance.

CHAPTER 4 [CE]

COMMERCIAL ENERGY EFFICIENCY

SECTION C401 GENERAL

C401.1 Scope. The provisions in this chapter are applicable to commercial buildings and their building sites.

C401.2 Application. Commercial buildings shall comply with one of the following:

1. The requirements of Sections C402, C403, C404, C405, C406, C408, C409 and C410.
2. The requirements of Section C407, ~~C408, C409, C410, C402.5, C403.2, C404, C405.2, C405.3, C405.4, C405.6 and C405.7. The building energy consumption shall be equal to or less than 87, 90 or 93 percent of the standard reference design building, depending on the option selected per Section C407.3.~~
- 2.3. When adopted by the local jurisdiction, the requirements of Appendix F, Outcome-Based Energy Budget, Sections C408, C409 and any specific section in Table C407.2 as determined by the local jurisdiction. The Proposed total UA of the proposed building shall be no more than 20 percent higher than the Allowed total UA as defined in Section C402.1.5.

Commented [BK(43)]:
P141-2018

Commented [BK(44)]:
171-2018

C401.2.1 Application to existing buildings. Work on existing buildings shall comply with Chapter 5 in addition to the applicable provisions of Chapter 4.

SECTION C402 BUILDING ENVELOPE REQUIREMENTS

C402.1 General (Prescriptive). Building thermal envelope assemblies for buildings that are intended to comply with the code on a prescriptive basis, in accordance with the compliance path described in Item 1 of Section C401.2, shall comply with the following:

1. The opaque portions of the building thermal envelope shall comply with the specific insulation requirements of Section C402.2 and the thermal requirements of either the R-value based method of Section C402.1.3, the U-, C- and F-factor based method of Section C402.1.4, or the component performance alternative of Section C402.1.5.
2. Fenestration in the building envelope assemblies shall comply with Section C402.4, or the component performance alternative of Section C402.1.5.
3. Air leakage of building envelope assemblies shall comply with Section C402.5.

C402.1.1 Low energy buildings, semi-heated buildings and greenhouses. Low energy buildings shall comply with Section C402.1.1.1. Semi-heated buildings and spaces shall comply with Section C402.1.1.2.

Commented [BK(45)]:
nv013-2018

C402.1.1.1 Low energy buildings. The following buildings, or portions thereof, separated from the remainder of the building by *building thermal envelope* assemblies complying with this code shall be exempt from all thermal envelope provisions of this code:

1. Those that are heated and/or cooled with a peak design rate of energy usage less than 3.4 Btu/h × ft² (10.7 W/m²) or 1.0 watt/ft² (10.7 W/m²) of floor area for space conditioning purposes.
2. Those that do not contain conditioned space.
3. ~~Greenhouses where cooling does not include a condensing unit and that are isolated from any other conditioned space.~~
- 4.3. Unstaffed equipment shelters or cabinets used solely for personal wireless service facilities.

Commented [BK(46)]:
nv013-2018

~~C402.1.1.1~~ **C402.1.1.2 Semi-heated buildings and spaces.** The building envelope of *semi-heated* buildings, or portions thereof, shall comply with the same requirements as that for conditioned spaces in Section C402, except as modified by this section. The total installed output capacity of mechanical space conditioning systems serving a semi-heated building or space shall comply with Section C202. Building envelope assemblies separating conditioned space from semi-heated space shall comply with the exterior envelope insulation requirements. Semi-heated spaces heated by mechanical systems that do not include electric resistance heating equipment are not required to comply with the opaque wall insulation provisions of Section C402.2.3 for walls that separate semi-heated spaces from the exterior or

Commented [BK(47)]:
nv014-2018

low energy spaces. Semi-heated spaces shall be calculated separately from other conditioned spaces for compliance purposes. Opaque walls in semi-heated spaces shall be calculated as fully code compliant opaque walls for both the target and proposed for the Target UA calculations for the component performance alternative in Section C402.1.5, and for the Standard Reference Design for Total Building Performance compliance per Section C407. The capacity of heat trace temperature maintenance systems complying with Section C404.7.2 that are provided for freeze protection of piping and equipment only, shall not be included in the total installed output capacity of mechanical space conditioning systems.

Exception: Building or space may comply as *semi-heated* when served by one or more of the following system alternatives:

1. Electric infrared heating equipment for localized heating applications.
2. Heat pumps with cooling capacity permanently disabled, as pre-approved by the jurisdiction.

C402.1.1.3 Greenhouses. Greenhouse structures or areas that comply with all of the following shall be exempt from the building envelope requirements of this code:

1. Exterior opaque envelope assemblies comply with Sections C402.2 and C402.4.4.
2. Interior partition *building thermal envelope* assemblies that separate the *greenhouse* from conditioned space comply with Sections C402.2, C402.4.3 and C402.4.4.
3. Non-opaque envelope assemblies comply with the thermal envelope requirements in Table C402.1.1.3. The U-factor for the non-opaque roof shall be for the roof assembly or a roof that includes the assembly and an internal curtain system.

Exception: Unheated greenhouses.

4. No mechanical cooling is provided.
- 4.5. For heated greenhouses, heating is provided by a radiant heating system, a condensing natural gas-fired or condensing propane-fired heating system, or a heat pump with cooling capacity permanently disabled as pre-approved by the jurisdiction.

C402.1.2 Equipment buildings. Buildings that comply with all of the following shall be exempt from the building thermal envelope provisions of this code:

1. Are separate buildings with floor area no more than 500 square feet (50 m²).
2. Are intended to house electronic equipment with installed equipment power totaling at least 7 watts per square foot (75 W/m²) and not intended for human occupancy.
- 2.3. Served by mechanical cooling and heating systems sized per Sections C403.1.2 and C403.3.1.
- 3.4. Have a heating system capacity not greater than 17,000 Btu/hr (5 kW) and a heating thermostat set point that is restricted to not more than 50°F (10°C).
5. Have an average wall and roof U-factor less than 0.200.

Exception: Where the cooling and heating system is a heat pump, the heating system capacity is allowed to exceed 17,000 Btu/h provided the heat pump cooling efficiency is at least 15 percent better than the requirements in Table C403.3.2(2).

C402.1.2.1 Standalone elevator hoistways. Elevator hoistways that comply with all of the following shall be exempt from the building thermal envelope and envelope air barrier provisions of this code:

1. Are separate from any other conditioned spaces in the building (do serve or open into any conditioned, semi-heated or indirectly conditioned space).
2. Have heating and/or cooling equipment sized only to serve the expected elevator loads with thermostat setpoints restricted to heating to no higher than 40° F and cooling to no lower than 95° F.
- a-3. Have an area-weighted average wall, roof, and floor (where applicable) U-factor of less than or equal to 0.20. Calculations must include any floor-slab-edges that penetrate the hoistway and thus are considered part of the above-grade walls.

C402.1.3 Insulation component R-value method. *Building thermal envelope* opaque assemblies shall ~~meet-comply with~~ the requirements of Section C402.2 based on the climate zone specified in Chapter 3. For opaque portions of the building thermal envelope intended to comply on an insulation component R-value basis, the R-values for insulation ~~in framing-areas, where required, and for continuous insulation, where required,~~ shall not be less than that specified in Table C402.1.3. Commercial buildings or portions of commercial buildings enclosing Group R occupancies shall use the R-values from the "Group R" column of Table C402.1.3. Commercial buildings or portions of commercial buildings enclosing occupancies other than Group R shall use the R-values from the "All other" column of Table C402.1.3. ~~The thermal resistance or R-value of the insulating material installed in, or continuously on, below grade exterior walls of the~~

Commented [BK(48):
nv014-2018

Commented [BK(49):
nv013-2018

Commented [BK(50):
nv015-2018

Commented [BK(51):
nv015-2018

Commented [BK(52):
nv023-2018

~~building envelope required in accordance with Table C402.1.3 shall extend to the lowest floor of the conditioned space enclosed by the below-grade wall. Doors having less than 50 percent opaque glass area shall be considered opaque doors. Opaque swinging doors shall comply with the Table C402.1.4 and opaque nonswinging doors shall comply with Table C402.1.3 or C402.1.4.~~

C402.1.4 Assembly U-factor, C-factor or F-factor based method. *Building thermal envelope* ~~opaque~~ assemblies shall meet the requirements of Section C402.2 based on the climate zone specified in Chapter 3. Building thermal envelope opaque assemblies intended to comply on an assembly U-, C-, or F-factor basis shall have a U-, C-, or F-factor not greater than that specified in Table C402.1.4. Commercial buildings or portions of commercial buildings enclosing Group R occupancies shall use the U-, C-, or F-factor from the “Group R” column of Table C402.1.4. Commercial buildings or portions of commercial buildings enclosing occupancies other than Group R shall use the U-, C-, or F-factor from the “All Other” column of Table C402.1.4. ~~The C factor for the below-grade exterior walls of the building envelope, as required in accordance with Table C402.1.4, shall extend to the level of the lowest conditioned floor. Opaque swinging doors shall comply with Table C402.1.4 and opaque nonswinging doors shall comply with Table C402.1.3 or C402.1.4.~~ The U-factors for typical construction assemblies are included in Appendix A. These values shall be used for all calculations. Where proposed construction assemblies are not represented in Appendix A, values shall be calculated in accordance with the ASHRAE *Handbook of Fundamentals* using the framing factors listed in Appendix A where applicable and shall include the thermal bridging effects of framing materials.

C402.1.4.1 Thermal resistance of cold-formed steel stud walls. U-factors of walls with cold-formed steel studs shall be permitted to be determined in accordance with Equation 4-1:

$$U = 1/[R_s + (ER)] \quad \text{(Equation 4-1)}$$

where:

R_s = The cumulative R-value of the wall components along the path of heat transfer, excluding the cavity insulation and steel studs.

ER = The effective R-value of the cavity insulation with steel studs.

TABLE C402.1.3
OPAQUE THERMAL ENVELOPE INSULATION COMPONENT
MINIMUM REQUIREMENTS, R-VALUE METHOD^{a, gh}

CLIMATE ZONE	5 AND MARINE 4	
	All Other	Group R
Roofs		
Insulation entirely above deck	R-38ci	R-38ci
Metal buildings ^b	R-25 + R-11 LS	R-25 + R-11 LS
Attic and other	R-49	R-49
Walls, Above Grade		
Mass ^d	R-9.5 ^c ci	R-13.3ci
Mass transfer deck slab edge	R-5	R-5
Metal building	R-19ci or R-13 13ci	R-19ci or R-13 13ci
Steel framed	R-13 + R-10ci	R-19 + R-8.5ci
Wood framed and other	R-21 int or R-15+5ci std	R-21 int R-13+7.5ci std or R-20+3.8ci std or R-25 std
Walls, Below Grade		
Below-grade wall ^d	Same as above grade	Same as above grade
Floors		
Mass ^f	R-30ci	R-30ci
Joist/framing	R-30 ^e	R-30 ^e
Slab-on-Grade Floors		
Unheated slabs	R-10 for 24" below	R-10 for 24" below
Heated slabs ^d	R-10 perimeter & under entire slab	R-10 perimeter & under entire slab
Opaque Doors^g		
Nonswinging	R-4.75	R-4.75

For SI: 1 inch = 25.4 mm. ci = Continuous insulation. NR = No requirement. LS = Liner system

- Assembly descriptions can be found in Chapter 2 and Appendix A.
- Where using *R*-value compliance method, a thermal spacer block with minimum thickness of ½ inch and minimum *R*-value of *R*-3.5 shall be provided, otherwise use the *U*-factor compliance method in Table C402.1.4.
- Exception: ~~Integral insulated concrete block walls complying with ASTM C90 with all cores filled and meeting both of the following: Single wythe concrete block walls that comply with ASTM C90 and meet all of the following requirements:~~
 - ~~The single wythe concrete block wall must be exposed on both sides. There is no interior or exterior wall cladding or finishing.~~

Commented [BK(53)]:
nv024-2018

Commented [BK(54)]:
nv018-2018

Commented [BK(55)]:
nv016, 017-2018

Commented [BK(56)]:
nv024-2018

2. ~~All cores must be filled and at least 50 percent of cores must be filled with vermiculite or equivalent fill insulation; and insulation with a performance rating of R-2 per inch or better.~~
- 4.3. ~~The concrete block must have a nominal thickness of 8 inches or greater.~~
- 2.4. ~~The building thermal envelope encloses one or more of the following uses: Warehouse (storage and retail), gymnasium, auditorium, church chapel, arena, kennel, manufacturing plant, indoor swimming pool, pump station, water and waste water treatment facility, storage facility, storage area, motor vehicle service facility. Where additional uses not listed (such as office, retail, etc.) are contained within the building, the exterior walls that enclose these areas may not utilize this exception and must comply with the appropriate mass wall R-value from Table C402.1.3/U-factor from Table C402.1.4. This exception may not be utilized for mass walls enclosing space use areas within the building that are not included in Item 4 (such as office areas and locker rooms).~~

Commented [BK(57):
nv020-2018

- d. Where heated slabs are below grade, they shall comply with the insulation requirements for heated slabs.
- e. Steel floor joist systems shall be insulated to $R-38 + R-10ci$.
- f. "Mass floors" shall include floors weighing not less than:
1.35 pounds per square foot of floor surface area; or
2.25 pounds per square foot of floor surface area where the material weight is not more than 120 pounds per cubic foot.
- g. ~~Not applicable to garage doors. See Table C402.1.4.~~

g-h. For roof, wall or floor assemblies where the proposed assembly would not be continuous insulation, an alternate nominal R-value compliance option for assemblies with isolated metal penetrations of otherwise continuous insulation is:

Assemblies with continuous insulation (see definition)	Alternate option for assemblies with metal penetrations, greater than 0.04% but less than 0.08%	Alternate option for assemblies with metal penetrations, greater than or equal to 0.08% but less than 0.12%
R-9.5ci	R-11.9ci	R-13ci
R-11.4ci	R-14.3ci	R-15.7ci
R-13.3ci	R-16.6ci	R-18.3ci
R-15.2ci	R-19.0ci	R-21ci
R-30ci	R-38ci	R-42ci
R-38ci	R-48ci	R-53ci
R-13 + R-7.5ci	R-13 + R-9.4ci	R-13 + R-10.3ci
R-13 + R-10ci	R-13 + R-12.5ci	R-13 + R-13.8ci
R-13 + R-12.5ci	R-13 + R-15.6ci	R-13 + R-17.2ci
R-13 + R-13ci	R-13 + R-16.3ci	R-13 + R-17.9ci
R-19 + R-8.5ci	R-19 + R-10.6ci	R-19 + R-11.7ci
R-19 + R-14ci	R-19 + R-17.5ci	R-19 + R-19.2ci
R-19 + R-16ci	R-19 + R-20ci	R-19 + R-22ci
R-20 + R-3.8ci	R-20 + R-4.8ci	R-20 + R-5.3ci
R-21 + R-5ci	R-21 + R-6.3ci	R-21 + R-6.9ci

This alternate nominal R-value compliance option is allowed for projects complying with all of the following:

- The ratio of the cross-sectional area, as measured in the plane of the surface, of metal penetrations of otherwise continuous insulation to the opaque surface area of the assembly is greater than 0.0004 (0.04%), but less than 0.0012 (0.12%).
- The metal penetrations of otherwise continuous insulation are isolated or discontinuous (e.g., brick ties or other discontinuous metal attachments, offset brackets supporting shelf angles that allow insulation to go between the shelf angle and the primary portions of the wall structure). No continuous metal elements (e.g., metal studs, z-girts, z-channels, shelf angles) penetrate the otherwise continuous portion of the insulation.
- Building permit drawings shall contain details showing the locations and dimensions of all the metal penetrations (e.g., brick ties or other discontinuous metal attachments, offset brackets, etc.) of otherwise continuous insulation. In addition, calculations shall be provided showing the ratio of the cross-sectional area of metal penetrations of otherwise continuous insulation to the overall opaque wall area.

For other cases where the proposed assembly is not continuous insulation, see Section C402.1.4 for determination of U-factors for assemblies that include metal other than screws and nails.

h.i. Peripheral edges of intermediate concrete floors are included in the above grade mass wall category and therefore must be insulated as above grade mass walls unless they meet the definition of Mass Transfer Deck Slab Edge. The area of the peripheral edges of concrete floors shall be defined as the thickness of the slab multiplied by the perimeter length of the edge condition. See Table A103.3.7.2 for typical default u-factors for above grade slab edges and footnote c for typical conditions of above grade slab edges.

Commented [BK(58):
nv024-2018

TABLE C402.1.4
OPAQUE THERMAL ENVELOPE ASSEMBLY MAXIMUM REQUIREMENTS, U-FACTOR METHOD^{a, f}

	CLIMATE ZONE 5 AND MARINE 4	
	All Other	Group R
Roofs		
Insulation entirely above deck	U-0.027	U-0.027
Metal buildings	U-0.031	U-0.031
Attic and other	U-0.021	U-0.021
Joist or single rafter	U-0.027	U-0.027
Walls, Above Grade		
Mass ^d	U-0.104 ^d	U-0.078
Mass transfer deck slab edge	U-0.20	U-0.20
Metal building	U-0.052	U-0.052
Steel framed	U-0.055	U-0.055
Wood framed and other	U-0.054	<u>U-0.054 U-0.051</u>
Walls, Below Grade		
Below-grade wall ^{b, g}	Same as above grade	Same as above grade
Floors		
Mass ^e	U-0.031	U-0.031
Joist/framing	U-0.029	U-0.029
Slab-on-Grade Floors		
Unheated slabs	F-0.54	F-0.54
Heated slabs ^c	F-0.55	F-0.55
Opaque Doors		
Swinging door	U-0.37	U-0.37
Nonswinging door	U-0.34	U-0.34
Garage door <14% glazing	<u>U-0.31</u>	<u>U-0.31</u>

Commented [BK(59):
nv024-2018

Commented [BK(60):
nv017-2018

- a. Use of opaque assembly *U*-factors, *C*-factors, and *F*-factors from Appendix A is required unless otherwise allowed by Section C402.1.4.
- b. Where heated slabs are below grade, they shall comply with the *F*-factor requirements for heated slabs.
- c. Heated slab *F*-factors shall be determined specifically for heated slabs. Unheated slab factors shall not be used.

- d. Exception: ~~Integral insulated concrete block walls complying with ASTM C90 with all cores filled and meeting both of the following: Single wythe concrete block walls that comply with ASTM C90 and meet all of the following requirements:~~
1. ~~The single wythe concrete block wall must be exposed on both sides. There is no interior or exterior wall cladding or finishing~~
 2. ~~All cores must be filled and at least 50 percent of cores must be filled with vermiculite or equivalent fill insulation; and insulation with a performance rating of R-2 or better.~~
 - 1-3. ~~The concrete block must have a nominal thickness of 8 inches or greater.~~
 - 2-4. ~~The building thermal envelope encloses one or more of the following uses: Warehouse (storage and retail), gymnasium, auditorium, church chapel, arena, kennel, manufacturing plant, indoor swimming pool, pump station, water and waste water treatment facility, storage facility, storage area, motor vehicle service facility. Where additional uses not listed (such as office, retail, etc.) are contained within the building, the exterior walls that enclose these areas may not utilize this exception and must comply with the appropriate mass wall R-value from Table C402.1.3/U-factor from Table C402.1.4.~~
- ~~This exception may not be utilized for mass walls enclosing space use areas within the building that are not included in Item 4 (such as office areas and locker rooms). Walls using this exception shall be calculated as fully code compliant opaque walls for both the target and proposed for the Target UA calculations for the component performance alternative in Section C402.1.5.~~
- e. "Mass floors" shall include floors weighing not less than:
- 1.35 pounds per square foot of floor surface area; or
 - 2.25 pounds per square foot of floor surface area where the material weight is not more than 120 pounds per cubic foot.
- f. ~~Opaque assembly U-factors based on designs tested in accordance with ASTM C1363 shall be permitted. The R-value of continuous insulation shall be permitted to be added or subtracted from the original test design.~~
- f.g. ~~Peripheral edges of intermediate concrete floors are included in the above grade mass wall category and therefore must be insulated as above grade mass walls unless they meet the definition of Mass Transfer Deck Slab Edge. The area of the peripheral edges of concrete floors shall be defined as the thickness of the slab multiplied by the perimeter length of the edge condition. See Table A103.3.7.2 for typical default u-factors for above grade slab edges and footnote c for typical conditions of above grade slab edges.~~

Commented [BK(61):
nv020-2018

Commented [BK(62):
nv024-2018

TABLE C402.1.4.1
EFFECTIVE R-VALUES FOR STEEL STUD WALL ASSEMBLIES

NOMINAL STUD DEPTH (inches)	SPACING OF FRAMING (inches)	CAVITY R-VALUE (insulation)	CORRECTION FACTOR (F _c)	EFFECTIVE R-VALUE (ER) (Cavity R-Value × F _c)
3 1/2	16	13	0.46	5.98
		15	0.43	6.45
3 1/2	24	13	0.55	7.15
		15	0.52	7.80
6	16	19	0.37	7.03
		21	0.35	7.35
6	24	19	0.45	8.55
		21	0.43	9.03
8	16	25	0.31	7.75
	24	25	0.38	9.50

C402.1.5 Component performance alternative. Building envelope values and fenestration areas determined in accordance with Equation 4-2 shall be permitted in lieu of compliance with the *U*-factors and *F*-factors in Table C402.1.4 and C402.4 and the maximum allowable fenestration areas in Section C402.4.1.

~~For buildings with more than one space conditioning category, component performance compliance shall be demonstrated separately for each space conditioning category. Interior partition ceilings, walls, fenestration and floors that separate space conditioning areas shall be applied to the component performance calculations for the space conditioning category with the highest level of space conditioning.~~

$$A + B + C + D \text{ Proposed Total UA} \leq \text{Zero-Allowable Total UA} \quad (\text{Equation 4-2})$$

Where:

~~A = Sum of the (UA Dif) values for each distinct assembly type of the building thermal envelope, other than slabs on grade:~~

~~UA Dif = UA Proposed - UA Table~~

~~UA Proposed = Proposed U value × Area~~

~~UA Table = (U-factor from Table C402.1.4 or C402.4) × Area~~

~~B = Sum of the (FL Dif) values for each distinct slab on grade perimeter condition of the building thermal envelope:~~

~~FL Dif = FL Proposed - FL Table~~

~~FL Proposed = Proposed F value × Perimeter length~~

~~FL Table = (F factor specified in Table C402.1.4) × Perimeter length~~

Commented [BK(63):
nv037-2018

Commented [BK(64):
nv027-2018

The maximum allowed prescriptive vertical fenestration area, identified as “Vertical Fenestration Area allowed” in factor CA below, as a percent of the gross above-grade wall area ratio is either:

1. ~~30%~~
2. ~~40% if the building complies with Section C402.4.1.1; or~~
3. ~~40% if the U-values used in calculating A for vertical fenestration are taken from Section C402.4.1.3 rather than Table C402.4~~

Where the proposed vertical fenestration area is less than or equal to the maximum allowed prescriptive vertical fenestration area, the value of C (Excess Vertical Glazing Value) shall be zero. Otherwise:

~~$C = (CA \times UV) - (CA \times U_{Wall})$, but not less than zero~~

~~$CA = (\text{Proposed Vertical Fenestration Area}) - (\text{Vertical Fenestration Area allowed})$~~

~~$U_{Wall} = \text{Sum of the (UA Proposed) values for each opaque assembly of the exterior wall}$~~

~~$U_{AW} = \text{Sum of the (UA Proposed) values for each above-grade wall assembly}$~~

~~$U_{Wall} = U_{AW} / \text{sum of wall area (excludes vertical fenestration area)}$~~

~~$U_{AV} = \text{Sum of the (UA Proposed) values for each vertical fenestration assembly}$~~

~~$UV = U_{AV} / \text{total vertical fenestration area}$~~

Where the proposed skylight area is less than or equal to the skylight area allowed by Section C402.4.1, the value of D (Excess Skylight Value) shall be zero. Otherwise:

~~$D = (DA \times US) - (DA \times U_{Roof})$, but not less than zero~~

~~$DA = (\text{Proposed Skylight Area}) - (\text{Allowable Skylight Area from Section C402.4.1})$~~

~~$U_{AR} = \text{Sum of the (UA Proposed) values for each roof assembly}$~~

~~$U_{Roof} = U_{AR} / \text{sum of roof area (excludes skylight area)}$~~

~~$U_{AS} = \text{Sum of the (UA Proposed) values for each skylight assembly}$~~

~~$US = U_{AS} / \text{total skylight area}$~~

Proposed total UA \equiv UA-glaz-prop + UA sky-prop + UA-opaque-prop + FL-slab-prop

Allowable total UA \equiv UA-glaz-allow + UA-glaz-excess + UA sky-allow + UA-sky-excess + UA-opaque-allow + FL-slab-allow

UA-glaz-prop \equiv Sum of (proposed U-value \times proposed area) for each distinct vertical fenestration type, up to code maximum area

UA-sky-prop \equiv Sum of (proposed U-value \times proposed area) for each distinct skylight type, up to the code maximum area

UA-opaque-prop \equiv Sum of (proposed U-value \times proposed area) for each distinct opaque thermal envelope type

FL-slab-prop \equiv Sum of (proposed F-value \times proposed length) for each distinct slab on grade perimeter assembly

UA-glaz-allow \equiv Sum of (code maximum vertical fenestration U-value from Table C402.4, or Section C402.4.1.3 if applicable, \times proposed area) for each distinct vertical fenestration type, not to exceed the code maximum area¹

UA-glaz-excess \equiv U-value for the proposed wall type from Table C402.4² \times vertical fenestration area in excess of the code maximum area

UA-sky-allow \equiv Sum of (code maximum skylight U-value from Table C402.4 \times proposed area) for each distinct skylight type proposed, not to exceed the code maximum area

UA-sky-excess \equiv U-value for the proposed roof type from Table C402.4³ \times skylight area in excess of the code maximum area

UA-opaque-allow \equiv Code maximum opaque envelope U-value from Table C402.1.4 for each opaque door, wall, roof, and floor assembly \times proposed area

FL-slab-allow \equiv Code maximum F-value for each slab-on-grade perimeter assembly \times proposed length

Notes

1. Where multiple vertical fenestration types are proposed and the code maximum area is exceeded, the U-value shall be the average Table C402.1.4 U-value weighted by the proposed vertical fenestration area of each type.
2. Where multiple wall types are proposed the U-value shall be the average Table C402.1.4 U-value weighted by the proposed above grade wall area of each type.
3. Where multiple roof types are proposed the U-value shall be the average Table C402.1.4 U-value weighted by the proposed roof area of each type.

C402.1.5.1 Component U-factors. The *U*-factors for typical construction assemblies are included in Chapter 3 and Appendix A. These values shall be used for all calculations. Where proposed construction assemblies are not represented in Chapter 3 or Appendix A, values shall be calculated in accordance with the ASHRAE *Handbook of Fundamentals*, using the framing factors listed in Appendix A.

For envelope assemblies containing metal framing, the *U*-factor shall be determined by one of the following methods:

1. Results of laboratory measurements according to acceptable methods of test.
2. ASHRAE *Handbook of Fundamentals* where the metal framing is bonded on one or both sides to a metal skin or covering.
3. The zone method as provided in ASHRAE *Handbook of Fundamentals*.
4. Effective framing/cavity *R*-values as provided in Appendix A. When return air ceiling plenums are employed, the roof/ceiling assembly shall:
 - a. For thermal transmittance purposes, not include the ceiling proper nor the plenum space as part of the assembly; and
 - b. For gross area purposes, be based upon the interior face of the upper plenum surface.

5. Tables in ASHRAE 90.1 Normative Appendix A.

5-6. Calculation method for steel-framed walls per Section C402.1.4.1 and Table C402.1.4.1.

Commented [BK(65)]:
nv029-2018

C402.1.5.2 SHGC rate calculations. Solar heat gain coefficient shall comply with Table C402.4. The target SHGC_{A_t} and the proposed SHGC_{A_p} shall be calculated using Equations 4-3 and 4-4 and the corresponding areas and SHGCs from Table C402.4.

**EQUATION 4-3
TARGET SHGC_{A_t}**

Proposed Total SHGC_A ≤ Allowable Total SHGC_A

(Equation 4-3)

Commented [BK(66)]:
nv027-2018

$$SHGC_{A_t} = SHGC_{egt}(A_{egt}) + SHGC_{vgt}(A_{vgt} + A_{vgmt} + A_{vgmot} + A_{vgdt})$$

Where:

~~SHGC_{A_t} = The target combined specific heat gain of the target fenestration area.~~

~~SHGC_{egt} = The solar heat gain coefficient for skylight fenestration found in Table C402.4.~~

~~A_{egt} = The proposed skylight area.~~

~~SHGC_{vgt} = The solar heat gain coefficient for fenestration found in Table C402.4 which corresponds to the proposed total fenestration area as a percent of gross exterior wall area.~~

~~A_{vgt} = The proposed vertical fenestration area with nonmetal framing~~

~~A_{vgmt} = The proposed vertical fenestration area with fixed metal framing~~

~~A_{vgmot} = The proposed vertical fenestration area with operable metal framing~~

~~A_{vgdt} = The proposed entrance door area~~

~~NOTE: The vertical fenestration area does not include opaque doors and opaque spandrel panels.~~

Proposed total SHGC_A **≡** **SHGC_A-glaz-prop + SHGC_A-sky-prop**

Allowable total SHGC_A **≡** **SHGC_A-glaz-allow + SHGC_A-sky-allow**

SHGC_A-glaz-prop **≡** **Sum of (proposed SHGC × proposed area) for each distinct vertical fenestration type**

SHGC_A-sky-prop **≡** **Sum of (proposed SHGC × proposed area) for each distinct skylight type**

SHGC_A-glaz-allow **≡** **Sum of (code maximum vertical fenestration SHGC from Table C402.4, or Section C402.4.1.3 if applicable, × proposed area) for each distinct vertical fenestration type, not to exceed the code maximum area**

SHGC_A-sky-allow **≡** **Sum of (code maximum skylight SHGC from Table C402.4 × proposed area) for each distinct skylight type, not to exceed the code maximum area**

**EQUATION 4-4
PROPOSED SHGC_{A_p}**

$$SHGC_{A_p} = SHGC_{eg}A_{eg} + SHGC_{vg}A_{vg}$$

Where:

~~SHGCA_a = The combined proposed specific heat gain of the proposed fenestration area.~~

~~SHGC_{sg} = The solar heat gain coefficient of the skylights.~~

~~A_{sg} = The skylight area.~~

~~SHGC_{vg} = The solar heat gain coefficient of the vertical fenestration.~~

~~A_{vg} = The vertical fenestration area.~~

~~NOTE: The vertical fenestration area does not include opaque doors and opaque spandrel panels.~~

C402.2 Specific building thermal envelope insulation requirements (Prescriptive). Insulation in building thermal envelope opaque assemblies shall comply with Sections C402.2.1 through C402.2.6 and Table C402.1.3.

Where this section refers to installing insulation levels as specified in Section C402.1.3, assemblies complying with Section C402.1.5 are allowed to install alternate levels of insulation so long as the U-factor of the insulated assembly is less than or equal to the U-factor required by the respective path.

~~**C402.2.1 Multiple layers of continuous insulation.** Where two or more layers of continuous insulation board are used in a construction assembly, the continuous insulation boards shall be installed in accordance with Section C303.2. If the continuous insulation board manufacturer's installation instructions do not address installation of two or more layers, the edge joints between each layer of continuous insulation boards shall be staggered.~~

C402.2.1 Roof assembly. The minimum thermal resistance (*R*-value) of the insulating material installed either between the roof framing or continuously on the roof assembly shall be as specified in Table C402.1.3, based on construction materials used in the roof assembly. Continuous insulation board shall be installed in not less than 2 layers and the edge joints between each layer of insulation shall be staggered. Insulation installed on a suspended ceiling with removable ceiling tiles shall not be considered part of the minimum thermal resistance of the roof insulation. Skylight curbs shall be insulated to the level of roofs with insulation entirely above deck or R-5, whichever is less.

Exceptions:

1. Continuously insulated roof assemblies where the thickness of insulation varies 1 inch (25 mm) or less and where the area-weighted *U*-factor is equivalent to the same assembly with the *R*-value specified in Table C402.1.3.
2. Where tapered insulation is used with insulation entirely above deck, those roof assemblies shall show compliance on a *U*-factor basis per Section C402.1.4. The effective *U*-factor shall be determined through the use of Tables A102.2.6(1), A102.2.6(2) and A102.2.6(3).
- ~~3. Unit skylight curbs included as a component of skylight listed and labeled in accordance with NFRC 100 shall not be required to be insulated.~~
- ~~3-4. Two layers of insulation are not required where insulation tapers to the roof deck, such as at roof drains. At roof drains, the immediate 24" x 24" plan area around each roof drain has a minimum insulation requirement of R-13, but otherwise is permitted to be excluded from roof insulation area-weighted calculations.~~

~~Insulation installed on a suspended ceiling with removable ceiling tiles shall not be considered part of the minimum thermal resistance of the roof insulation.~~

C402.2.1.1 Skylight curbs. Skylight curbs shall be insulated to the level of roofs with insulation entirely above deck or R-5, whichever is less.

Exception: Unit skylight curbs included as a component of skylight listed and labeled in accordance with NFRC 100 shall not be required to be insulated.

C402.2.1.2 Rooftop HVAC Equipment curbs. Structural curbs installed to support rooftop HVAC equipment are allowed to interrupt the above roof insulation. The area under the HVAC equipment inside of the equipment curb shall be insulated to a minimum of R-13 in all locations where there are not roof openings for ductwork. The annular space between the roof opening and the ductwork shall be sealed to maintain the building air barrier. The plan-view area of the HVAC equipment curb shall be excluded from the prescriptive roof insulation requirements or the area-weighted component performance calculations.

C402.2.2 Reserved.

C402.2.3 Thermal resistance of Above-grade walls. The minimum thermal resistance (*R*-value) of materials installed in the wall cavity between the framing members and continuously on the walls shall be as specified in Table C402.1.3, based on framing type and construction materials used in the wall assembly. The *R*-value of integral insulation installed in concrete masonry units (CMU) shall not be used in determining compliance with Table C402.1.3 except as otherwise noted in the table. In determining compliance with Table C402.1.4, the use of the U-factor of concrete masonry units with integral insulation shall be permitted.

Commented [BK(67)]:
nv030-2018

Commented [BK(68)]:
nv031-2018

"Mass walls" where used as a component in the thermal envelope of a building shall include walls comply with one of the following:

1. Weighing not less than 35 psf (170 kg/m²) of wall surface area.
2. Weighing not less than 25 psf (120 kg/m²) of wall surface area where the material weight is not more than 120 pounds per cubic foot (pcf) (1,900 kg/m³).
3. ~~Having~~ Have a heat capacity exceeding 7 Btu/ft² × °F (144 kJ/m² × K).
4. ~~Having~~ Have a heat capacity exceeding 5 Btu/ft² × °F (103 kJ/m² × K) where the material weight is not more than 120 pcf (1900 kg/m³).

C402.2.4 Thermal resistance of Below-grade walls. ~~The R-value~~ The minimum thermal resistance (R-value) of the insulating material installed in, or continuously on, the below-grade walls shall be ~~as specified in accordance with Table C402.1.3. The C-factor or R-value required shall extend~~ The C factor for the below grade exterior walls of the building envelope, as required in accordance with Table C402.1.4, shall extend to ~~to the level of the lowest floor of the conditioned floorspace enclosed by the below-grade wall.~~

C402.2.5 Floors. The thermal properties (component *R*-values or assembly *U*- or *F*-factors) of floor assemblies over outdoor air or unconditioned space shall be as specified in Table C402.1.3 or C402.1.4 based on the construction materials used in the floor assembly. Floor framing cavity insulation or structural slab insulation shall be installed to maintain permanent contact with the underside of the subfloor decking or structural slabs.

"Mass floors" where used as a component of the thermal envelope of a building shall provide one of the following weights:

1. 35 pounds per square foot of floor surface area.
- ~~4-2.~~ 25 pounds per square foot of floor surface area where the material weight is not more than 120 pounds per cubic foot.

Exceptions:

1. The floor framing cavity insulation or structural slab insulation shall be permitted to be in contact with the top side of sheathing or continuous insulation installed on the bottom side of floor assemblies where combined with insulation that meets or exceeds the minimum *R*-value in Table C402.1.3 for "Metal framed" or "Wood framed and other" values for "Walls, Above Grade" and extends from the bottom of the top of all perimeter floor framing or floor assembly members.
2. Insulation applied to the underside of concrete floor slabs shall be permitted an air space of not more than 1 inch where it turns up and is in contact with the underside of the floor under walls associated with the *building thermal envelope*.

C402.2.6 Slabs-on-grade perimeter insulation. Where the slab-on-grade is in contact with the ground, the minimum thermal resistance (*R*-value) of the insulation around the perimeter of unheated or heated slab-on-grade floors designed in accordance with the *R*-value method of Section C402.1.3 shall be as specified in Table C402.1.3. The insulation shall be placed on the outside of the foundation or on the inside of the foundation wall. The insulation shall extend downward from the top of the slab for a minimum distance as shown in the table or to the top of the footing, whichever is less, or downward to at least the bottom of the slab and then horizontally to the interior or exterior for the total distance shown in the table. Insulation extending away from the building shall be protected by pavement or by a minimum of 10 inches (254 mm) of soil. Insulation complying with Table C402.1.3 shall be provided under the entire area of heated slabs-on-grade.

Exception: Where the slab-on-grade floor is greater than 24 inches (61 mm) below the finished exterior grade, perimeter insulation is not required.

C402.2.7 Reserved Airspaces. Where the thermal properties of airspaces are used to comply with this code in accordance with Section C401.2, such airspaces shall be enclosed in an unventilated cavity constructed to minimize airflow into and out of the enclosed airspace. Airflow shall be deemed minimized where the enclosed airspace is located on the interior side of the continuous air barrier and is bounded on all sides by building components.

Exception: The thermal resistance of airspaces located on the exterior side of the continuous air barrier and adjacent to and behind the exterior wall covering material shall be determined in accordance with ASTM C1363 modified with an airflow entering the bottom and exiting the top of the airspace at a minimum air movement rate of not less than 70 mm/sec.

C402.2.8 Insulation of radiant heating systems. Radiant heating system panels and their associated components that

are installed in interior or exterior assemblies shall be insulated ~~with a minimum of~~ to an R-value of not less than R-3.5 ~~(0.62 m²/K × W)~~ on all surfaces not facing the space being heated. Radiant heating system panels that are installed in the *building thermal envelope* shall be separated from the exterior of the building or unconditioned or exempt spaces by not less than the R-value of the insulation installed in the opaque assembly in which they are installed or the assembly shall comply with Section C402.1.4.

Exception: Heated slabs-on-grade insulated in accordance with Section C402.2.6.

C402.3 Reserved.

C402.4 Fenestration ~~(Prescriptive)~~. Fenestration shall comply with Sections C402.4 through C402.4.4 and Table C402.4. Daylight responsive controls shall comply with this section and Section C405.2.4.1.

**TABLE C402.4
BUILDING ENVELOPE FENESTRATION MAXIMUM U-FACTOR AND SHGC REQUIREMENTS**

CLIMATE ZONE	5 AND MARINE 4	
Vertical Fenestration <u>U-factor for Class AW windows rated in accordance with AAMA/CSA101/IS.2/A440, vertical curtain walls and site-built fenestration products^d</u>		
<u>Fixed^b U-factor</u>	<u>U-0.38</u>	
<u>Operable^c U-factor</u>	<u>U-0.40</u>	
U-factor <u>Entrance doors^d</u>		
Nonmetal framing (all)^a U-factor	0.30 <u>U-0.60</u>	
Metal framing (fixed)^b	0.38	
<u>U-factor for all other vertical fenestration</u>		
<u>U-factor</u>	<u>U-0.30</u>	
Metal framing (operable)^c	0.40	
Metal framing (entrance doors)^d	0.60	
SHGC <u>for all vertical fenestration</u>		
Orientation ^{a,d}	SEW	N
PF < 0.2	0.40 <u>0.38</u>	0.53 <u>0.51</u>
0.2 ≤ PF < 0.5	0.48 <u>0.46</u>	0.58 <u>0.56</u>
PF ≥ 0.5	0.64 <u>0.61</u>	0.64 <u>0.61</u>
Skylights		
U-factor	<u>U-0.50</u>	
SHGC	0.35	

NR = No requirement.

- ~~"Nonmetal framing" includes framing materials other than metal, with or without metal reinforcing or cladding.~~ U-factor and SHGC shall be rated in accordance with NFRC 100.
- ~~"Metal framing" includes metal framing, with or without thermal break.~~ "Fixed" includes curtain wall, storefront, picture windows, and other fixed windows.

Commented [BK(69):
nv035-2018

Commented [BK(70):
nv035-2018

Commented [BK(71):
nv035-2018

Commented [BK(72):
nv035-2018

Commented [BK(73):
nv033-2018

- c. ~~"Metal framing" includes metal framing, with or without thermal break.~~ "Operable" includes openable fenestration products other than "entrance doors."
- d. ~~"Metal framing" includes metal framing, with or without thermal break.~~ "Entrance door" includes glazed swinging entrance doors. Other doors which are not entrance doors, including sliding glass doors, are considered "operable."
- e. ~~"N" indicates vertical fenestration oriented within 30 degrees of true north. "SEW" indicates orientations other than "N."~~
- d.f. Fenestration that is entirely within the conditioned space or is between conditioned and other enclosed space is exempt from solar heat gain coefficient requirements and not included in the SHGC calculation.

Commented [BK(74):
nv035-2018

Commented [BK(75):
nv033-2018

Commented [BK(76):
nv037-2018

C402.4.1 Maximum area. The total building vertical fenestration area (not including opaque doors and opaque spandrel panels) shall not exceed 30 percent of the total building gross above-grade wall area. The skylight area shall not exceed 5 percent of the total building gross roof area (skylight-to-roof ratio).

For buildings with more than one space conditioning category, compliance with the maximum allowed window-to-wall ratio and skylight-to-roof ratio shall be demonstrated separately for each space conditioning category. Interior partition ceiling, wall, fenestration and floor areas that separate space conditioning areas shall not be applied to the window-to-wall ratio and skylight-to-roof ratio calculations.

Commented [BK(77):
nv037-2018

C402.4.1.1 Increased Vertical fenestration maximum area with daylight responsive control high performance alternates. For buildings that comply with C402.4.1.1.1, C402.4.1.1.3 or C402.4.1.1.4, the total building vertical fenestration area is permitted to exceed 30 percent but shall not exceed 40 percent of the gross above grade wall area for the purpose of prescriptive compliance with Section C402.1.4.

For the component performance alternative per Section C402.1.5, the total building vertical fenestration area allowed in Equation 4-2 is 40 percent of the above grade wall area for buildings that comply with the vertical fenestration alternates described in this section. These alternates are not permitted to be used for Total Building Performance compliance in Section C407.

Commented [BK(78):
nv037-2018

C402.4.1.1.1 Optimized daylighting. A maximum of 40 percent of the gross above grade wall area shall be permitted to be vertical fenestration for the purpose of prescriptive compliance with Section C402.1.4 or for the component performance alternative in Section C402.1.5, provided All of the following requirements are shall be met:

1. ~~In buildings not greater than two stories above grade, No less than 50 percent of the total conditioned floor area in the building is within a daylight zone that includes daylight responsive controls complying with Section C405.2.4.1.~~
2. ~~In buildings three or more stories above grade, not less than 25 percent of the net floor area is within a daylight zone.~~
3. ~~Daylight responsive controls complying with Section C405.2.4.1 are installed in daylight zones.~~
- 4.2. Visible transmittance (VT) of all vertical fenestration in the building is greater than or equal to 1.1 times solar heat gain coefficient (SHGC) or 0.50, whichever is greater.

Commented [BK(79):
nv037-2018

Commented [BK(80):
nv039-2018

Commented [BK(81):
nv038-2018

Commented [BK(82):
nv039-2018

Commented [BK(83):
nv040-2018

Exception: Fenestration that is outside the scope of NFRC 200 is not required to comply with Item 4.

C402.4.1.1.2 Reserved.

C402.4.1.1.3 Increased vertical fenestration area with high-performance fenestration. ~~The vertical fenestration area (not including opaque doors and opaque spandrel panels) is permitted to exceed 30% but shall not exceed 40% of the gross above grade wall area, for the purpose of prescriptive compliance with Section C402.1.3 provided that each All of the following conditions are requirements shall be met:~~

Commented [BK(84):
nv037-2018

1. ~~The All vertical fenestration in the building shall have comply with~~ the following U-factors:
 - a. Non-metal framing (all) = 0.28
 - b. Metal framing (fixed) = 0.34
 - c. Metal framing (operable) = 0.36
 - d. Metal framing (entrance doors) = 0.60
2. The SHGC of the vertical fenestration shall be less than or equal to 0.35, adjusted for projection factor in compliance with C402.4.3.

An area-weighted average shall be permitted to satisfy the U-factor requirement for each fenestration product category listed in Item 1 of this section. Individual fenestration products from different fenestration product categories shall not be combined in calculating the area-weighted average U-factor.

~~The compliance path described in this section is not permitted to be used for the Total Building Performance compliance path in Section C407. The compliance path described in this section is permitted to be used for the component performance alternative in Section C402.1.5, provided that the requirements of Section C402.1.5 are met.~~

Commented [BK(85):
nv037-2018

C402.4.1.1.4 Increased vertical fenestration area with high-performance Optimized mechanical systems. The vertical fenestration area (not including opaque doors and opaque spandrel panels) is permitted to exceed 30 percent but shall not exceed 40 percent of the gross above grade wall area, for the purpose of prescriptive compliance with Section C402.1.4 or

~~for the component performance alternative in Section C402.1.5, provided that the mechanical system complies with all requirements of All occupied spaces in the building that require ventilation per the International Mechanical Code shall be served by a dedicated outdoor air systems (DOAS) in accordance with Section C403.6403.3.5, dedicated outdoor air systems (DOAS) without utilizing any of the exceptions to Section C403.6403.3.5. This increased glazing fraction is not permitted to be used to establish the reference case for the Total Building Performance compliance path in Section C407.~~

Commented [BK(86):
eletion, Env042-2018

Commented [BK(87):
nv037-2018

Commented [BK(88):
nv044-2018

C402.4.2 Minimum skylight fenestration area. ~~For single-story buildings only with single story, in an enclosed spaces greater than 2,500 square feet (232 m²) in floor area, that are directly under a roof and with not less than 75 percent of the ceiling area with have a ceiling heights greater than 15 feet (4572 mm) for no less than 75 percent of the ceiling area; these single-story spaces shall be provided with skylights and daylight responsive controls per Section C405.2.4. Space types required to comply with this provision include, and used as an~~ office, lobby, atrium, concourse, corridor, gymnasium/exercise center, convention center, automotive service, manufacturing, nonrefrigerated warehouse, retail store, distribution/sorting area, transportation, ~~or and~~ workshop. ~~Skylights in these spaces are required to provide a total toplight-toplit daylight zone area not less than half- 50 percent of the floor area and shall provide one of the following:~~

1. A minimum ratio of skylight area to ~~topligh-toplit daylight~~ zone area ~~under skylights~~ of not less than 3 percent where all skylights have a VT of at least 0.40 as determined in accordance with Section C303.1.3
2. A minimum skylight effective aperture of at least 1 percent determined in accordance with Equation 4-5.

$$\text{Skylight Effective Aperture} = \frac{(0.85 \times \text{Skylight Area} \times \text{Skylight VT} \times \text{WF})}{\text{Toplit Daylight zone under skylight}}$$

(Equation 4-5)

where:

Skylight area	=	Total fenestration area of skylights.
Skylight VT	=	Area weighted average visible transmittance of skylights.
WF	=	Area weighted average well factor, where well factor is 0.9 if light well depth is less than 2 feet (610 mm), or 0.7 if light well depth is 2 feet (610 mm) or greater, <u>or 1.0 for tubular daylighting devices with VT-annual ratings measured according to NFRC 203.</u>
Light well depth	=	Measure vertically from the underside of the lowest point of the skylight glazing to the ceiling plane under the skylight.

Commented [BK(89):
Nv043-2018

Exceptions:

1. Skylights above daylight zones of enclosed spaces are not required in:
 - ~~a-1.1.~~ Reserved.
 - ~~b-1.2.~~ Spaces where the designed *general lighting* power densities are less than 0.5 W/ft² (5.4 W/m²) and at least 10 percent lower than the lighting power allowance in Section C405.4.2.
 - ~~c-1.3.~~ Areas where it is documented that existing structures or natural objects block direct beam sunlight on at least half of the roof over the enclosed area for more than 1,500 daytime hours per year between 8 a.m. and 4 p.m.
 - ~~d-1.4.~~ Spaces where the daylight zone under rooftop monitors is greater than 50 percent of the enclosed space floor area.
 - 1.5. Spaces where the total floor area minus the ~~sideligh~~ ~~sidelit~~ daylight zone area is less than 2,500 square feet (232 m²), and where the lighting in the daylight zone is controlled in accordance with Section C405.2.3.1.
2. The skylight effective aperture, calculated in accordance with Equation 4-5, is permitted to be 0.66 percent, in lieu of one percent, if the VT-annual of the skylight or TDD (tubular daylight device), as measured by NFRC 203 is greater than 38 percent.

Commented [BK(90):
nv044-2018

Commented [BK(91):
nv043-2018

C402.4.2.1 Lighting controls in daylight zones under skylights. *Daylight responsive controls* complying with Section C405.2.4.1 shall be provided to control all electric lights within toplit daylight zones.

C402.4.2.2 Haze factor. Skylights in office, storage, automotive service, manufacturing, nonrefrigerated warehouse, retail store, and distribution/sorting area spaces shall have a glazing material or diffuser with a haze factor greater than 90 percent when tested in accordance with ASTM D 1003.

Exception: Skylights designed and installed to exclude direct sunlight entering the occupied space by the use of fixed or automated baffles, or the geometry of skylight and light well.

C402.4.2.3 Daylight zones. Daylight zones referenced in Sections C402.4.1.1 through C402.4.2.2 shall comply with Section C405.2.4.2 and C405.2.4.3, as applicable. Daylight zones shall include toplit zones and sidelit zones.

C402.4.3 Maximum U-factor and SHGC. The maximum U-factor and solar heat gain coefficient (SHGC) for fenestration shall be as specified in Table C402.4.

The window projection factor shall be determined in accordance with Equation 4-6.

$$PF = A/B$$

(Equation 4-6)

Where:

PF = Projection factor (decimal).

A = Distance measured horizontally from the furthest continuous extremity of any overhang, eave, or permanently attached shading device to the vertical surface of the glazing.

B = Distance measured vertically from the bottom of the glazing to the underside of the overhang, eave, or permanently attached shading device.

Where different windows or glass doors have different *PF* values, they shall each be evaluated separately.

C402.4.3.1 Reserved

C402.4.3.2 Reserved.

C402.4.3.3 Dynamic glazing. Where *dynamic glazing* is intended to satisfy the SHGC and VT requirements of Table C402.4, the ratio of the higher to lower labeled SHGC shall be greater than or equal to 2.4, and the dynamic glazing shall be automatically controlled to modulate the amount of solar gain into the space in multiple steps. Dynamic glazing shall be considered separately from other fenestration, and area-weighted averaging with other fenestration that is not dynamic glazing shall not be permitted.

Exception: Dynamic glazing is not required to comply with this section where both the lower and higher labeled SHGC already comply with the requirements of Table C402.4.

C402.4.3.4 Area-weighted *U*-factor. An area-weighted average shall be permitted to satisfy the *U*-factor requirements for each fenestration product category listed in Table C402.4. Individual fenestration products from different fenestration product categories listed in Table C402.4 shall not be combined in calculating area-weighted average *U*-factor.

C402.4.4 Doors. Opaque swinging doors shall comply with ~~the applicable requirements for doors as specified in Tables C402.1.3-C402.1.4, and~~ Opaque non-swinging doors shall comply with Table C402.1.3~~C402.1.4. Opaque doors shall~~ and be considered part of the gross area of above grade walls that are part of the *building thermal envelope*. Other doors shall comply with the provisions of Section C402.4.3 for vertical fenestration and the entire door area, including the frame, shall be considered part of the fenestration area of the building thermal envelope.

C402.5 Air leakage – thermal envelope ~~(Mandatory)~~. The thermal envelope of buildings shall comply with Sections C402.5.1 through C402.5.8.

C402.5.1 Air barriers. A continuous air barrier shall be provided throughout the building thermal envelope. The air barriers shall be permitted to be located on the inside or outside of the building envelope, located within the assemblies composing the envelope, or any combination thereof. The air barrier shall comply with Sections C402.5.1.1 and C402.5.1.2.

C402.5.1.1 Air barrier construction. The *continuous air barrier* shall be constructed to comply with the following:

1. The air barrier shall be continuous for all assemblies that are the thermal envelope of the building and across the joints and assemblies.
2. Air barrier joints and seams shall be sealed, including sealing transitions in places and changes in materials. The joints and seals shall be securely installed in or on the joint for its entire length so as not to dislodge, loosen or otherwise impair its ability to resist positive and negative pressure from wind, stack effect and mechanical ventilation.
3. Penetrations of the air barrier shall be caulked, gasketed or otherwise sealed in a manner compatible with the construction materials and location. Sealing shall allow for expansion, contraction and mechanical vibration. Joints and ~~seals-seams~~ associated with penetrations shall be sealed in the same manner or taped ~~or covered with moisture vapor permeable wrapping material~~. Sealing materials ~~shall be appropriate to the construction materials being sealed and~~ shall be securely installed around the penetrations so as not to dislodge, loosen or otherwise impair the penetrations' ability to resist positive and negative pressure from wind, stack effect, and mechanical ventilation. Sealing of concealed fire sprinklers, where required, shall be in a manner that is recommended by the manufacturer. Caulking or other adhesive sealants shall not be used to fill voids between fire sprinkler cover plates and walls or ceilings.
4. Recessed lighting fixtures shall comply with Section C402.5.8. Where similar objects are installed which penetrate the air barrier, provisions shall be made to maintain the integrity of the air barrier.
5. Construction documents shall contain a diagram showing the building's pressure boundary in plan(s) and section(s) and a calculation of the area of the pressure boundary to be considered in the test.

C402.5.1.2 Building test. The completed building shall be tested and the air leakage rate of the *building envelope* shall not exceed ~~0.49~~ 0.25 cfm/ft² at a pressure differential of 0.3 inches water gauge (2.0 L/s × m² at 75 Pa) at the upper 95 percent confidence interval in accordance with ASTM E 779 or an equivalent method approved by the *code official*. A report that includes the tested surface area, floor area, air by volume, stories above grade, and leakage rates shall be submitted to the building owner and the *code official*. ~~If the tested rate exceeds that defined here, a visual inspection of the air barrier shall be conducted and any leaks noted shall be sealed to the extent practicable. An additional report identifying the corrective actions taken to seal air leaks shall be submitted to the building owner and the Code Official and any further requirement to meet the leakage air rate will be waived.~~

Commented [BK(92)]:
nv046-2018

Commented [BK(93)]:
nv045-2018

1. Test shall be accomplished using either (1) both pressurization and depressurization or (2) pressurization alone, but not depressurization alone. The test results shall be plotted against the correct P for pressurization in accordance with Section 9.4 of ASTM E779.
2. The test pressure range shall be from 25 Pa to 80 Pa per Section 8.10 of ASTM E779, but the upper limit shall not be less than 50 Pa, and the difference between the upper and lower limit shall not be less than 25 Pa.
3. If the pressure exponent *n* is less than 0.45 or greater than 0.85 per Section 9.6.4 of ASTM E779, the test shall be rerun with additional readings over a longer time interval.

C402.5.1.2.1 Building test for mixed-use buildings. Where a building is three or fewer stories above grade plane and contains both commercial and residential uses, the air barrier of the R-2 and R-3 occupancy areas of the building is permitted to be separately tested according to Section R402.4.1.2. Alternatively, it is permissible to test the air barrier of the entire building according to Section C402.5.1.2, provided that the tested air leakage rate does not exceed the rate specified in Section C402.5.1.2.

C402.5.2 Reserved.

C402.5.3 Rooms containing fuel-burning appliances. Where ~~open combustion air ducts provide combustion air to open combustion space conditioning is supplied through openings in an exterior wall to a room or space containing a space conditioning fuel-burning appliances, the appliances and combustion air openings shall be located outside of the building thermal envelope or enclosed in a room isolated from inside the thermal envelope. Such rooms shall be sealed and insulated in accordance with the envelope requirements of Table C402.1.3 or C402.1.4, where the walls, floors and ceilings shall meet the minimum of the below grade wall R-value requirement. The door into the room shall be fully gasketed, and any water lines and ducts in the room insulated in accordance with Section C403. The combustion air duct shall be insulated, where it passes through conditioned space, to a minimum of R-8.~~ one of the following shall apply:

1. The room or space containing the appliance shall be located outside of the building thermal envelope.
2. The room or space containing the appliance shall be enclosed and isolated from conditioned spaces inside the building thermal envelope. Such rooms shall comply with all of the following:
 - 2.1. The walls, floor and ceiling that separate the enclosed room or space from the conditioned spaces shall be insulated to be at least equivalent to the insulation requirement of below grade walls as specified in Table C402.1.3 or C402.1.4.
 - 2.2. The walls, floors and ceiling that separate the enclosed room or space from conditioned spaces shall be sealed in accordance with Section C402.5.1.1.
 - 2.3. The doors into the enclosed room or space shall be fully gasketed.
 - 2.4. Water lines and ducts in the enclosed room or space shall be insulated in accordance with Section C403.
 - ~~a-2.5. Where the air duct supplying combustion air to the enclosed room or space passes through conditioned space, the duct shall be insulated to an R-value of not less than R-8.~~

Exceptions:

- ~~1. Direct vent appliances with both intake and exhaust pipes installed continuous to the outside.~~

Fireplaces and stoves complying with Sections 901 through 905 of the International Mechanical Code, and Section 2111.13 of the International Building Code.

C402.5.4 Doors and access openings to shafts, chutes, stairways, and elevator lobbies. Doors and access openings from conditioned space to shafts, chutes, stairways and elevator lobbies shall be gasketed, weatherstripped or sealed.

Exceptions:

1. Door openings required to comply with Section ~~715 or 715.4~~ 716 of the *International Building Code*.
2. Doors and door openings required to comply with UL 1784 by the *International Building Code*.

C402.5.5 Air intakes, exhaust openings, stairways and shafts. Stairway enclosures, elevator shaft vents and other outdoor air intakes and exhaust openings integral to the building envelope shall be provided with dampers in accordance with Section C403.2.4.3.

C402.5.6 Loading dock weatherseals. Cargo doors ~~openings~~ and loading dock doors ~~openings~~ shall be equipped with weatherseals ~~to that~~ restrict infiltration ~~when and provide direct contact along the top and sides of~~ vehicles ~~that~~ are parked in the doorway.

C402.5.7 Vestibules. All building entrances shall be protected with an enclosed vestibule, with all doors opening into and out of the vestibule equipped with self-closing devices. Vestibules shall be designed so that in passing through the vestibule it is not necessary for the interior and exterior doors to open at the same time. The installation of one or more revolving doors in the building entrance shall not eliminate the requirement that a vestibule be provided on any doors adjacent to revolving doors. For the purposes of this section, "building entrances" shall include exit-only doors in buildings where separate doors for entering and exiting are provided.

Interior and exterior doors shall have a minimum distance between them of not less than 7 feet. The exterior envelope of conditioned vestibules shall comply with the requirements for a conditioned space. Either the interior or exterior envelope of unconditioned vestibules shall comply with the requirements for a conditioned space. The building lobby is not considered a vestibule.

Exception: Vestibules are not required for the following:

1. Doors not intended to be used as building entrances.
2. Unfinished ground-level space greater than 3,000 square feet (298 m²) if a note is included on the permit documents at each exterior entrance to the space stating "Vestibule required at time of tenant build-out if entrance serves a space greater than 3,000 square feet in area."
3. Doors opening directly from a *sleeping unit* or dwelling unit.
4. Doors between an enclosed space smaller than 3,000 square feet (298 m²) in area and the exterior of the building or the building entrance lobby, where those doors do not comprise one of the primary building entrance paths to the remainder of the building. The space must be enclosed and separated without transfer air paths from the primary building entrance paths. If there are doors between the space and the primary entrance path then the doors shall be equipped with self-closing devices so the space acts as a vestibule for the primary building entrance.
5. Revolving doors.
6. Doors used primarily to facilitate vehicular movement or material handling and adjacent personnel doors.
7. In buildings less than three stories above grade or in spaces that do not directly connect with the building elevator lobby, doors that have an air curtain with a velocity of not less than 6.56 feet per second (2 m/s) at the floor that have been tested in accordance with ANSI/AMCA 220 and installed in accordance with the manufacturer's instructions. Manual or automatic controls shall be provided that will operate the air curtain with the opening and closing of the door. Air curtains and their controls shall comply with Section C408.2.3
8. Building entrances in buildings that are less than four stories above grade and less than 10,000 square feet in area.
9. Elevator doors in parking garages provided that the elevators have an enclosed lobby at each level of the garage.
10. Entrances to semi-heated spaces.

Commented [BK(94):
nv048-2018

C402.5.8 Recessed lighting. Recessed luminaires installed in the *building thermal envelope* shall be all of the following:

1. IC Rated.
2. *Labeled* as having an air leakage rate of not more than 2.0 cfm (0.944 L/s) when tested in accordance with ASTM E 283 at a 1.57 psf (75 Pa) pressure differential.
3. Sealed with a gasket or caulk between the housing and interior wall or ceiling covering.

SECTION C403 MECHANICAL SYSTEMS

C403.1 General. Mechanical systems and equipment serving heating, cooling, ventilating, and other needs shall comply with ~~Section C403.2 and shall comply with Sections C403.3 and C403.4 based on the equipment and systems provided this section.~~

Exceptions:

1. Energy using equipment used by a manufacturing, industrial or commercial process other than for conditioning spaces or maintaining comfort and amenities for the occupants and not otherwise regulated by C403.2.3C403.3.2, Tables C403.2.3-C403.3.2(1) through (10) inclusive, C403.2.4.5C403.11.2, C403.2.4.6C403.11.3, C403.2.7C403.2.4.7, C403.2.9C403.4.X, C403.5.4C403.9.5, C404.2, Table C404.2, C405.8, and C410. Data-centerComputer room HVAC equipment is not covered by this exception.

Commented [BK(95):
M051-2018

- 4-2. Essential portions of data center systems meeting Section C403.1.3 are exempt from Sections C403.3, C403.4 and C403.5.

Commented [BK(96):
M051-2018

C403.2.10 Mechanical systems commissioning and completion requirements. Mechanical systems shall be commissioned and completed in accordance with Section C408.

~~C403.2.1~~**C403.1.1 HVAC total system performance ratio (HVAC TSPR).** For systems serving office, retail, library and education occupancies subject to the requirements of Section C403.3.5 without exceptions, the *HVAC total system performance ratio* (HVAC TSPR) of the *proposed design* HVAC system shall be more than or equal to the HVAC TSPR of the standard reference design as calculated according to Appendix D, Calculation of HVAC Total System Performance Ratio.

Commented [BK(97):
M050-2018

Exceptions:

1. Buildings with conditioned floor area less than 5,000 ft².
2. HVAC systems using district heating water, chilled water or steam
3. HVAC systems not included in Table D601.10.1.
4. HVAC systems with chilled water supplied by absorption chillers, heat recovery chillers, water to water heat pumps, air to water heat pumps, or a combination of air and water cooled chillers on the same chilled water loop.
5. HVAC system served by heating water plants that include air to water or water to water heat pumps.
6. Underfloor air distribution HVAC systems.
7. Space conditioning systems that do not include *mechanical cooling*.
8. Alterations to existing buildings that do not substantially replace the entire HVAC system.
9. HVAC systems meeting all the requirements of the standard reference design HVAC system in Table D602.11, Standard Reference Design HVAC Systems.

C403.1.2 Calculation of heating and cooling loads. Design loads associated with heating, ventilating and air conditioning of the building shall be determined in accordance with the procedures described in ANSI/ASHRAE/ACCA Standard 183 or by an *approved* equivalent computational procedure, using the design parameters specified in Chapter 3. Heating and cooling loads shall be adjusted to account for load reductions that are achieved where energy recovery systems are utilized in the HVAC system in accordance with the ASHRAE *HVAC Systems and Equipment Handbook* by an *approved* equivalent computational procedure.

C403.1.3 Data centers. *Data center systems in data centers* shall comply with Section 6 of ASHRAE Standard 90.4, including appendices a, b, c and d. Use the following *MLC* design values per climate zone, rather than those of Table 6.2.1.1 in ASHRAE 90.4:

Commented [BK(98):
M051-2018

Zone 4C Design MLC = 0.22

Zone 5B Design MLC = 0.24

(Design MLC is defined as the sum of all active cooling system power inputs at the design condition divided by the design power into the ITE being cooled, and is evaluated at 50 percent and 100 percent ITE load.)

Or, comply with Sections 6 and 8 of ASHRAE 90.4 using the following annualized MLC values rather than those of Table 6.2.1.2 in ASHRAE 90.4:

Zone 4C Annual MLC = 0.18

Zone 5B Annual MLC = 0.17

(Annual MLC is defined as the sum of all intended energy for cooling system operation over a typical year, minus any recovered ITE energy taken from heating, all divided by the total annual energy flowing into the ITE being cooled, and is evaluated at 50 percent and 100 percent ITE load.)

C403.2 Provisions applicable to all mechanical systems (Mandatory)System design. Mechanical systems ~~and equipment serving the building heating, cooling or ventilating needs shall be designed to~~ comply with Sections C403.2.1 through C403.2.13 and C403.2.2. Where elements of a building's mechanical systems are addressed in Sections C403.3 through C403.11, such elements shall comply with the applicable provisions of those sections.

~~C403.2.4~~**C403.2.1 Zone isolation required.** HVAC systems serving zones that ~~are over 25,000 square feet (2323 m²) in floor area or that span more than one floor and are designed-intended to operate or be occupied~~ nonsimultaneously shall be divided into isolation areas. Zones may be grouped into a single isolation area provided it does not exceed 25,000 square feet (2323 m²) of conditioned floor area nor include more than one floor. Each isolation area shall be equipped with isolation devices and controls configured to automatically shut off the supply of conditioned air and outdoor air to and exhaust air from the isolation area. Each isolation area shall be controlled independently by a device meeting the requirements of Section ~~C403.2.4.2~~**C403.4.2.2**. Central systems and plants shall be provided with controls and devices that will allow system and equipment operation for any length of time

Commented [BK(99):
M054-2018

while serving only the smallest isolation area served by the system or plant.

Exceptions:

1. Exhaust air and outdoor air connections to isolation areas where the fan system to which they connect is not greater than 5,000 cfm (2360 L/s).
2. Exhaust airflow from a single isolation area of less than 10 percent of the design airflow of the exhaust system to which it connects.
3. Isolation areas intended to operate continuously or intended to be inoperative only when all other isolation areas in a zone are inoperative.

~~C403.2.6~~C403.2.2 Ventilation and exhaust.

~~C403.2.2.1 Ventilation.~~ Ventilation, either natural or mechanical, shall be provided in accordance with Chapter 4 of the *International Mechanical Code*. Where mechanical ventilation is provided, the system shall be configured to provide no greater than 150 percent of the minimum outdoor air required by Chapter 4 of the *International Mechanical Code* or other applicable code or standard, whichever is greater.

Exceptions:

1. The mechanical system may supply outdoor air at rates higher than the limit above when it is used for particulate or VOC dilution, economizer, night flushing, dehumidification, pressurization, exhaust make-up, or other process air delivery. Outdoor air shall be reduced to the minimum ventilation rates when not required for the preceding uses.
2. Air systems supplying Group R-1, R-2 or I-2 occupancies.
3. Alterations that replace less than half of the total heating and cooling capacity of the system.
4. ~~Systems with energy recovery complying with the requirements of Section C403.5.1C403.7.6.1.~~
5. ~~Systems with energy recovery complying with the requirements of Section C403.7.6.1 that utilize sensible only active chilled beams for space cooling without any additional zonal fan power. Active chilled beams shall be permitted to utilize the increased outdoor airflow to increase space sensible capacity and to maintain space latent cooling loads without additional controls to reduce the outdoor airflow to each zone.~~

~~C403.2.2.2 Exhaust.~~ Exhaust shall be provided in accordance with Chapters 4 and 5 of the *International Mechanical Code*. Where exhaust is provided, the system shall be configured to provide no greater than 150 percent of the minimum exhaust air required by Chapters 4 and 5 of the *International Mechanical Code* or other applicable code or standard, whichever is greater.

~~Exceptions:~~

1. ~~The mechanical system may exhaust air at rates higher than the limit above when it is used for particulate or VOC dilution, economizer, night flushing, dehumidification, pressure equalization, relief, or other process exhaust air requirements. Outdoor air and exhaust air shall be reduced to the minimum exhaust rates when not required for the preceding uses.~~
2. ~~Domestic range hood exhaust in Group R occupancies.~~
3. ~~Exhaust for Group I occupancies.~~

~~C403.2.14 Electric motor efficiency.~~ Electric motors, including fractional hp motors, shall comply with the provisions of Section C405.8.

~~C403.2.3 Variable flow capacity.~~ For fan and pump motors 7.5 hp and greater including motors in or serving custom and packaged air handlers serving variable air volume fan systems, constant volume fans, heating and cooling hydronic pumping systems, pool and service water pumping systems, domestic water pressure-booster systems, cooling tower fan, and other pump or fan motors where variable flows are required, there shall be:

1. ~~Variable speed drives; or~~
2. ~~Other controls and devices that will result in fan and pump motor demand of no more than 30 percent of design wattage at 50 percent of design air volume for fans when static pressure set point equals 1/3 the total design static pressure, and 50 percent of design water flow for pumps, based on manufacturer's certified test data. Variable inlet vanes, throttling valves (dampers), scroll dampers or bypass circuits shall not be allowed.~~

~~Exception:~~ Variable speed devices are not required for motors that serve:

1. ~~Fans or pumps in packaged equipment where variable speed drives are not available as a factory option from the equipment manufacturer.~~
2. ~~Fans or pumps that are required to operate only for emergency fire-life-safety events (e.g., stairwell~~

Commented [BK(100)]
M058-2018

Commented [BK(101)]
M055-2018

Commented [BK(102)]
M057-2018

Commented [BK(103)]
M058-2018

Commented [BK(104)]
M100-2018

pressurization fans, elevator pressurization fans, fire pumps, etc.).

C403.3 Equipment selection. Heating and cooling equipment installed in mechanical systems shall be sized in accordance with Section C403.3.1 and shall be not less efficient in the use of energy than as specified in Section C403.3.2.

~~C403.2.2~~C403.3.1 Equipment and system sizing. The output capacity of heating and cooling equipment shall be not greater than that of the smallest available equipment size that exceeds the loads calculated in accordance with Section ~~C403.2.1~~C403.1.2. A single piece of equipment providing both heating and cooling shall satisfy this provision for one function with the capacity for the other function as small as possible, within available equipment options.

Exceptions:

1. Required standby equipment and systems provided with controls and devices that allow such systems or equipment to operate automatically only when the primary equipment is not operating.
2. Multiple units of the same equipment type with combined capacities exceeding the design load and provided with controls that are configured to sequence the operation of each unit based on load.

~~C403.2.3~~C403.3.2 HVAC equipment performance requirements. Equipment shall meet the minimum efficiency requirements of Tables ~~C403.2.3(1), C403.2.3(2), C403.2.3(3), C403.2.3(4), C403.2.3(5), C403.2.3(6), C403.2.3(7), C403.2.3(8) and C403.2.3(9)~~C403.3.2(1) through C403.3.2(9) when tested and rated in accordance with the applicable test procedure. Plate-type liquid-to-liquid heat exchangers shall meet the minimum requirements of Table ~~C403.2.3~~C403.3.2(10). The efficiency shall be verified through certification and listed under an *approved* certification program or, if no certification program exists, the equipment efficiency ratings shall be supported by data furnished by the manufacturer. Where multiple rating conditions or performance requirements are provided, the equipment shall satisfy all stated requirements. Where components, such as indoor or outdoor coils, from different manufacturers are used, calculations and supporting data shall be furnished by the designer that demonstrates that the combined efficiency of the specified components meets the requirements herein.

Gas-fired and oil-fired forced air furnaces with input ratings of 225,000 Btu/h (65 kW) or greater and all unit heaters shall also have an intermittent ignition or interrupted device (IID), and have either mechanical draft (including power venting) or a flue damper. A vent damper is an acceptable alternative to a flue damper for furnaces where combustion air is drawn from the conditioned space. All furnaces with input ratings of 225,000 Btu/h (65 kW) or greater, including electric furnaces, that are not located within the conditioned space shall have jacket losses not exceeding 0.75 percent of the input rating.

~~C403.3.2.1~~ [Title.] Chilled water plants and buildings with more than 500 tons total capacity shall not have more than 100 tons provided by air-cooled chillers.

Exceptions:

1. Where the designer demonstrates that the water quality at the building site fails to meet manufacturer's specifications for the use of water-cooled equipment.
2. Air-cooled chillers with minimum efficiencies at least 10 percent higher than those listed in Table ~~C403.2.3~~C403.3.2(7).
3. Replacement of existing air-cooled chiller equipment.
- ~~3-4.~~ Air-to-water heat pump units that are configured to provide both heating and cooling and that are rated in accordance with AHRI 550/590. Where the air-to-water heat pumps are designed for a maximum supply leaving water temperature of less than 140°F, the efficiency rating will be calculated and reported at the maximum unit leaving water temperature for this test condition.

Commented [BK(105)]:
M059-2018

Commented [BK(106)]:
M059-2018

Commented [BK(107)]:
M059-2018

TABLE ~~C403.2.3~~C403.3.2(1)A
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE ^a
Air conditioners, air cooled	< 65,000 Btu/h ^b	All	Split System	13.0 SEER	AHRI 210/240
			Single Package	14.0 SEER	
Through-the-wall (air cooled)	≤ 30,000 Btu/h ^b	All	Split system	12.0 SEER	
			Single Package	12.0 SEER	

Small duct high velocity, air cooled	$\leq 65,000$ Btu/h ^b	All	Split system	11.0 SEER	
Air conditioners, air cooled	$\geq 65,000$ Btu/h and $< 135,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	11.2 EER 12.9 IEER	AHRI 340/360
		All other	Split System and Single Package	11.0 EER 12.7 IEER	
	$\geq 135,000$ Btu/h and $< 240,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.4 IEER	
		All other	Split System and Single Package	10.8 EER 12.2 IEER	
	$\geq 240,000$ Btu/h and $< 760,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 11.6 IEER	
		All other	Split System and Single Package	9.8 EER 11.4 IEER	
	$\geq 760,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	9.7 EER 11.2 IEER	
		All other	Split System and Single Package	9.5 EER 11.0 IEER	
Air conditioners, water cooled	$< 65,000$ Btu/h ^b	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	$\geq 65,000$ Btu/h and $< 135,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 13.9 IEER	AHRI 340/360
		All other	Split System and Single Package	11.9 EER 13.7 IEER	
	$\geq 135,000$ Btu/h and $< 240,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	12.5 EER 13.9 IEER	
		All other	Split System and Single Package	12.3 EER 13.7 IEER	
	$\geq 240,000$ Btu/h and $< 760,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	12.4 EER 13.6 IEER	
		All other	Split System and Single Package	12.2 EER 13.4 IEER	
	$\geq 760,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	12.2 EER 13.5 IEER	
		All other	Split System and Single Package	12.0 EER 13.3 IEER	

(continued)

TABLE C403.2-3C403.3.2(1)A—continued
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE ^a
Air conditioners, evaporatively cooled	$< 65,000$ Btu/h ^b	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	$\geq 65,000$ Btu/h and $< 135,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 340/360
		All other	Split System and	11.9 EER	

	$\geq 135,000$ Btu/h and $< 240,000$ Btu/h		Single Package	12.1 IEER	
		Electric Resistance (or None)	Split System and Single Package	12.0 EER 12.2 IEER	
		All other	Split System and Single Package	11.8 EER 12.0 IEER	
	$\geq 240,000$ Btu/h and $< 760,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	11.9 EER 12.1 IEER	
		All other	Split System and Single Package	11.7 EER 11.9 IEER	
	$\geq 760,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	11.7 EER 11.9 EER	
		All other	Split System and Single Package	11.5 EER 11.7 EER	
Condensing units, air cooled	$\geq 135,000$ Btu/h			10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	$\geq 135,000$ Btu/h			13.5 EER 14.0 IEER	
Condensing units, evaporatively cooled	$\geq 135,000$ Btu/h			13.5 EER 14.0 IEER	

For SI: 1 British thermal unit per hour = 0.2931 W.

- Chapter ~~6-12~~ of the referenced standard contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
- Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.

TABLE ~~C403.2.3~~C403.3.2(1)B
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED VARIABLE REFRIGERANT FLOW AIR CONDITIONERS

Equipment Type	Size Category	Heating Section Type	Sub-Category or Rating Condition	Minimum Efficiency		Test Procedure
				Before 1/1/2017	After 1/1/2017	
VRF Air Conditioners, Air Cooled	$< 65,000$ Btu/h	All	VRF Multi-split System	13.0 SEER	13.0 SEER	AHRI 1230
	$\geq 65,000$ Btu/h and $< 135,000$ Btu/h	Electric Resistance (or none)	VRF Multi-split System	11.2 EER 13.1 IEER	11.2 EER 15.5 IEER	
	$\geq 135,000$ Btu/h and $< 240,000$ Btu/h	Electric Resistance (or none)	VRF Multi-split System	11.0 EER 12.9 IEER	11.0 EER 14.9 IEER	
	$\geq 240,000$ Btu/h	Electric Resistance (or none)	VRF Multi-split System	10.0 EER 11.6 IEER	10.0 EER 13.9 EER	

TABLE ~~C403.2.3~~C403.3.2(1)C
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED VARIABLE REFRIGERANT FLOW AIR-TO-AIR AND APPLIED HEAT PUMPS

Equipment Type	Size Category	Heating Section Type	Sub-Category or Rating Condition	Minimum Efficiency		Test Procedure
				Before 1/1/2017	After 1/1/2017	
VRF Air Cooled, (cooling mode)	<65,000 Btu/h	All	VRF Multi-split System	13.0 SEER	13.0 SEER	AHRI 1230
	≥65,000 Btu/h and <135,000 Btu/h	Electric Resistance (or none)	VRF Multi-split System	11.0 EER 12.9 IEER	11.0 EER 14.6 IEER	
	≥65,000 Btu/h and <135,000 Btu/h	Electric Resistance (or none)	VRF Multi-split System with Heat Recovery	10.8 EER 12.7 IEER	10.8 EER 14.4 IEER	
	≥135,000 Btu/h and <240,000 Btu/h	Electric Resistance (or none)	VRF Multi-split System	10.6 EER 12.3 IEER	10.6 EER 13.9 IEER	
	≥135,000 Btu/h and <240,000 Btu/h	Electric Resistance (or none)	VRF Multi-split System with Heat Recovery	10.4 EER 12.1 IEER	10.4 EER 13.7 IEER	
	≥240,000 Btu/h	Electric Resistance (or none)	VRF Multi-split System	9.5 EER 11.0 IEER	9.5 EER 12.7 IEER	
	≥240,000 Btu/h	Electric Resistance (or none)	VRF Multi-split System with Heat Recovery	9.3 EER 10.8 IEER	9.3 EER 12.5 IEER	

(continued)

VRF Water source (cooling mode)	<65,000 Btu/h	All	VRF Multi-split systems 86°F entering water	<u>16.0 IEER</u> 12.0 EER	AHRI 1230
	<65,000 Btu/h	All	VRF Multi-split systems with Heat Recovery 86°F entering water	<u>15.8 IEER</u> 11.8 EER	
	≥65,000 Btu/h and <135,000 Btu/h	All	VRF Multi-split System 86°F entering water	<u>16.0 IEER</u> 12.0 EER	
	≥65,000 Btu/h and <135,000 Btu/h	All	VRF Multi-split System with Heat Recovery 86°F entering water	<u>15.8 IEER</u> 11.8 EER	
	≥135,000 Btu/h <u>and <240,000 Btu/h</u>	All	VRF Multi-split System 86°F entering water	<u>14.0 IEER</u> 10.0 EER	
	≥135,000 Btu/h <u>and <240,000 Btu/h</u>	All	VRF Multi-split System with Heat Recovery 86°F entering water	<u>13.8 IEER</u> 9.8 EER	
	<u>≥240,000 Btu/h</u>	<u>All</u>	<u>VRF Multi-split System 86°F entering water</u>	<u>12.0 IEER</u>	
	<u>≥240,000 Btu/h</u>	<u>All</u>	<u>VRF Multi-split System with Heat Recovery 86°F entering water</u>	<u>11.8 IEER</u>	
VRF Groundwater source (cooling mode)	<135,000 Btu/h	All	VRF Multi-split System 59°F entering water	16.2 EER	AHRI 1230
	<135,000 Btu/h	All	VRF Multi-split System with Heat Recovery 59°F entering water	16.0 EER	
	≥135,000 Btu/h	All	VRF Multi-split System		

Equipment Type	Size Category	Heating Section Type	Sub-Category or Rating Condition	Minimum Efficiency		Test Procedure
				Before 1/1/2017	After 1/1/2017	
VRF Ground source (cooling mode)			59°F entering water	13.8 EER		AHRI 1230
	≥135,000 Btu/h	All	VRF Multi-split System with Heat Recovery 59°F entering water	13.6 EER		
	<135,000 Btu/h	All	VRF Multi-split System 77°F entering water	13.4 EER		
	<135,000 Btu/h	All	VRF Multi-split System with Heat Recovery 77°F entering water	13.2 EER		
	≥135,000 Btu/h	All	VRF Multi-split System 77°F entering water	11.0 EER		
	≥135,000 Btu/h	All	VRF Multi-split System with Heat Recovery 77°F entering water	10.8 EER		
VRF Air Cooled (heating mode)	<65,000 Btu/h (cooling capacity)	- - -	VRF Multi-split System	7.7 HSPF		AHRI 1230
	≥65,000 Btu/h and <135,000 Btu/h (cooling capacity)	- - -	VRF Multi-split system 47°F db/43°F wb outdoor air 17°F db/15°F wb outdoor air	3.3 COP 2.25 COP		
	≥135,000 Btu/h (cooling capacity)	- - -	VRF Multi-split System 47°F db/43°F wb outdoor air 17°F db/15°F wb outdoor air	3.2 COP 2.05 COP		
VRF Water source (heating mode)	<135,000 Btu/h (cooling capacity)	---	VRF Multi-split System 68°F entering water	4.2 4.3 COP		AHRI 1230
	≥135,000 Btu/h and <240,000 Btu/h (cooling capacity)	---	VRF Multi-split System 68°F entering water	3.9 4.0 COP		
	≥240,000 Btu/h (cooling capacity)	---	VRF Multi-split System 68°F entering water	3.9 COP		

(continued)

VRF Groundwater source (heating mode)	<135,000 Btu/h (cooling capacity)	---	VRF Multi-split System 50°F entering water	3.6 COP	AHRI 1230
	≥135,000 Btu/h (cooling capacity)	---	VRF Multi-split System 50°F entering water	3.3 COP	
VRF Ground source (heating mode)	<135,000 Btu/h (cooling capacity)	---	VRF Multi-split System 32°F entering water	3.1 COP	AHRI 1230
	≥135,000 Btu/h (cooling capacity)	---	VRF Multi-split System 32°F entering water	2.8 COP	

TABLE C403.2.3C403.3.2(2)
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE ^a
Air cooled	< 65,000 Btu/h ^b	All	Split System	14.0 SEER	AHRI

(cooling mode)			Single Packaged	14.0 SEER	210/240
Through-the-wall, air cooled (cooling mode)	$\leq 30,000$ Btu/h ^b	All	Split System	12.0 SEER	
			Single Packaged	12.0 SEER	
Small duct high velocity, air cooled	$< 65,000$ Btu/h ^b	All	Split System	11.0 SEER	AHRI 340/360
Air cooled (cooling mode)	$\geq 65,000$ Btu/h and $< 135,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.2 IEER	
		All other	Split System and Single Package	10.8 EER 12.0 IEER	
	$\geq 135,000$ Btu/h and $< 240,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 11.6 IEER	
		All other	Split System and Single Package	10.4 EER 11.4 IEER	
	$\geq 240,000$ Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 10.6 IEER	
		All other	Split System and Single Package	9.3 EER 10.4 IEER	
Water to air, source water loop (cooling mode)	$< 17,000$ Btu/h	All	86°F entering water	12.2 EER	ISO 13256-1
	$\geq 17,000$ Btu/h and $< 65,000$ Btu/h	All	86°F entering water	13.0 EER	
	$\geq 65,000$ Btu/h and $< 135,000$ Btu/h	All	86°F entering water	13.0 EER	
Water to air, ground-water source (cooling mode)	$< 135,000$ Btu/h	All	59°F entering water	18.0 EER	
Brine to air, ground loop Ground source (cooling mode)	$< 135,000$ Btu/h	All	77°F entering water	14.1 EER	ISO 13256-2
Water- source water to water, water loop (cooling mode)	$< 135,000$ Btu/h	All	86°F entering water	10.6 EER	
Water to water, ground water (cooling mode)	$< 135,000$ Btu/h	All	59°F entering water	16.3 EER	
Ground-water source- Brine to water, ground loop (cooling mode)	$< 135,000$ Btu/h	All	77°F entering fluid	12.1 EER	

(continued)

TABLE C403.2.3C403.3.2(2)—continued
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE ^a
Air cooled (heating mode)	$< 65,000$ Btu/h ^b	—	Split System	8.2 HSPF	AHRI 210/240
		—	Single Package	8.0 HSPF	
Through-the-wall, (air cooled, heating mode)	$\leq 30,000$ Btu/h ^b (cooling capacity)	—	Split System	7.4 HSPF	
		—	Single Package	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	$< 65,000$ Btu/h ^b	—	Split System	6.8 HSPF	AHRI 340/360
Air cooled (heating mode)	$\geq 65,000$ Btu/h and $< 135,000$ Btu/h (cooling capacity)	—	47°F db/43°F wb Outdoor Air	3.3 COP	
			17°F db/15°F wb Outdoor Air	2.25 COP	

	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb Outdoor Air	3.2 COP	
			17°F db/15°F wb Outdoor Air	2.05 COP	
Water source-to air, water loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	4.3 COP	ISO 13256-1
Water to air, ground-water source (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.7 COP	
Ground source-Brine to air, ground loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	3.2 COP	
Water- source- water to water, water loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	3.7 COP	ISO 13256-2
		—	50°F entering water	3.1 COP	
Ground source- Brine to water, ground loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	2.5 COP	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

- Chapter 6-12 of the referenced standard contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
- Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.

TABLE C403.2.3C403.3.2(3)
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED PACKAGED TERMINAL AIR CONDITIONERS,
PACKAGED TERMINAL HEAT PUMPS, SINGLE-PACKAGE VERTICAL AIR CONDITIONERS,
SINGLE-PACKAGE VERTICAL HEAT PUMPS, ROOM AIR CONDITIONERS AND ROOM AIR-CONDITIONER HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE ^a
PTAC (cooling mode) new construction	All Capacities	95°F db outdoor air	14.0 - (0.300 × Cap/1000) EER	AHRI 310/380
PTAC (cooling mode) replacements ^b	All Capacities	95°F db outdoor air	10.9 - (0.213 × Cap/1000) EER	
PTHP (cooling mode) new construction	All Capacities	95°F db outdoor air	14.0 - (0.300 × Cap/1000) EER	
PTHP (cooling mode) replacements ^b	All Capacities	95°F db outdoor air	10.8 - (0.213 × Cap/1000) EER	
PTHP (heating mode) new construction	All Capacities	—	3.7 - (0.052 × Cap/1000) COP	
PTHP (heating mode) replacements ^b	All Capacities	—	2.9 - (0.026 × Cap/1000) COP	
SPVAC (cooling mode)	< 65,000 Btu/h	95°F db/ 75°F wb outdoor air	10.0 11.0 EER	AHRI 390
	≥65,000 Btu/h and < 135,000 Btu/h	95°F db/ 75°F wb outdoor air	10.0 11.0 EER	
	≥135,000 Btu/h and < 240,000 Btu/h	95°F db/ 75°F wb outdoor air	10.0 11.0 EER	
SPVHP (cooling mode)	< 65,000 Btu/h	95°F db/ 75°F wb outdoor air	10.0 11.0 EER	
	≥65,000 Btu/h and < 135,000 Btu/h	95°F db/ 75°F wb outdoor air	10.0 11.0 EER	
	≥135,000 Btu/h and	95°F db/ 75°F wb	10.0 11.0 EER	

	< 240,000 Btu/h	outdoor air		
SPVHP (heating mode)	<65,000 Btu/h	47°F db/ 43°F wb outdoor air	3.0 <u>3.3</u> COP	AHRI 390
	≥65,000 Btu/h and < 135,000 Btu/h	47°F db/ 43°F wb outdoor air	3.0 <u>3.3</u> COP	
	≥135,000 Btu/h and < 240,000 Btu/h	47°F db/ 43°F wb outdoor air	3.0 <u>3.3</u> COP	
Room air conditioners, with louvered sides	< 6,000 Btu/h	—	9.7 SEER <u>11.0 CEER</u>	ANSI/AHA-MRAC-1
	≥ 6,000 Btu/h and < 8,000 Btu/h	—	9.7 SEER <u>11.0 CEER</u>	
	≥ 8,000 Btu/h and < 14,000 Btu/h	—	9.8 EER <u>10.9 CEER</u>	
	≥ 14,000 Btu/h and < 20,000 Btu/h	—	9.7 SEER <u>10.7 CEER</u>	
	≥ 20,000 Btu/h and < 25,000 Btu/h	---	9.4 CEER	
	≥25,000 Btu/h	—	8.5 EER <u>9.0 CEER</u>	
Room air conditioners, without louvered sides	<6,000 Btu/h	---	10.0 CEER	
	> 6,000 Btu/h and < 8,000 Btu/h	---	10.0 CEER	
	< 8,000 Btu/h < 11,000 Btu/h	—	9.0 EER <u>9.6 CEER</u>	
	≥ 8 <u>11</u> ,000 Btu/h and < 20 <u>14</u> ,000 Btu/h	—	8.5 EER <u>9.5 CEER</u>	
	> 14,000 Btu/h and < 20,000 Btu/h		9.3 CEER	
	≥20,000 Btu/h	—	8.5 EER <u>9.4 CEER</u>	

TABLE C403.2.3C403.3.2(3)—continued
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED PACKAGED TERMINAL AIR CONDITIONERS,
PACKAGED TERMINAL HEAT PUMPS, SINGLE-PACKAGE VERTICAL AIR CONDITIONERS,
SINGLE VERTICAL HEAT PUMPS, ROOM AIR CONDITIONERS AND ROOM AIR-CONDITIONER HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE ^a
Room air-conditioner heat pumps with louvered sides	< 20,000 Btu/h	—	9.0 EER <u>9.8 CEER</u>	ANSI/AHA-MRAC-1
	≥20,000 Btu/h	—	8.5 EER <u>9.3 CEER</u>	
Room air-conditioner heat pumps without louvered sides	< 14,000 Btu/h	—	8.5 EER <u>9.3 CEER</u>	
	≥14,000 Btu/h	—	8.0 EER <u>8.7 CEER</u>	
Room air conditioner casement only	All capacities	—	8.7 EER <u>9.5 CEER</u>	
Room air conditioner casement-slider	All capacities	—	9.5 EER <u>10.4 CEER</u>	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

“Cap” = The rated cooling capacity of the product in Btu/h. If the unit’s capacity is less than 7000 Btu/h, use 7000 Btu/h in the calculation. If the unit’s capacity is greater than 15,000 Btu/h, use 15,000 Btu/h in the calculations.

- Chapter 6-12 of the referenced standard contains a complete specification of the referenced test procedure, including the referenced year version of the test procedure.
- Replacement unit shall be factory labeled as follows: “MANUFACTURED FOR NONSTANDARD SIZE APPLICATIONS ONLY: NOT TO BE INSTALLED IN NEW STANDARD PROJECTS” or “MANUFACTURED FOR REPLACEMENT APPLICATIONS ONLY: NOT TO BE INSTALLED IN NEW CONSTRUCTION PROJECTS.” Replacement efficiencies apply only to units with existing sleeves less than 16 inches (406 mm) in height and less than 42 inches (1067 mm) in width.

TABLE 403.2.3C403.3.2(4)
WARM AIR FURNACES AND COMBINATION WARM AIR FURNACES/AIR-CONDITIONING UNITS,
WARM AIR DUCT FURNACES AND UNIT HEATERS, MINIMUM EFFICIENCY REQUIREMENTS

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY ^{d,e}	TEST PROCEDURE ^a
Warm air furnaces, gas fired	< 225,000 Btu/h	—	78 80% AFUE or 80% E_t^c	DOE 10 CFR Part 430 or ANSI Z21.47
	≥225,000 Btu/h	Maximum capacity ^c	80% E_t^f	ANSI Z21.47
Warm air furnaces, oil fired	< 225,000 Btu/h	—	78 83% AFUE or 80% E_t^c	DOE 10 CFR Part 430 or UL 727
	≥ 225,000 Btu/h	Maximum capacity ^b	81% E_t^g	UL 727
Warm air duct furnaces, gas fired	All capacities	Maximum capacity ^b	80% E_c	ANSI Z83.8
Warm air unit heaters, gas fired	All capacities	Maximum capacity ^b	80% E_c	ANSI Z83.8
Warm air unit heaters, oil fired	All capacities	Maximum capacity ^b	80% E_c	UL 731

For SI: 1 British thermal unit per hour = 0.2931 W.

- Chapter 6-12 of the referenced standard contains a complete specification of the referenced test procedure, including the referenced year version of the test procedure.
- Minimum and maximum ratings as provided for and allowed by the unit's controls.
- Combination units not covered by the National Appliance Energy Conservation Act of 1987 (NAECA) (3-phase power or cooling capacity greater than or equal to 65,000 Btu/h [19 kW]) shall comply with either rating.
- E_t = Thermal efficiency. See test procedure for detailed discussion.
- E_c = Combustion efficiency (100% less flue losses). See test procedure for detailed discussion.
- E_c = Combustion efficiency. Units must also include an IID, have jackets not exceeding 0.75 percent of the input rating, and have either power venting or a flue damper. A vent damper is an acceptable alternative to a flue damper for those furnaces where combustion air is drawn from the conditioned space.
- E_t = Thermal efficiency. Units must also include an IID, have jacket losses not exceeding 0.75 percent of the input rating, and have either power venting or a flue damper. A vent damper is an acceptable alternative to a flue damper for those furnaces where combustion air is drawn from the conditioned space.

TABLE C403.2.3C403.3.2(5)
MINIMUM EFFICIENCY REQUIREMENTS: GAS- AND OIL-FIRED BOILERS

EQUIPMENT TYPE ^a	SUBCATEGORY OR RATING CONDITION	SIZE CATEGORY (INPUT)	MINIMUM EFFICIENCY	TEST PROCEDURE
Boilers, hot water	Gas-fired	< 300,000 Btu/h ^{d,e}	82% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h ^b	80% E_t	10 CFR Part 431
		> 2,500,00 Btu/h ^a	82% E_c	
	Oil-fired ^c	< 300,000 Btu/h ^e	84% AFUE	10 CFR Part 430
		≥300,000 Btu/h and ≤ 2,500,000 Btu/h ^b	82% E_t	10 CFR Part 431
		> 2,500,000 Btu/h ^a	84% E_c	
Boilers, steam	Gas-fired	< 300,000 Btu/h ^d	80% AFUE	10 CFR Part 430
	Gas-fired- all, except natural draft	≥300,000 Btu/h and ≤ 2,500,000 Btu/h ^b	79% E_t	10 CFR Part 431
		> 2,500,000 Btu/h ^a	79% E_t	
	Gas-fired-natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h ^b	77 79% E_t	
		> 2,500,000 Btu/h ^a	77 79% E_t	
	Oil-fired ^c	< 300,000 Btu/h	82% AFUE	10 CFR Part 430
		≥300,000 Btu/h and ≤2,500,000 Btu/h ^b	81% E_t	10CFR Part 431

		> 2,500,000 Btu/h ^a	81% E_t	
--	--	--------------------------------	-----------	--

For SI: 1 British thermal unit per hour = 0.2931 W.

E_c = Combustion efficiency (100 percent less flue losses). E_t = Thermal efficiency. See referenced standard document for detailed information.

a. These requirements apply to boilers with rated input of 8,000,000 Btu/h or less that are not packaged boilers and to all packaged boilers. Minimum efficiency requirements for boilers cover all capacities of packaged boilers.

b. Maximum capacity – minimum and maximum ratings as provided for and allowed by the unit's controls.

c. Includes oil-fired (residual).

d. Boilers shall not be equipped with a constant burning ignition pilot.

e-e. A boiler not equipped with a tankless domestic water heating coil shall be equipped with an automatic means for adjusting the temperature of the water such that an incremental change in inferred heat load produces a corresponding incremental change in the temperature of the water supplied.

TABLE C403.2.3C403.3.2(6)
RESERVED

TABLE C403.2.3C403.3.2(7)
MINIMUM EFFICIENCY REQUIREMENTS:
WATER CHILLING PACKAGES^a

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	AS OF 1/1/2015 ^b				TEST PROCEDURE ^c
			PATH A		PATH B		
			FULL LOAD	IPLV	FULL LOAD	IPLV	
Air-cooled chillers	< 150 tons	EER	≥ 10.100	≥ 13.700	≥9.700	≥15.800	AHRI 550/590
	≥150 tons	EER	≥ 10.100	≥14.000	≥9.700	≥16.100	
Air cooled without condenser, electrical operated	All capacities	EER	Air-cooled chillers without condensers shall be rated with matching condensers and comply with the air-cooled chiller efficiency requirements				
Water cooled, electrically operated, reciprocating	All capacities	kW/ton	Reciprocating units shall comply with water-cooled positive displacement efficiency requirements				
Water cooled, electrically operated, positive displacement	< 75 tons	kW/ton	≤ 0.750	≤ 0.600	≤ 0.780	≤0.500	
	≥75 tons and < 150 tons	kW/ton	≤ 0.720	≤ 0.560	≤ 0.750	≤ 0.490	
	≥ 150 tons and < 300 tons	kW/ton	≤ 0.660	≤0.540	≤ 0.680	≤ 0.440	
	≥ 300 tons and < 600 tons	kW/ton	≤ 0.610	≤ 0.520	≤ 0.625	≤ 0.410	
	≥ 600 tons	kW/ton	≤ 0.560	≤ 0.500	≤ 0.585	≤ 0.380	
Water cooled, electrically operated, centrifugal	< 150 tons	kW/ton	≤ 0.610	≤ 0.550	≤ 0.695	≤ 0.440	
	≥ 150 tons and < 300 tons	kW/ton	<u>≤ 0.610</u>	<u>≤ 0.550</u>	<u>≤ 0.695</u>	<u>≤ 0.400</u>	
	≥300 tons and < 400 tons	kW/ton	≤ 0.560	≤ 0.520	≤ 0.595	≤ 0.390	
	≥400 tons	kW/ton	≤0.560	≤ 0.500	≤ 0.585	≤0.380	
Air cooled, absorption single effect	All capacities	COP	≥ 0.600	NR	NA	NA	AHRI 560
Water cooled, absorption single effect	All capacities	COP	≥ 0.700	NR	NA	NA	
Absorption double effect, indirect fired	All capacities	COP	≥1.000	≥ 1.050	NA	NA	
Absorption double effect, direct fired	All capacities	COP	≥ 1.000	≥ 1.000	NA	NA	

For SI: 1 ton = 3517 W, 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

NA = Not applicable, not to be used for compliance; NR = No requirement.

- The centrifugal chiller equipment requirements, after adjustment in accordance with Section ~~C403.2.3.1~~C403.3.2.2 or Section ~~C403.2.3.2~~C403.3.2.3, do not apply to chillers used in low-temperature applications where the design leaving fluid temperature is less than 36°F. The requirements do not apply to positive displacement chillers with leaving fluid temperatures less than or equal to 32°F. The requirements do not apply to absorption chillers with design leaving fluid temperatures less than 40°F.
- Compliance with this standard can be obtained by meeting the minimum requirements of Path A or B. However, both the full load and IPLV shall be met to fulfill the requirements of Path A or B.
- Chapter ~~6-12~~ of the referenced standard contains a complete specification of the referenced test procedure, including the referenced year version of the test procedure.

TABLE ~~C403.2.3~~C403.3.2(8)
MINIMUM EFFICIENCY REQUIREMENTS:
HEAT REJECTION EQUIPMENT

EQUIPMENT TYPE ^a	TOTAL SYSTEM HEAT REJECTION CAPACITY AT RATED CONDITIONS	SUBCATEGORY OR RATING CONDITION ⁱ	PERFORMANCE REQUIRED ^{b, c, d, g, h}	TEST PROCEDURE ^{e, f}
Propeller or axial fan open circuit cooling towers	All	95°F Entering Water 85°F Leaving Water 75°F Entering wb	≥ 38.2 40.2 gpm/hp	CTI ATC-105 and CTI STD-201 <u>RS</u>
Centrifugal fan open circuit cooling towers	All	95°F Entering Water 85°F Leaving Water 75°F Entering wb	≥ 20.0 gpm/hp	CTI ATC-105 and CTI STD-201 <u>RS</u>
Propeller or axial fan closed circuit cooling towers	All	102°F Entering Water 90°F Leaving Water 75°F Entering wb	≥ 44.0 16.1 gpm/hp	CTI ATC-105S and CTI STD-201 <u>RS</u>
Centrifugal closed circuit cooling towers	All	102°F Entering Water 90°F Leaving Water 75°F Entering wb	≥ 7.0 gpm/hp	CTI ATC-105S and CTI STD-201 <u>RS</u>
Propeller or axial fan evaporative condensers	All	R-507A Test Fluid 165°F Entering Gas Temperature 105°F Condensing Temperature 75°F Entering wb	≥157,000 Btu/h•hp	CTI ATC-106
Propeller or axial fan evaporative condensers	All	Ammonia Test Fluid 140°F Entering Gas Temperature 96.3°F Condensing Temperature 75°F Entering wb	≥134,000 Btu/h•hp	CTI ATC-106
Centrifugal fan evaporative condensers	All	R-507A Test Fluid 165°F Entering Gas Temperature 105°F Condensing Temperature 75°F Entering wb	≥135,000 Btu/h•hp	CTI ATC-106
Centrifugal fan evaporative condensers	All	Ammonia Test Fluid 140°F Entering Gas Temperature 96.3°F Condensing Temperature 75°F Entering wb	≥110,000 Btu/h•hp	CTI ATC-106
Air-cooled condensers	All	125°F Condensing Temperature R-22 Test Fluid 190°F Entering Gas Temperature 15°F Subcooling 95°F Entering db	≥ 176,000 Btu/h•hp	AHRI 460

For SI: °C = [(°F)-32]/1.8, L/s · kW = (gpm/hp)/(11.83), COP = (Btu/h · hp)/(2550.7).

db = dry bulb temperature, °F, wb = wet bulb temperature, °F.

- The efficiencies and test procedures for both open and closed circuit cooling towers are not applicable to hybrid cooling towers that contain a combination of wet and dry heat exchange sections.
- For purposes of this table, open circuit cooling tower performance is defined as the water flow rating of the tower at the thermal rating condition ~~listed in Table 403.2.3(8)~~ divided by the fan nameplate rated motor power.
- For purposes of this table, closed circuit cooling tower performance is defined as the water flow rating of the tower at the thermal rating condition ~~listed in Table 403.2.3(8)~~ divided by the sum of the fan nameplate rated motor power and the spray pump nameplate rated motor power.
- For purposes of this table, air-cooled condenser performance is defined as the heat rejected from the refrigerant divided by the fan nameplate rated motor power.
- Chapter ~~6-12~~ of the referenced standard contains a complete specification of the referenced test procedure, including the referenced year version of the test procedure.
- Where a certification program exists for a covered product, and it includes provisions for verification and challenge of equipment efficiency ratings, then the product shall be listed in the certification program, or, if a certification program exists for a covered product, and it includes provisions for

verification and challenge of equipment efficiency ratings, but the product is not listed in the existing certification program, the ratings shall be verified by an independent laboratory test report.

- g. Cooling towers shall comply with the minimum efficiency listed in the table for that specific type of tower with the capacity effect of any project-specific accessories and/or options included in the capacity of the cooling tower.
- h. For purposes of this table, evaporative condenser performance is defined as the heat rejected at the specified rating condition in the table, divided by the sum of the fan motor nameplate power and the integral spray pump nameplate power.
- i. Requirements for evaporative condensers are listed with ammonia (R-717) and R-507A as test fluids in this table. Evaporative condensers intended for use with halocarbon refrigerants other than R-507A must meet the minimum efficiency requirements listed above with R-507A as the test fluid.

TABLE C403.2.3(9)
MINIMUM EFFICIENCY REQUIREMENTS:
AIR CONDITIONERS AND CONDENSING UNITS SERVING COMPUTER ROOMS

Equipment Type	Net Sensible Cooling Capacity ^a	Minimum SCOP-127 ^b Efficiency Downflow units / Upflow units	Test Procedure
Air conditioners, air-cooled	<65,000 Btu/h (<19 kW)	2.20 / 2.09	ANSI / ASHRAE 127
	≥ 65,000 Btu/h and < 240,000 Btu/h (≥19kW and < 70 kW)	2.10 / 1.99	
	≥ 240,000 Btu/h (≥ 70 kW)	1.90 / 1.79	
Air conditioners, water-cooled	<65,000 Btu/h (<19 kW)	2.60 / 2.49	ANSI / ASHRAE 127
	≥ 65,000 Btu/h and < 240,000 Btu/h (≥19kW and < 70 kW)	2.50 / 2.39	
	≥ 240,000 Btu/h (≥ 70 kW)	2.40 / 2.29	
Air conditioners, water-cooled, with fluid economizer	<65,000 Btu/h (<19 kW)	2.55 / 2.44	ANSI / ASHRAE 127
	≥ 65,000 Btu/h and < 240,000 Btu/h (≥19kW and < 70 kW)	2.45 / 2.34	
	≥ 240,000 Btu/h (≥ 70 kW)	2.35 / 2.24	
Air conditioners, glycol-cooled (rated at 40% propylene glycol)	<65,000 Btu/h (<19 kW)	2.50 / 2.39	ANSI / ASHRAE 127
	≥ 65,000 Btu/h and < 240,000 Btu/h (≥19kW and < 70 kW)	2.15 / 2.04	
	≥ 240,000 Btu/h (≥ 70 kW)	2.10 / 1.99	
Air conditioners, glycol-cooled (rated at 40% propylene glycol) with fluid economizer	<65,000 Btu/h (<19 kW)	2.45 / 2.34	ANSI / ASHRAE 127
	≥ 65,000 Btu/h and < 240,000 Btu/h (≥19kW and < 70 kW)	2.10 / 1.99	
	≥ 240,000 Btu/h (≥ 70 kW)	2.05 / 1.94	

a. Net sensible cooling capacity: The total gross cooling capacity less the latent cooling less the energy to the air movement system. (Total Gross – latent – Fan Power)

b. Sensible coefficient of performance (SCOP-127): a ratio calculated by dividing the net sensible cooling capacity in watts by the total power input in watts (excluding re-heaters and humidifiers) at conditions defined in ASHRAE Standard 127. The net sensible cooling capacity is the gross sensible capacity minus the energy dissipated into the cooled space by the fan system.

TABLE C403.3.2(9)

**MINIMUM EFFICIENCY REQUIREMENTS:
AIR CONDITIONERS AND CONDENSING UNITS SERVING COMPUTER ROOMS**

Equipment Type	Net Sensible Cooling Capacity	Standard Model	Minimum Net Sensible COP _c			Test Procedure
			Return Air Dry-Bulb Temperature/ Dew-Point Temperature			
			Class 1	Class 2	Class 3	
			75°F/52°F	85°F/52°F	95°F/52°F	
Air cooled	<65,000 Btu/h	Downflow unit	2.09	2.30	2.45	AHRI 1360
		Upflow unit—ducted		2.10		
		Upflow unit—unducted				
		Horizontal-flow unit				
	≥ 65,000 Btu/h and < 240,000 Btu/h	Downflow unit	1.99	2.20	2.35	
		Upflow unit—ducted		2.05		
		Upflow unit—unducted				
		Horizontal-flow unit				
	≥ 240,000 Btu/h	Downflow unit	1.79	2.00	2.15	
Upflow unit—ducted		1.85				
Upflow unit—unducted						
Horizontal-flow unit						
Water cooled	<65,000 Btu/h	Downflow unit	2.25	2.50	2.70	AHRI 1360
		Upflow unit—ducted		2.30		
		Upflow unit—unducted				
		Horizontal-flow unit				
	≥ 65,000 Btu/h and < 240,000 Btu/h	Downflow unit	2.15	2.40	2.60	
		Upflow unit—ducted		2.20		
		Upflow unit—unducted				
		Horizontal-flow unit				
	≥ 240,000 Btu/h	Downflow unit	2.05	2.25	2.45	
Upflow unit—ducted		2.10				
Upflow unit—unducted						
Horizontal-flow unit						
Water cooled with fluid economizer	<65,000 Btu/h	Downflow unit	2.20	2.45	2.60	AHRI 1360
		Upflow unit—ducted		2.25		
		Upflow unit—unducted				
		Horizontal-flow unit				
	≥ 65,000 Btu/h and < 240,000 Btu/h	Downflow unit	2.10	2.35	2.55	
		Upflow unit—ducted		2.15		
		Upflow unit—unducted				
		Horizontal-flow unit				
	≥ 240,000 Btu/h	Downflow unit	2.00	2.20	2.40	
Upflow unit—ducted		2.05				
Upflow unit—unducted						
Horizontal-flow unit						
Glycol cooled	<65,000 Btu/h	Downflow unit	2.00	2.30	2.40	AHRI 1360
		Upflow unit—ducted		2.10		
		Upflow unit—unducted				
		Horizontal-flow unit				
	≥ 65,000 Btu/h and < 240,000 Btu/h	Downflow unit	2.05	1.85		

	$\geq 240,000$ Btu/h	Upflow unit—unducted	1.85		2.15	
		Horizontal-flow unit				
		Downflow unit		1.95		
		Upflow unit—ducted		1.80		
Glycol cooled with fluid economizer	$< 65,000$ Btu/h	Upflow unit—unducted	1.75			AHRI 1360
		Horizontal-flow unit			2.10	
		Downflow unit		2.25		
		Upflow unit—ducted		2.10		
	$\geq 65,000$ Btu/h and $< 240,000$ Btu/h	Upflow unit—unducted	2.00			
		Horizontal-flow unit			2.35	
		Downflow unit		1.95		
		Upflow unit—ducted		1.80		
	$\geq 240,000$ Btu/h	Upflow unit—unducted	1.75			
		Horizontal-flow unit			2.10	
		Downflow unit		1.90		
		Upflow unit—ducted		1.80		
	$\geq 240,000$ Btu/h	Upflow unit—unducted	1.70			
		Horizontal-flow unit			2.10	

TABLE C403.2.3C403.3.2(10)
MINIMUM EFFICIENCY REQUIREMENTS: HEAT TRANSFER EQUIPMENT

EQUIPMENT TYPE	SUBCATEGORY	MINIMUM EFFICIENCY	TEST PROCEDURE ^a
Liquid-to-liquid heat exchangers	Plate type	NR	AHRI 400

NR = No Requirement

- a. Chapter 6-12 of the referenced standard contains a complete specification of the referenced test procedure, including the referenced year version of the test procedure.

C403.2.3.1C403.3.2.2 Water-cooled centrifugal chilling packages. Equipment not designed for operation at AHRI Standard 550/590 test conditions of 44°F (7°C) leaving chilled-water temperature and 2.4 gpm/ton evaporator fluid flow and 85°F (29°C) entering condenser water temperature with 3 gpm/ton (0.054 L/s × kW) condenser water flow shall have maximum full-load kW/ton (*FL*) and part-load ratings adjusted using Equations 4-7 and 4-8.

$$FL_{adj} = FL/K_{adj}$$

(Equation 4-7)

$$PLV_{adj} = IPLV/K_{adj}$$

(Equation 4-8)

Where:

$$K_{adj} = A \times B$$

FL = Full-load kW/ton values as specified in Table C403.2.3C403.3.2(7)

FL_{adj} = Maximum full-load kW/ton rating, adjusted for nonstandard conditions

IPLV = Values as specified in Table C403.2.3C403.3.2(7)

PLV_{adj} = Maximum NPLV rating, adjusted for nonstandard conditions.

$$A = 0.00000014592 \times (LIFT)^4 - 0.0000346496 \times (LIFT)^3 + 0.00314196 \times (LIFT)^2 - 0.147199 \times LIFT + 3.9302$$

$$B = 0.0015 \times L_{vg}^{Evap} (^\circ F) + 0.934$$

$$LIFT = L_{vg}^{Cond} - L_{vg}^{Evap}$$

L_{vg}^{Cond} = Full-load condenser leaving fluid temperature ($^\circ F$)

L_{vg}^{Evap} = Full-load evaporator leaving temperature ($^\circ F$)

The FL_{adj} and PLV_{adj} values are only applicable for centrifugal chillers meeting all of the following full-load design ranges:

1. Minimum evaporator leaving temperature: 36°F.
2. Maximum condenser leaving temperature: 115°F.
3. LIFT is not less than 20°F and not greater than 80°F.

~~C403.2.3.2~~C403.3.2.3 Positive displacement (air- and water-cooled) chilling packages. Equipment with a leaving fluid temperature higher than 32°F (0°C) and water-cooled positive displacement chilling packages with a condenser leaving fluid temperature below 115°F (46°C) shall meet the requirements of Table ~~C403.2.3~~C403.3.2(7) when tested or certified with water at standard rating conditions, in accordance with the referenced test procedure.

~~C403.2.3.3~~C403.3.2.4 Packaged electric heating and cooling equipment. Packaged electric equipment providing both heating and cooling with a total cooling capacity greater than 6,000 Btu/h shall be a heat pump.

Exception: Unstaffed equipment shelters or cabinets used solely for personal wireless service facilities.

~~C403.2.3.4~~C403.3.2.5 Humidification. If an air economizer is required on a cooling system for which humidification equipment is to be provided to maintain minimum indoor humidity levels, then the humidifier shall be of the adiabatic type (direct evaporative media or fog atomization type).

Exceptions:

1. Health care facilities licensed by the state where Chapter 246-320 or 246-330 WAC requires steam injection humidifiers in duct work downstream of final filters.
2. Systems with water economizer.
3. 100% outside air systems with no provisions for air recirculation to the central supply fan.
4. Nonadiabatic humidifiers cumulatively serving no more than 10% of a building's air economizer capacity as measured in cfm. This refers to the system cfm serving rooms with stand-alone or duct mounted humidifiers.

~~C403.4.6~~C403.3.3 Hot gas bypass limitation. Cooling systems shall not use hot gas bypass or other evaporator pressure control systems unless the system is designed with multiple steps of unloading or continuous capacity modulation. The capacity of the hot gas bypass shall be limited as indicated in Table ~~C403.4.6~~C403.3.3, as limited by Section C403.35.1

**TABLE ~~C403.4.6~~C403.3.3
MAXIMUM HOT GAS BYPASS CAPACITY**

RATED CAPACITY	MAXIMUM HOT GAS BYPASS CAPACITY (% of total capacity)
≤ 240,000 Btu/h	50
> 240,000 Btu/h	25

For SI: 1 British thermal unit per hour = 0.2931 W.

~~C403.4.2.5~~C403.3.4 Boiler turndown. Boiler systems with design input of greater than 1,000,000 Btu/h (293 kW) shall comply with the turndown ratio specified in Table ~~C403.4.2.5~~C403.3.4.

The system turndown requirement shall be met through the use of multiple single input boilers, one or more *modulating boilers* or a combination of single input and modulating boilers.

**TABLE ~~C403.4.2.5~~C403.3.4
BOILER TURNDOWN**

Boiler System Design Input (Btu/h)	Minimum Turndown Ratio
------------------------------------	------------------------

≥1,000,000 and less than or equal to 5,000,000	3 to 1
> 5,000,000 and less than or equal to 10,000,000	4 to 1
>10,000,000	5 to 1

C403.3.5 Dedicated outdoor air systems (DOAS). ~~For office, retail, education, libraries and fire stations~~ For buildings with occupancies as shown in Table C403.3.5, outdoor air shall be provided to each occupied space by a dedicated outdoor air system (DOAS) which delivers 100 percent outdoor air without requiring operation of the heating and cooling system fans for ventilation air delivery. ~~The DOAS supply air shall be delivered directly to the occupied space or downstream of the terminal heating and/or cooling coils.~~

Commented [BK(108)]:
M062-2018

Commented [BK(109)]:
M063-2018

Exceptions:

1. Occupied spaces that are not ventilated by a mechanical ventilation system and are only ventilated by a natural ventilation system per Section 402 of the *International Mechanical Code*.
2. High efficiency variable air volume (VAV) systems complying with Section C403.6.10. This exception shall not be used as a substitution for a DOAS per Section C406.6 ~~or as a modification to the requirements for the Standard Reference Design per Section C407.~~

Commented [BK(110)]:
P141-2018

Commented [BK(111)]:
M062-2018

**TABLE C403.3.5
OCCUPANCY CLASSIFICATIONS REQUIRING DOAS**

<u>Occupancy Classification^a</u>	<u>Inclusions</u>	<u>Exempted</u>
<u>A-1</u>	<u>All occupancies not specifically exempted</u>	<u>Television and Radio studios</u>
<u>A-2</u>	<u>Casinos (gaming area)</u>	<u>All other A-2 occupancies</u>
<u>A-3</u>	<u>Lecture halls, community halls, exhibition halls, Gymnasiums, Courtrooms, Libraries, Places of Religious Worship</u>	<u>All other A-3 occupancies</u>
<u>A-4, A-5</u>		<u>All occupancies excluded</u>
<u>B</u>	<u>All occupancies not specifically exempted</u>	<u>Food processing establishments including commercial kitchens, restaurants, cafeterias; laboratories for testing and research; data processing facilities and telephone exchanges; air traffic control towers; animal hospitals, kennels, pounds; ambulatory care facilities.</u>
<u>F, H, I, R, S, U</u>		<u>All occupancies excluded</u>
<u>E, M</u>	<u>All occupancies included</u>	

a. Occupancy classification from the *International Building Code* Chapter 3.

C403.3.5.1 Energy recovery ventilation with DOAS. ~~The DOAS shall include energy recovery ventilation, that complies with the minimum energy recovery efficiency and energy recovery bypass requirements, where applicable, of Section C403.7.6.1.~~ The energy recovery system shall have a 60 percent minimum sensible recovery effectiveness or have 50 percent enthalpy recovery effectiveness per section C403.7.6.1. For DOAS having a total fan system motor nameplate hp less than 5 hp, total combined fan power shall not exceed 1 W/cfm of outdoor air. For DOAS having a total fan system motor hp greater than or equal to 5 hp, refer to fan power limitations of Section C403.8.1. This fan power restriction applies to each dedicated outdoor air unit in the permitted project, but does not include the fan power associated with the zonal heating/cooling equipment. ~~The airflow rate thresholds for energy recovery requirements in Tables C403.7.6.1(1) and C403.7.6.1(2) do not apply.~~

Commented [BK(112)]:
M065-2018

Commented [BK(113)]:
M064-2018

Commented [BK(114)]:
M064-2018

Exceptions:

1. Occupied spaces ~~under the threshold of Section C403.7.6~~ with all of the following characteristics; complying with C403.7.6.1, served by equipment less than 5000 cfm, with an average occupant load greater than 25 people per 1000 square feet (93 m²) of floor area (as established in Table 403.3.1.1 of the *International Mechanical Code*) that include demand control ventilation configured to reduce outdoor air by at least 50% below design minimum ventilation rates when the actual occupancy of the space served by the system is less than the design occupancy.

2. Systems installed for the sole purpose of providing makeup air for systems exhausting toxic, flammable, paint, or corrosive fumes or dust, dryer exhaust, or commercial kitchen hoods used for collecting and removing grease vapors and smoke.

C403.3.5.2 Heating/cooling system fan controls. Heating and cooling equipment fans, heating and cooling circulation pumps, and terminal unit fans shall cycle off and terminal unit primary cooling air shall be shut off when there is no call for heating or cooling in the zone.

Exception: Fans used for heating and cooling using less than 0.12 watts per cfm may operate when space temperatures are within the setpoint deadband (Section C403.4.1.2) to provide destratification and air mixing in the space.

C403.3.5.3 Impracticality. Where the code official determines full compliance with all of the requirements of Section C403.7.4.1 and C403.7.4.2 would be impractical, it is permissible to provide an approved alternate means of compliance that achieves a comparable level of energy efficiency. For the purposes of this section, impractical means that an HVAC system complying with Section C403.7.4 cannot effectively be utilized due to an unusual use or configuration of the building.

C403.2.13 Variable flow capacity. For fan and pump motors 7.5 hp and greater including motors in or serving custom and packaged air handlers serving variable air volume fan systems, constant volume fans, heating and cooling hydronic pumping systems, pool and service water pumping systems, domestic water pressure boosting systems, cooling tower fan, and other pump or fan motors where variable flows are required, there shall be:

1. Variable speed drives; or
2. Other controls and devices that will result in fan and pump motor demand of no more than 30 percent of design wattage at 50 percent of design air volume for fans when static pressure set point equals 1/3 the total design static pressure, and 50 percent of design water flow for pumps, based on manufacturer's certified test data. Variable inlet vanes, throttling valves (dampers), scroll dampers or bypass circuits shall not be allowed.

Exception: Variable speed devices are not required for motors that serve:

1. Fans or pumps in packaged equipment where variable speed drives are not available as a factory option from the equipment manufacturer.
2. Fans or pumps that are required to operate only for emergency fire life safety events (e.g., stairwell pressurization fans, elevator pressurization fans, fire pumps, etc.).

C403.2.13.1 Heat rejection equipment. The requirements of this section apply to heat rejection equipment used in comfort cooling systems such as air-cooled condensers, open cooling towers, closed-circuit cooling towers, and evaporative condensers.

Exception: Heat rejection devices included as an integral part of equipment listed in Tables C403.2.3(1) through C403.2.3(3).

Heat rejection equipment shall have a minimum efficiency performance not less than values specified in Table C403.2.3(8). These requirements apply to all propeller, axial fan and centrifugal fan cooling towers. Table C403.2.3(8) specifies requirements for air-cooled condensers that are within rating conditions specified within the table.

C403.2.13.1.1 Variable flow controls. Cooling tower fans 7.5 hp and greater shall have control devices that vary flow by controlling the leaving fluid temperature or condenser temperature/pressure of the heat rejection device.

C403.2.13.1.2 Limitation on centrifugal fan cooling towers. Open cooling towers with a combined rated capacity of 1,100 gpm and greater at 95°F condenser water return, 85°F condenser water supply and 75°F outdoor wet-bulb temperature shall meet the energy efficiency requirement for axial fan open-circuit cooling towers.

C403.3.6 Ventilation for Group R-2 occupancy. For all Group R-2 dwelling and sleeping units, a balanced ventilation system with heat recovery system with minimum 60 percent sensible recovery effectiveness shall provide outdoor air directly to all habitable space. The ventilation system shall allow for the design flow rates to be tested and verified at each habitable space as part of the commissioning process per section C408.2.2.

Commented [BK(115)]:
nv046-2018

C403.2.4 HVAC system controls. HVAC systems shall be provided with controls as defined in this section in accordance with Sections C403.4.1 through C403.4.11 and shall be capable of and configured to implement all required control functions in this code.

C403.2.4.1 Thermostatic controls. The supply of heating and cooling energy to each zone shall be controlled by individual thermostatic controls capable of responding to temperature within the zone. Controls in the same zone or in neighboring zones connected by openings larger than 10 percent of the floor area of either zone shall not allow for

simultaneous heating and cooling. At a minimum, each floor of a building shall be considered as a separate zone. Controls on systems required to have economizers and serving single zones shall have multiple cooling stage capability and activate the economizer when appropriate as the first stage of cooling. See Section ~~C403.3.4~~C403.5 for further economizer requirements. Where humidification or dehumidification or both is provided, at least one humidity control device shall be provided for each humidity control system.

Exceptions:

1. Independent perimeter systems that are designed to offset only building envelope heat losses or gains or both serving one or more perimeter *zones* also served by an interior system provided:
 - ~~a.1.1.~~ The perimeter system includes at least one thermostatic control *zone* for each building exposure having exterior walls facing only one orientation (within +/-45 degrees) (0.8 rad) for more than 50 contiguous feet (15,240 mm);
 - ~~b.1.2.~~ The perimeter system heating and cooling supply is controlled by a thermostat located within the *zones* served by the system; and
 - ~~c.1.3.~~ Controls are configured to prevent the perimeter system from operating in a different heating or cooling mode from the other equipment within the zones or from neighboring zones connected by openings larger than 10 percent of the floor area of either zone.
2. Any interior zone open to a perimeter zone shall have setpoints and deadbands coordinated so that cooling in the interior zone shall not operate while the perimeter zone is in heating until the interior zone temperature is 5°F (2.8°C) higher than the perimeter zone temperature, unless the interior and perimeter zones are separated by a partition whose permanent openings are smaller than 10 percent of the perimeter zone floor area.
- ~~2.3. Dedicated outdoor air units that provide ventilation air, make-up air or replacement air for exhaust systems are permitted to be controlled based on supply air temperature. The supply air temperature shall be controlled to a maximum of 65°F (18.3°C) in heating and a minimum of 72°F (22°C) in cooling unless the supply air temperature is being reset based on the status of cooling or heating in the zones served or it being reset based on outdoor air temperature.~~

Commented [BK(116)]
M067-2018

~~C403.2.4.1.1~~C403.4.1.1 **Heat pump supplementary heat.** Unitary air cooled heat pumps shall include microprocessor controls that minimize supplemental heat usage during start-up, set-up, and defrost conditions. These controls shall anticipate need for heat and use compression heating as the first stage of heat. Controls shall indicate when supplemental heating is being used through visual means (e.g., LED indicators). Heat pumps equipped with supplementary heaters shall be installed with controls that prevent supplementary heater operation above 40°F.

Exception: Packaged terminal heat pumps (PTHPs) of less than 2 tons (24,000 Btu/hr) cooling capacity provided with controls that prevent supplementary heater operation above 40°F.

~~C403.2.4.1.2~~C403.4.1.2 **Deadband.** Where used to control both heating and cooling, zone thermostatic controls shall be configured to provide a temperature range or deadband of at least 5°F (2.8°C) within which the supply of heating and cooling energy to the zone is shut off or reduced to a minimum.

Exceptions:

1. Thermostats requiring manual changeover between heating and cooling modes.
2. Occupancies or applications requiring precision in indoor temperature control as *approved* by the *code official*.

~~C403.2.4.1.3~~C403.4.1.3 **Setpoint overlap restriction.** Where a *zone* has a separate heating and a separate cooling thermostatic control located within the zone, a limit switch, mechanical stop or direct digital control system with software programming shall be configured to prevent the heating set point from exceeding the cooling setpoint and to maintain a deadband in accordance with Section C403.2.4.1.2.

~~C403.4.1.4 Heated or cooled vestibules. The heating system for heated vestibules and air curtains with integral heating shall be provided with controls configured to shut off the source of heating when the outdoor air temperature is greater than 45°F (7°C). Vestibule heating and cooling systems shall be controlled by a thermostat located in the vestibule configured to limit heating to a temperature not greater than 60°F (16°C) and cooling to a temperature not less than 85°F (29°C).~~

Exceptions:

1. Control of heating or cooling provided by ~~site recovered energy or~~ transfer air that would otherwise be exhausted.
- ~~4.2. Vestibule heating only systems are permitted to be controlled without an outdoor air temperature lockout when controlled by a thermostat located in the vestibule configured to limit heating to a temperature not greater than 45°F (7°C) where required for freeze protections of piping and sprinkler heads located in the vestibule.~~

Commented [BK(117)]
G004-2018

Commented [BK(118)]
M068-2018

~~C403.2.5~~**C403.4.1.5 Hot water boiler outdoor temperature setback control.** Hot water boilers that supply heat to the building through one- or two-pipe heating systems shall have an outdoor setback control that lowers the boiler water temperature based on the outdoor temperature.

C403.4.1.6 Door Switches for HVAC System Thermostatic Control. Doors that open to the outdoors from a conditioned space must have controls configured to do the following when the doors once doors have been open for 5 minutes:

Commented [BK(119)]
M069-2018

1. Disable the mechanical heating to the zone or reset the space heating temperature setpoint to 55 °F or less within 5 minutes of the door open enable signal.
2. Disable the mechanical cooling to the zone or reset the space cooling temperature setpoint to 85 °F or more within 5 minutes of the door open enable signal.

Exceptions:

1. Building entrances with vestibules.
2. Alterations to existing buildings.
3. Loading docks.

~~C403.2.4.2~~**C403.4.2 Off-hour controls.** For all occupancies other than Group R, each zone shall be provided with thermostatic setback controls that are controlled by either an automatic time clock or programmable control system.

Exceptions:

1. Zones that will be operated continuously.
2. Zones with a full HVAC load demand not exceeding 6,800 Btu/h (2 kW) and having a ~~readily accessible~~ manual shutoff switch located with ready access.

~~C403.2.4.2.1~~**C403.4.2.1 Thermostatic setback capabilities.** Thermostatic setback controls shall be configured to set back or temporarily operate the system to maintain zone temperatures down to 55°F (13°C) or up to 85°F (29°C).

~~C403.2.4.2.2~~**C403.4.2.2 Automatic setback and shutdown capabilities.** Automatic time clock or programmable controls shall be capable of starting and stopping the system for seven different daily schedules per week and retaining their programming and time setting during a loss of power for at least 10 hours. Additionally, the controls shall have a manual override that allows temporary operation of the system for up to 2 hours; a manually operated timer configured to operate the system for up to 2 hours; or an occupancy sensor.

~~C403.2.4.2.3~~**C403.4.2.3 Automatic start capabilities and stop.** Automatic start and stop controls shall be provided for each HVAC system. The automatic start controls shall be ~~capable of configured to~~ automatically adjusting the daily start time of the HVAC system in order to bring each space to the desired occupied temperature immediately prior to scheduled occupancy. The automatic stop controls shall be configured to reduce the HVAC system's heating temperature setpoint and increase the cooling temperature setpoint by at least 2°F before scheduled unoccupied periods based upon the thermal lag and acceptable drift in space temperature that is within comfort limits. At a minimum the controls shall be a function of the space temperature, occupied and unoccupied temperatures, and the amount of time prior to scheduled occupancy.

Commented [BK(120)]
M070-2018

C403.4.2.4 Exhaust system off-hour controls. For all occupancies other than Group R, exhaust systems serving spaces within the conditioned envelope shall be controlled by either an automatic time clock, thermostatic controls or programmable control system to operate on the same schedule as the HVAC systems providing their make-up air.

Commented [BK(121)]
M070-2018

Commented [BK(122)]
M071-2018

Exceptions:

1. Exhaust systems requiring continuous operation.
2. Exhaust systems that are controlled by occupancy sensor control configured with automatic on and automatic shutoff within 15 minutes after occupants have left the space.

C403.4.2.5 Transfer and destratification fan system off-hour controls. For all occupancies other than Group R, transfer fan or mixing fan systems serving spaces within the conditioned envelope shall be controlled by either an automatic time clock, thermostatic controls or programmable control system to operate on the same schedule as the associated HVAC systems.

Commented [BK(123)]
M071-2018

Exception: Transfer fan and destratification fan systems that are controlled by occupancy sensor control configured with manual on and automatic shutoff within 15 minutes after occupants have left the space.

~~C403.4.2~~**C403.4.3 Hydronic systems controls.** The heating of fluids that have been previously mechanically cooled and the cooling of fluids that have been previously mechanically heated shall be limited in accordance with Sections ~~C403.4.2.1~~**C403.4.3.1** through ~~C403.4.2.3~~**C403.4.3.3**. Hydronic heating systems comprised of multiple-packaged boilers and designed to deliver conditioned water or steam into a common distribution system shall include automatic controls

configured to sequence operation of the boilers. Hydronic heating systems comprised of a single boiler and greater than 500,000 Btu/h (146,550 W) input design capacity shall include either a multi-staged or modulating burner.

~~C403.4.2.2~~**C403.4.3.1 Three-pipe system.** Hydronic systems that use a common return system for both hot water and chilled water are prohibited.

~~C403.4.2.2~~**C403.4.3.2 Two-pipe changeover system.** Systems that use a common distribution system to supply both heated and chilled water shall be designed to allow a dead band between changeover from one mode to the other of at least 15°F (8.3°C) outside air temperatures; be designed to and provided with controls that will allow operation in one mode for at least 4 hours before changing over to the other mode; and be provided with controls that allow heating and cooling supply temperatures at the changeover point to be no more than 30°F (16.7°C) apart.

~~C403.4.2.3~~**C403.4.3.3 Hydronic (water loop) heat pump systems.** Hydronic heat pump systems shall comply with Sections ~~C403.4.2.3.1~~**C403.4.3.3.1** through ~~C403.4.2.3.3~~**C403.4.3.3.3**.

~~C403.4.2.3.1~~**C403.4.3.3.1 Temperature dead band.** Hydronic heat pumps connected to a common heat pump water loop with central devices for heat rejection and heat addition shall have controls that are configured to provide a heat pump water supply temperature dead band of at least 20°F (11.1°C) between initiation of heat rejection and heat addition by the central devices.

Exception: Where a system loop temperature optimization controller is installed and can determine the most efficient operating temperature based on real time conditions of demand and capacity, dead bands of less than 20°F (11°C) shall be permitted.

~~C403.4.2.3.2~~**C403.4.3.3.2 Heat rejection.** ~~Heat rejection equipment shall comply with Sections C403.4.2.3.2.1 and C403.4.2.3.2.2.~~ The following shall apply to hydronic water loop heat pump systems:

1. ~~Where a closed-circuit cooling tower is used directly in the heat pump loop, either an automatic valve shall be installed to bypass the flow of water around the closed-circuit cooling tower, except for any the minimum flow necessary for freeze protection, or low leakage positive closure dampers shall be provided. Flow controls for freeze protection shall not allow water through the closed-circuit cooling tower when outside temperatures are above the freezing point of the glycol/water solution, i.e. 32°F (0°C) for 100 percent water applications, and 18°F (-7.8°C) for 20 percent by mass propylene glycol solution.~~
2. ~~Where an open-circuit cooling tower is used directly in the heat pump loop, an automatic valve shall be installed to bypass all heat pump water flow around the open-circuit cooling tower.~~
- 4.3. ~~Where an open-circuit cooling tower is used in conjunction with a separate heat exchanger to isolate the open-circuit cooling tower from the heat pump loop, heat loss shall be controlled by shutting down the circulation pump on the cooling tower loop.~~

Exception: Where it can be demonstrated that a heat pump system will be required to reject heat throughout the year.

~~C403.4.2.3.2.1~~**Climate Zone 4.** For Climate Zone 4:

1. ~~If a closed circuit cooling tower is used directly in the heat pump loop, either an automatic valve shall be installed to bypass all but a minimal flow of water around the tower, or lower leakage positive closure dampers shall be provided.~~
2. ~~If an open circuit tower is used directly in the heat pump loop, an automatic valve shall be installed to bypass all heat pump water flow around the tower.~~
3. ~~If an open or closed circuit cooling tower is used in conjunction with a separate heat exchanger to isolate the cooling tower from the heat pump loop, then heat loss shall be controlled by shutting down the circulation pump on the cooling tower loop.~~

~~C403.4.2.3.2.2~~**Climate Zone 5.** For Climate Zone 5, if an open or closed circuit cooling tower is used, then a separate heat exchanger shall be provided to isolate the cooling tower from the heat pump loop, and heat loss shall be controlled by shutting down the circulation pump on the cooling tower loop and providing an automatic valve to stop the flow of fluid.

~~C403.4.2.3.3~~**C403.4.3.3.3 Isolation valve.** Each hydronic heat pump on the hydronic system having a total pump system power exceeding 10 horsepower (hp) (7.5 kW) shall have a two-way (but not three-way) valve. For the purposes of this section, pump system power is the sum of the nominal power demand (i.e., nameplate horsepower at nominal motor efficiency) of motors of all pumps that are required to operate at design conditions to supply fluid from the heating or cooling source to all heat transfer devices (e.g., coils, heat exchanger) and return it to the source. This converts the system into a variable flow system and, as such, the primary circulation pumps shall comply with

Commented [BK(124)]:
M072-2018

Commented [BK(125)]:
M072-2018

the variable flow requirements in Section C403.4.2.6.

C403.4.2.4 Part load controls. Hydronic systems greater than or equal to 300,000 Btu/h (88 kW) in design output capacity supplying heated or chilled water to comfort conditioning systems shall include controls that are configured to:

1. Automatically reset the supply-water temperatures in response to varying building heating and cooling demand using coil valve position, zone-return water temperature or outdoor air temperature. The temperature shall be reset by not less than 25 percent of the design supply-to-return water temperature difference.

Exception: Hydronic systems serving hydronic heat pumps.

2. Automatically vary fluid flow for hydronic systems with a combined pump motor capacity of 3-2 hp or larger with three or more control valves or other devices by reducing the system design flow rate by not less than 50 percent or the maximum reduction allowed by designed the equipment manufacturer for proper operation of equipment by valves that modulate or step open and close, or pumps that modulate or turn on and off as a function of load.
3. Automatically vary pump flow on heating water systems, chilled-water systems and heat rejection loops serving water-cooled unitary air conditioners as follows:

3.1. Where pumps operate continuously or operate based on a time schedule, pumps with nominal with a combined-output motor capacity power of 3-2 hp or more larger by reducing pump design flow by not less than 50 percent utilizing adjustable speed drives on pumps, or multiple staged pumps where not less than one half of the total pump horsepower is capable of being automatically turned off. Pump flow shall be controlled to maintain one control valve nearly wide open or to satisfy the minimum differential pressure shall have a variable speed drive.

3.2. Where pumps have automatic direct digital control configured to operate pumps only when zone heating or cooling is required, a variable speed drive shall be provided for pumps with motors having the same or greater nominal output power indicated in Table C403.4.4 based on the climate zone and system served.

- 3.4. Where a variable speed drive is required by Item 3 of this Section, pump motor power input shall be not more than 30 percent of design wattage at 50 percent of the design water flow. Pump flow shall be controlled to maintain one control valve nearly wide open or to satisfy the minimum differential pressure

Exceptions:

1. Supply-water temperature reset is not required for chilled-water systems supplied by off-site district chilled water or chilled water from ice storage systems.
2. Minimum flow rates other than 50 percent as required by the equipment manufacturer for proper operation of equipment where using flow bypass or end-of line 3 way valves. Variable pump flow is not required on dedicated coil circulation pumps where needed for freeze protection.
3. Variable pump flow is not required on dedicated equipment circulation pumps where configured in primary/secondary design to provide the minimum flow requirements of the equipment manufacturer for proper operation of equipment.
- 3.4. Variable speed drives are not required on heating water pumps where more than 50 percent of annual heat is generated by an electric boiler.

TABLE C403.4.4
VARIABLE SPEED DRIVE (VSD) REQUIREMENTS FOR DEMAND-CONTROLLED PUMPS

<u>Climate Zones 4c, 5b</u>	<u>VSD Required for Motors with Rated Output of at Least</u>
<u>Heating Water Pumps</u>	<u>≥7.5 HP</u>
<u>Chilled water and Heat Rejection Loop Pumps</u>	<u>≥10 HP</u>

C403.4.2.6C403.4.5 Pump isolation. Chilled water plants including more than one chiller shall be capable of and configured to reduce flow automatically through the chiller plant when a chiller is shut down and automatically shut off flow to chillers that are shut down. Chillers piped in series for the purpose of increased temperature differential shall be considered as one chiller.

Exception: Chillers that are piped in series for the purpose of increased temperature differential.

Boiler plants-systems including more than one boiler shall be capable of and configured to reduce flow automatically through the boiler plant-system when a boiler is shut down.

C403.4.2.7C403.4.6 Variable flow controls. Individual pumps required by this code to have variable speed control shall

be controlled in one of the following manners:

- ~~a.1.~~ For systems having a combined pump motor horsepower less than or equal to 20 hp (15 kW) and without direct digital control of individual coils, pump speed shall be a function of either:

~~a.1.1.~~ Required differential pressure; or

~~b.1.2.~~ Reset directly based on zone hydronic demand, or other zone load indicators; or

~~1.3.~~ Reset directly based on pump power and pump differential pressure.

~~e.1.4.~~ Reset directly by an integral controller based on the relationship between variable speed controller frequency and power.

Commented [BK(126)]
M074-2018

- ~~b.2.~~ For systems having a combined pump motor horsepower that exceeds 20 hp (15 kW) or smaller systems with direct digital control, pump speed shall be a function of either:

~~a.2.1.~~ The static pressure set point as reset based on the valve requiring the most pressure; or

~~2.2.~~ Directly controlled based on zone hydronic demand.

~~b.2.3.~~ Reset directly by an integral controller based on the relationship between variable speed controller frequency and power.

Commented [BK(127)]
M074-2018

~~C403.2.4.8~~ **C403.4.7 Combustion heating equipment controls.** Combustion heating equipment with a capacity over 225,000 Btu/h shall have modulating or staged combustion control.

Exceptions:

1. Boilers.
2. Radiant heaters.

~~C403.4.7.1 Combustion decorative vented appliance, combustion fireplace and fire pit controls.~~ Combustion decorative vented appliances, combustion fireplaces and fire pits shall be equipped with local controls to limit operation to a maximum duration of one hour without override hold capability or shall be controlled by occupancy sensor control configured with manual on and automatic shutoff within 15 minutes after occupants have left the space.

Commented [BK(128)]
M075-2018

~~C403.2.4.9~~ **C403.4.8 Group R-1 hotel/motel guest room/guestrooms.** See Section C403.7.5. ~~For hotel and motel guest rooms, a minimum of one of the following control technologies shall be required in hotels/motels with over 50 guest rooms such that the space temperature would automatically setback (winter) or set up (summer) by no less than 5°F (3°C) when the occupant is not in the room:~~

~~Controls that are activated by the room occupant via the primary room access method—Key, card, deadbolt, etc.~~

~~Occupancy sensor controls that are activated by the occupant's presence in the room.~~

~~C403.2.4.10~~ **C403.4.9 Group R-2 and R-3 dwelling units.** The primary space conditioning system within each dwelling unit shall be provided with at least one programmable thermostat for the regulation of space temperature. The thermostat shall allow for, at a minimum, a 5-2 programmable schedule (weekdays/weekends) and be capable of providing at least two programmable setback periods per day.

Each additional system provided within the dwelling unit shall be provided with at least one adjustable thermostat for the regulation of temperature.

Exceptions:

1. Systems controlled by an occupant sensor that is configured to shut the system off when no occupant is sensed for a period of up to 30 minutes.
2. Systems controlled solely by a manually operated timer configured to operate the system for no more than two hours.
3. Ductless heat pumps.

Each thermostat shall be capable of being set by adjustment or selection of sensors as follows:

1. When used to control heating only: 55°F to 75°F.
2. When used to control cooling only: 70°F to 85°F.
3. All other: 55°F to 85°F with an adjustable deadband ~~of not less than 10°F~~ configured to at least 5°F (2.8°C) in accordance with Section C403.4.1.2.

Commented [BK(129)]
M076-2018

~~C403.2.4.11~~ **C403.4.10 Group R-2 sleeping units.** The primary space conditioning system within each sleeping unit shall be provided with at least one programmable thermostat for the regulation of space temperature. The thermostat shall allow for, at a minimum, a 5-2 programmable schedule (weekdays/weekends) and be capable of providing at least two programmable setback periods per day.

Each additional system provided within the sleeping unit shall be provided with at least one adjustable thermostat for the regulation of temperature.

Exceptions:

1. Systems controlled by an occupant sensor that is configured to shut the system off when no occupant is sensed for a period of up to 30 minutes.
2. Systems controlled solely by a manually operated timer configured to operate the system for no more than two hours.
3. Zones with a full HVAC load demand not exceeding 3,400 Btu/h (1 kW) and having a ~~readily accessible~~ manual shutoff switch located with ready access.
4. Ductless heat pumps.

Each thermostat shall be capable of being set by adjustment or selection of sensors as follows:

1. When used to control heating only: 55°F to 75°F;
2. When used to control cooling only: 70°F to 85°F;
3. All other: 55°F to 85°F with an adjustable deadband ~~of not less than 10°F~~ configured to at least 5°F (2.8°C) in accordance with Section C403.4.1.2.

Commented [BK(130)]
M076-2018

~~C403.2.4.12~~**C403.4.11 Direct digital control systems.** Direct digital control (DDC) shall be required as specified in Sections ~~C403.2.4.12.4~~**C403.4.11.1** through ~~C403.2.4.12.3~~**C403.4.11.3**.

C403.4.11.1 DDC applications. DDC shall be provided in the applications and qualifications listed in Table ~~C403.2.4.12.4~~**C403.4.11.1**.

C403.4.11.2 DDC controls. Where DDC is required by Section ~~C403.2.4.12.4~~**C403.4.11.1**, the DDC system shall be capable of all of the following, as required to provide the system and zone control logic required in Sections C403.2, C403.3-5, 403.6.8 and C403.4.3:

1. Monitoring zone and system demand for fan pressure, pump pressure, heating and cooling.
2. Transferring zone and system demand information from zones to air distribution system controllers and from air distribution systems to heating and cooling plant controllers.

C403.4.11.3 DDC display. Where DDC is required by Section ~~C403.2.4.12.4~~**C403.4.11.1** for new buildings, the DDC system shall be capable of trending and graphically displaying input and output points.

**TABLE ~~C403.2.4.12.4~~C403.4.11.1
DDC APPLICATIONS AND QUALIFICATIONS**

Building Status	Application	Qualifications
New Building	Air-handling system and all zones served by the system	All air-handling systems in buildings with building cooling capacity greater than 780,000 Btu/h
	Air-handling system and all zones served by the system	Individual systems supplying more than three zones and with fan system bhp of 10 hp and larger
	Chilled-water plant and all coils and terminal units served by the system	Individual plants supplying more than three zones and with design cooling capacity of 300,000 Btu/h and larger
	Hot-water plant and all coils and terminal units served by the system	Individual plants supplying more than three zones and with design heating capacity of 300,000 Btu/h and larger
Alteration or addition	Zone terminal units such as VAV box	Where existing zones served by the same air-handling, chilled-water, or hot-water system have DDC
	Air-handling system or fan coil	Where existing air-handling system(s) and fan coil(s) served by the same chilled- or hot-water plant have DDC
	New air-handling system and all new zones served by the system	Individual systems with fan system bhp 10 hp and larger and supplying more than three zones and more than 75% of zones are new
	New or upgraded chilled-water plant	Where all chillers are new and plant design cooling capacity is 300,000 Btu/h and larger
	New or upgraded hot-water plant	Where all boilers are new and plant design heating capacity is 300,000 Btu/h and larger

Commented [BK(131)]
M080-2018

~~C403.3~~**C403.5 Economizers (Prescriptive).** Air economizers shall be provided on all new cooling systems including those ~~2015-2018~~ Washington State Energy Code

serving computer server rooms, electronic equipment, radio equipment, and telephone switchgear. Economizers shall comply with Sections ~~C403.3.1~~C403.5.1 through ~~C403.3.4~~C403.5.5.

Exception: Economizers are not required for the systems listed below:

1. ~~Systems~~ Cooling systems not installed outdoors nor in a mechanical room adjacent to outdoors and installed in conjunction with DOAS complying with Section ~~C403.6~~C403.3.5 Dedicated outdoor air systems (DOAS) and serving only spaces with year-round cooling loads from lights and equipment of less than 5 watts per square foot.
2. Unitary or packaged systems serving one zone with dehumidification that affect other systems so as to increase the overall building energy consumption. New humidification equipment shall comply with Section ~~C403.2.3~~C403.3.2.5.4.
3. Unitary or packaged systems serving one zone where the cooling efficiency meets or exceeds the efficiency requirements in Table ~~C403.3.5~~.
4. ~~Water-cooled refrigeration~~ Equipment serving chilled beams and chilled ceiling space cooling systems only which are provided with a water economizer meeting the requirements of Section ~~C403.3.5.4~~.
5. ~~Systems complying with all of the following criteria:~~
 - 5.1. ~~Consist of multiple water source heat pumps connected to a common water loop.~~
 - 5.2. ~~Have a minimum of 60 percent air economizer.~~
 - 5.3. ~~Have water source heat pumps with an EER at least 15 percent higher for cooling and a COP of at least 15 percent higher for heating than that specified in Section C403.2.3.~~
 - 5.4. ~~Where provided, have a central boiler or furnace efficiency of 90 percent minimum for units up to 199,000 Btu/h.~~
 - 5.5.4.1. ~~Provide heat recovery with a minimum 50 percent heat recovery effectiveness as defined in Section C403.5 to preheat the outside air supply.~~
- 6.5. For Group R occupancies, cooling units installed outdoors or in a mechanical room adjacent to outdoors with a total cooling capacity less than 20,000 Btu/h and other cooling units with a total cooling capacity less than 54,000 Btu/h provided that these are high-efficiency cooling equipment with IEER, ~~CEER~~, SEER, and EER values more than 15 percent higher than minimum efficiencies listed in Tables ~~C403.2.3~~C403.3.2 (1) through (3), in the appropriate size category, using the same test procedures. Equipment shall be listed in the appropriate certification program to qualify for this exception. For split systems, compliance is based on the cooling capacity of individual fan coil units.
- 7.6. ~~Variable refrigerant flow (VRF) systems, multiple zone split system heat pumps, consisting of multiple, individually metered indoor units with multi-speed fan motors, served on a single common refrigeration circuit with an exterior reverse cycle heat pump with variable speed compressor(s) and variable speed condenser fan(s). These systems shall also be capable of providing simultaneous heating and cooling operation, where recovered energy from the indoor units operating in one mode can be transferred to one or more perimeter zones (as determined by conditioned floor area) and the outdoor unit shall be at least 65,000 Btu/h in total capacity. Systems utilizing this exception shall have 50 percent heat recovery effectiveness as defined by Section C403.5 on the outside air. For the purposes of this exception, dedicated server rooms, electronic equipment rooms or telecom switch rooms are not considered perimeter zones.~~
- 8.7. Equipment used to cool *Controlled Plant Growth Environments* provided these are high-efficiency cooling equipment with SEER, EER and IEER values a minimum of 20 percent greater than the values listed in Tables ~~C403.2.3~~C403.3.2 (1), (3) and (7).
8. ~~Equipment used to cool any spaces with year-round cooling loads from lights and equipment of greater than 5 watts per square foot, where it can be demonstrated through calculations, to the satisfaction of the code official, that the heat rejection load of the equipment will be recovered and used for on-site space heating or service water heating demands such that the energy use of the building is decreased in comparison to a baseline of the same equipment provided with an air economizer complying with Section C403.3~~ Equipment serving a space with year-round cooling loads from lights and equipment of 5 watts per square foot or greater complying with the following criteria:
 - 8.1. Equipment serving the space utilizes chilled water as the cooling source; and
 - 8.2. The chilled water plant includes a condenser heat recovery system that meets the requirements of Section C403.9.5 or the building and water-cooled system meets the following requirements:
 - 8.2.1. A minimum of 90% (capacity-weighted) of the building space heat is provided by hydronic heating water.

Commented [BK(132)]
M080-2018

Commented [BK(133)]
M079-2018

Commented [BK(134)]
M079-2018

8.1.1-8.2.2. Chilled water plant includes a heat recovery chiller or water-wo-water heat pump capable of rejecting heat from the chilled water system to the hydronic heating equipment capacity.

9. Water-cooled equipment served by systems meeting the requirements of C403.9.8, Condenser heat recovery.

10. Equipment used to cool any dedicated server room, electronic equipment room or telecom switch room provided the system complies with Option a, b or c in the table below. The total cooling capacity of all fan systems without economizers shall not exceed 240,000 Btu/h per building or 10 percent of its air economizer capacity, whichever is greater. This exception shall not be used for Total Building Performance.

Commented [BK(135)]
M078-2018

Commented [BK(136)]
M099-2018

Commented [BK(137)]
M079-2018

	Equipment Type	Higher Equipment Efficiency	Part-Load Control	Economizer
Option a	Tables C403.2.3C403.3.2 (1) and C403.2.3C403.3.2 (2) ^a	+15% ^b	Required over 85,000 Btu/h ^c	None Required
Option b	Tables C403.2.3C403.3.2 (1) and C403.2.3C403.3.2 (2) ^a	+5% ^d	Required over 85,000 Btu/h ^c	Waterside Economizer
Option c	ASHRAE Standard 127 ^f	+0% ^g	Required over 85,000 Btu/h ^c	Waterside Economizer

Notes for Exception 10:

1-a. For a system where all of the cooling equipment is subject to the AHRI standards listed in Tables ~~C403.2.3C403.3.2~~(1) and ~~C403.2.3C403.3.2~~(2), the system shall comply with all of the following (note that if the system contains any cooling equipment that exceeds the capacity limits in Table ~~C403.2.3C403.3.2~~(1) or ~~C403.2.3C403.3.2~~(2), or if the system contains any cooling equipment that is not included in Table ~~C403.2.3C403.3.2~~(1) or ~~C403.2.3C403.3.2~~(2), then the system is not allowed to use this option).

2-b. The cooling equipment shall have an EER value and an IPLV value that is a minimum of 15 percent greater than the value listed in Tables ~~C403.2.3C403.3.2~~(1) and ~~C403.2.3C403.3.2~~(2).

3-c. For units with a total cooling capacity over 85,000 Btu/h, the system shall utilize part-load capacity control schemes that are able to modulate to a part-load capacity of 50 percent of the load or less that results in the compressor operating at the same or higher EER at part loads than at full load (e.g., minimum of two-stages of compressor unloading such as cylinder unloading, two-stage scrolls, dual tandem scrolls, but hot gas bypass is not credited as a compressor unloading system).

4-d. The cooling equipment shall have an EER value and an IPLV value that is a minimum of 5 percent greater than the value listed in Tables ~~C403.2.3C403.3.2~~(1) and ~~C403.2.3C403.3.2~~(2).

5-e. The system shall include a water economizer in lieu of air economizer. Water economizers shall meet the requirements of Sections C403.35.1 and C403.35.2 and be capable of providing the total concurrent cooling load served by the connected terminal equipment lacking airside economizer, at outside air temperatures of 50°F dry-bulb/45°F wet-bulb and below. For this calculation, all factors including solar and internal load shall be the same as those used for peak load calculations, except for the outside temperatures. The equipment shall be served by a dedicated condenser water system unless a nondedicated condenser water system exists that can provide appropriate water temperatures during hours when waterside economizer cooling is available.

6-f. For a system where all cooling equipment is subject to ASHRAE Standard 127.

7-g. The cooling equipment subject to ASHRAE Standard 127 shall have an EER value and an IPLV value that is equal or greater than the value listed in Tables ~~C403.2.3C403.3.2~~(1) and ~~C403.2.3C403.3.2~~(2) when determined in accordance with the rating conditions in ASHRAE Standard 127 (i.e., not the rating conditions in AHRI Standard 210/240 or 340/360). This information shall be provided by an independent third party.

TABLE ~~C403.3C403.5~~
EQUIPMENT EFFICIENCY PERFORMANCE EXCEPTION FOR ECONOMIZERS

Climate Zone	Efficiency Improvement ^a
4C	64%

5B	59%
----	-----

~~4.a.~~ If a unit is rated with an IPLV, IEER or SEER then to eliminate the required air or water economizer, the minimum cooling efficiency of the HVAC unit must be increased by the percentage shown. If the HVAC unit is only rated with a full load metric like EER or COP cooling, then these must be increased by the percentage shown.

~~C403.3.1~~**C403.5.1 Integrated economizer control.** Economizer systems shall be integrated with the mechanical cooling system and be configured to provide partial cooling even where additional mechanical cooling is required to provide the remainder of the cooling load. Controls shall not be capable of creating a false load in the mechanical cooling system by limiting or disabling the economizer or any other means, such as hot gas bypass, except at the lowest stage of mechanical cooling.

Units that include an air economizer shall comply with the following:

1. Unit controls shall have the mechanical cooling capacity control interlocked with the air economizer controls such that the outdoor air damper is at the 100 percent open position when mechanical cooling is on and the outdoor air damper does not begin to close to prevent coil freezing due to minimum compressor run time until the leaving air temperature is less than 45°F (7°C).
2. Direct expansion (DX) units with cooling capacity 65,000 Btu/H (19 kW) or greater of rated capacity shall comply with the following:
 - ~~a.2.1.~~ DX units that control the capacity of the mechanical cooling directly based on occupied space temperature shall have not fewer than two stages of mechanical cooling capacity.
 - ~~b.2.2.~~ Other DX units, including those that control space temperature by modulating the airflow to the space, shall be in accordance with Table ~~C403.3.1~~**C403.5.1**.

~~C403.3.2~~**C403.5.2 Economizer heating system impact.** HVAC system design and economizer controls shall be such that economizer operation does not increase building heating energy use during normal operation.

Exception: Economizers on VAV systems that cause *zone* level heating to increase due to a reduction in supply air temperature.

~~C403.3.3~~**C403.5.3. Air economizers.** Air economizers shall comply with Sections ~~C403.3.3.1~~**C403.5.3.1** through ~~C403.3.3.5~~**C403.5.3.5**.

~~C403.3.3.1~~**C403.5.3.1 Design capacity.** Air economizer systems shall be configured to modulate *outdoor air* and return air dampers to provide up to 100 percent of the design supply air quantity as *outdoor air* for cooling.

~~C403.3.3.2~~**C403.5.3.2 Control signal.** Economizer controls and dampers shall be configured to sequence the dampers with mechanical cooling equipment and shall not be controlled by only mixed air temperature. Air economizers on systems with cooling capacity greater than 65,000 Btu/h shall be configured to provide partial cooling even when additional mechanical cooling is required to meet the remainder of the cooling load.

Exception: The use of mixed air temperature limit control shall be permitted for systems that are both controlled from space temperature (such as single *zone* systems) and having cooling capacity less than 65,000 Btu/h.

~~C403.3.3.3~~**C403.5.3.3 High-limit shutoff.** Air economizers shall be configured to automatically reduce *outdoor air* intake to the design minimum outdoor air quantity when outdoor air intake will no longer reduce cooling energy usage. High-limit shutoff control types for specific climates shall be chosen from Table ~~C403.3.3.3~~**C403.5.3.3**. High-limit shutoff control settings for these control types shall be those specified in Table ~~C403.3.3.3~~**C403.5.3.3**.

~~C403.3.3.4~~**C403.5.3.4 Relief of excess outdoor air.** Systems shall be capable of relieving excess *outdoor air* during air economizer operation to prevent over-pressurizing the building. The relief air outlet shall be located to avoid recirculation into the building.

~~C403.3.3.5~~**C403.5.3.5 Economizer dampers.** Return, exhaust/relief and outdoor air dampers used in economizers shall comply with Section ~~C403.2.4.3~~**C403.7.9**

TABLE ~~C403.3.1~~C403.5.1****
DX COOLING STAGE REQUIREMENTS FOR MODULATING AIRFLOW UNITS

Rating Capacity	Minimum Number of Mechanical Cooling Stages	Minimum Compressor Displacement ^a
≥ 65,000 Btu/h and < 240,000 Btu/h	3 stages	≤ 35% of full load

$\geq 240,000$ Btu/h	4 stages	$\leq 25\%$ of full load
----------------------	----------	--------------------------

- a. For *mechanical cooling* stage control that does not use variable compressor displacement, the percent displacement shall be equivalent to the mechanical cooling capacity reduction evaluated at the full load rating conditions for the compressor.

**TABLE ~~C403.3.3~~C403.5.3.3
HIGH-LIMIT SHUTOFF CONTROL SETTING FOR AIR ECONOMIZERS^b**

DEVICE TYPE	CLIMATE ZONE	REQUIRED HIGH LIMIT (ECONOMIZER OFF WHEN):		REQUIRED HIGH LIMIT FOR CYCLING FANS ^c (ECONOMIZER OFF WHEN):	
		EQUATION	DESCRIPTION	EQUATION	DESCRIPTION
Fixed dry bulb	4C, 5B	$T_{OA} > 75^{\circ}\text{F}$	Outdoor air temperature exceeds 75°F	$T_{OA} > 70^{\circ}\text{F}$	Outdoor air temperature exceeds 70°F
Differential dry bulb	4C, 5B	$T_{OA} > T_{RA}$	Outdoor air temperature exceeds return air temperature	$T_{OA} > (T_{RA} - 5)$	Outdoor air temperature exceeds return air temperature - 5°F
Fixed enthalpy with fixed dry-bulb temperatures	All	$h_{OA} > 28$ Btu/lb ^a or $T_{OA} > 75^{\circ}\text{F}$	Outdoor air enthalpy exceeds 28 Btu/lb of dry air ^a or outdoor temperature exceeds 75°F	$h_{OA} > 26$ Btu/lb ^a or $T_{OA} > 70^{\circ}\text{F}$	Outdoor air enthalpy exceeds 26 Btu/lb of dry air ^d or outdoor temperature exceeds 70°F
Differential enthalpy with fixed dry-bulb temperatures	All	$h_{OA} > H_{RA}$ or $T_{OA} > 75^{\circ}\text{F}$	Outdoor air enthalpy exceeds return air enthalpy or outdoor temperature exceeds 75°F	$h_{OA} > (H_{RA} - 2)$ or $T_{OA} > 70^{\circ}\text{F}$	Outdoor air enthalpy exceeds return air enthalpy or outdoor temperature exceeds 70°F

Commented [BK(138)]:
M081-2018

For SI: °C = (°F - 32) × 5/9, 1 Btu/lb = 2.33 kJ/kg.

~~1-a.~~ At altitudes substantially different than sea level, the Fixed Enthalpy limit shall be set to the enthalpy value at 75°F and 50-percent relative humidity. As an example, at approximately 6,000 feet elevation the fixed enthalpy limit is approximately 30.7 Btu/lb.

~~b.~~ Devices with selectable setpoint shall be capable of being set to within 2°F and 2 Btu/lb of the setpoint listed.

~~c.~~ Where fans cycle on only to provide heating and cooling, limits are adjusted lower to compensate for fan energy use in economizer mode.

~~2-d.~~ For cycling fans, at altitudes substantially different than sea level, the fixed enthalpy limit shall be set to the enthalpy value at 70°F and 50% relative humidity.

Commented [BK(139)]:
M081-2018

~~C403.3.4~~C403.5.4 **Water-side economizers.** Water-side economizers shall comply with Sections C403.~~35~~.4.1 and C403.~~35~~.4.2.

C403.~~35~~.4.1 Design capacity. Water economizer systems shall be configured to supply air by indirect evaporation and providing up to 100 percent of the expected system cooling load at *outdoor air* temperatures of not greater than 50°F dry-bulb (10°C dry-bulb)/45°F wet-bulb (7.2°C wet-bulb).

Exception: Systems in which a water economizer is used and where dehumidification requirements cannot be met using outdoor air temperatures of 50°F dry-bulb (10°C dry-bulb)/45°F wet-bulb (7.2°C wet-bulb) shall satisfy 100 percent of the expected system cooling load at 45°F dry-bulb (7.2°C dry-bulb)/40°F wet-bulb (4.5°C wet-bulb).

C403.~~35~~.4.2 Maximum pressure drop. Precooling coils and water-to-water heat exchangers used as part of a water economizer system shall either have a waterside pressure drop of less than 15 feet (4572 mm) of water or a secondary loop shall be created so that the coil or heat exchanger pressure drop is not seen by the circulating pumps when the system is in the normal cooling (noneconomizer) mode.

~~C403.2.4.7~~C403.5.5 **Economizer fault detection and diagnostics (FDD).** Air-cooled unitary direct-expansion units with a cooling capacity of 54,000 Btu/h or greater listed in Tables ~~C403.2.3~~C403.3.2(1) through ~~C403.2.3~~C403.3.2(3) that are equipped with an economizer in accordance with Section C403.5 shall include a fault detection and diagnostics (FDD) system complying with the following:

1. The following temperature sensors shall be permanently installed to monitor system operation:
 - 1.1. Outside air.
 - 1.2. Supply air.
 - 1.3. Return air.

2. Temperature sensors shall have an accuracy of $\pm 2^{\circ}\text{F}$ (1.1°C) over the range of 40°F to 80°F (4°C to 26.7°C).
3. Refrigerant pressure sensors, where used, shall have an accuracy of ± 3 percent of full scale.
4. The unit controller shall be configured to provide system status by indicating the following:
 - ~~a-4.1.~~ Free cooling available.
 - ~~b-4.2.~~ Economizer enabled.
 - ~~c-4.3.~~ Compressor enabled.
 - ~~d-4.4.~~ Heating enabled.
 - ~~e-4.5.~~ Mixed air low limit cycle active.
 - ~~f-4.6.~~ The current value of each sensor.
5. The unit controller shall be capable of manually initiating each operating mode so that the operation of compressors, economizers, fans and the heating system can be independently tested and verified.
6. The unit shall be configured to report faults to a fault management application ~~accessible available for access~~ by day-to-day operating or service personnel or annunciated locally on zone thermostats.
7. The FDD system shall be configured to detect the following faults:
 - ~~a-7.1.~~ Air temperature sensor failure/fault.
 - ~~b-7.2.~~ Not economizing when the unit should be economizing.
 - ~~c-7.3.~~ Economizing when the unit should not be economizing.
 - ~~d-7.4.~~ Damper not modulating.
 - ~~e-7.5.~~ Excess outdoor air.

C403.4.4C403.6 Requirements for mechanical systems serving multiple zones. Sections ~~C403.4.4.4~~C403.6.1 through C403.4.4.4-C403.6.10 shall apply to mechanical systems serving multiple zones.

C403.6.1 Variable air volume (VAV) and multiple zone systems. Supply air systems serving multiple zones shall be VAV systems that have zone controls which, during periods of occupancy, are designed and configured to reduce the volume of primary air supply that is reheated, recooled or mixed in to each zone to one of the following ~~before reheating, recooling or mixing takes place:~~

1. ~~Twenty percent of the zone design peak supply for systems with DDC and~~ thirty percent of the maximum supply air ~~to each zone for other systems.~~
2. ~~Three hundred cfm (142 L/s) or less where the maximum flow rate is less than 10 percent of the total fan system supply airflow rate.~~ Systems with DDC where items 2.1 through 2.3 apply.
 - 2.1 ~~The airflow rate in the dead band between heating and cooling does not exceed 20 percent of the zone design peak supply rate or higher allowed rates under items 3, 4 or 5 of this section.~~
 - 2.2 ~~The first stage of heating modulates the zone supply air temperature setpoint up to a maximum setpoint while the airflow is maintained at the dead band flow rate.~~
 - ~~1-1-2.3~~ 2.3 ~~The second stage of heating modulates the airflow rate from the dead band flow rate up to the heating maximum flow rate that is less than 50 percent of the zone design peak supply rate.~~
- ~~2-3.~~ 3. ~~The outdoor airflow rate required to meet the~~ minimum ventilation requirements of Chapter 4 of the *International Mechanical Code*.
- ~~3-4.~~ 4. Any higher rate that can be demonstrated to reduce overall system annual energy use by offsetting reheat/recool energy losses through a reduction in outdoor air intake for the system; as *approved* by the code official.
- ~~4-5.~~ 5. The airflow rate required to comply with applicable codes or accreditation standards; such as pressure relationships or minimum air change rates.

Exception: The following individual zones or ~~define where individual zones or where~~ entire air distribution systems are exempted from the requirement for VAV control:

1. ~~Zones or supply air systems where at least not less than~~ 75 percent of the energy for reheating or for providing warm air in mixing systems is provided from a site-recovered source, including condenser heat, or site solar energy source.
- ~~1-2.~~ 2. ~~Systems that prevent reheating, recooling, mixing or simultaneous supply of air that has been previously cooled, either mechanically or through the use of economizer systems, and air that has been previously mechanically heated.~~
2. ~~Zones where special humidity levels are required to satisfy process needs.~~
3. ~~Zones with a peak supply air quantity of 300 cfm (142 L/s) or less and where the flow rate is less than 10 percent of the total fan system supply airflow rate.~~
4. ~~Zones without DDC for which the volume of air that is reheated, recooled or remixed is less than the larger of~~

Commented [BK(140)]
G004-2018

Commented [BK(141)]
G004-2018

the following:

- a. ~~30 percent of the zone design peak supply rate.~~
- b. ~~The outdoor airflow rate required to meet the ventilation requirements of Chapter 4 of the *International Mechanical Code* for the zone.~~
- c. ~~Any higher rate that can be demonstrated, to the satisfaction of the code official, to reduce overall system annual energy usage by offsetting reheat/recool energy losses through a reduction in outdoor air intake for the system.~~
- d. ~~The airflow rate required to comply with applicable codes or accreditation standards, such as pressure relationships or minimum air change rates.~~

5. ~~Zones with DDC that comply with all of the following:~~

- a. ~~The airflow rate in dead band between heating and cooling does not exceed the larger of the following:~~
 - i. ~~20 percent of the zone design peak supply rate.~~
 - ii. ~~The outdoor airflow rate required to meet the ventilation requirements of Chapter 4 of the *International Mechanical Code* for the zone.~~
 - iii. ~~Any higher rate that can be demonstrated, to the satisfaction of the code official, to reduce overall system annual energy usage by offsetting reheat/recool energy losses through a reduction in outdoor air intake for the system.~~
 - iv. ~~The airflow rate required to comply with applicable codes or accreditation standards, such as pressure relationships or minimum air change rates.~~
- b. ~~The airflow rate that is reheated, recoolled or mixed shall be less than 50 percent of the zone design peak supply rate.~~
- c. ~~The first stage of heating consists of modulating the zone supply air temperature setpoint up to a maximum setpoint while the airflow is maintained at the dead band flow rate.~~
- d. ~~The second stage of heating consists of modulating the airflow rate from the dead band flow rate up to the heating maximum flow rate.~~

6.3. ~~Zones or supply air systems with thermostatic and humidistatic controls capable of operating in sequence the supply of heating and cooling energy to the zones and which are configured to prevent reheating, recooling, mixing or simultaneous supply of air that has been previously cooled, either mechanically or through the use of economizer systems, and air that has been previously mechanically heated. Ventilation systems complying with Section C403.3.5 DOAS, with ventilation rates complying with Section C403.2.2.~~

Commented [BK(142)]
M082-2018

C403.4.4.1C403.6.2 Single duct variable air volume (VAV) systems, terminal devices. Single duct VAV systems shall use terminal devices capable of and configured to reduce the supply of primary supply air before reheating or recooling takes place.

C403.4.4.2C403.6.3 Dual duct and mixing VAV systems, terminal devices. Systems that have one warm air duct and one cool air duct shall use terminal devices which are capable of and configured to reduce the flow from one duct to a minimum before mixing of air from the other duct takes place.

C403.4.4.4C403.6.4 Supply-air temperature reset controls. Multiple zone HVAC systems shall include controls that automatically reset the supply-air temperature in response to representative building loads, or to outdoor air temperature. The controls shall be ~~capable of resetting~~ configured to reset the supply air temperature at least 25 percent of the difference between the design supply-air temperature and the design room air temperature.

Exceptions:

1. Systems that prevent reheating, recooling or mixing of heated and cooled supply air.
2. Seventy-five percent of the energy for reheating is from ~~a site-recovered or site solar energy source~~ source.
3. Zones with peak supply air quantities of 300 cfm (142 L/s) or less.

Commented [BK(143)]
G004-2018

C403.4.4.3C403.6.5 Multiple-zone VAV system ventilation optimization controls. Multiple-zone VAV systems with direct digital control of individual zone boxes reporting to a central control panel shall have automatic controls configured to reduce outdoor air intake flow below design rates in response to changes in system ventilation efficiency (Ev) as defined by the *International Mechanical Code*.

Exceptions:

1. VAV systems with zonal transfer fans that recirculate air from other zones without directly mixing it with outdoor air, dual-duct dual-fan VAV systems, and VAV systems with fan-powered terminal units.

~~2. Systems having exhaust air energy recovery complying with Section C403.5.~~

~~3.2.~~ Systems where total design exhaust airflow is more than 70 percent of total design outdoor air intake flow requirements.

C403.6.6 Parallel-flow fan-powered VAV air terminal control. Parallel-flow fan-powered VAV air terminals shall have automatic controls configured to:

1. Turn off the terminal fan except when space heating is required or where required for ventilation.
2. Turn on the terminal fan as the first stage of heating before the heating coil is activated.
3. During heating for warmup or setback temperature control, either:
 - 3.1. Operate the terminal fan and heating coil without primary air.
 - 3.2. Reverse the terminal damper logic and provide heating from the central air handler by primary air.

~~C403.4~~**C403.6.7 Hydronic and multiple-zone HVAC system controls and equipment (Prescriptive).** Hydronic and multiple-zone HVAC system controls and equipment shall comply with this section.

For buildings with a total equipment cooling capacity of 300 tons and above, the equipment shall comply with one of the following:

- a.1. No one unit shall have a cooling capacity of more than 2/3 of the total installed cooling equipment capacity.
- b.2. The equipment shall have a variable speed drive.
- e.3. The equipment shall have multiple compressors.

~~C403.4.1 Multiple-zone system fan control.~~ Controls shall be provided for fans in accordance with Sections C403.4.1.1 through C403.4.1.2.

~~C403.4.1.2~~**C403.6.8 Set points for direct digital control.** For systems with direct digital control of individual zones reporting to the central control panel, the static pressure setpoint shall be reset based on the zone requiring the most pressure. In such cases, the set point is reset lower until one zone damper is nearly wide open. The direct digital controls shall be capable of monitoring zone damper positions or shall have an alternative method of indicating the need for static pressure that is configured to provide all of the following:

1. Automatically detecting any zone that excessively drives the reset logic.
2. Generating an alarm to the system operational location.
3. Allowing an operator to readily remove one or more zones from the reset algorithm.

~~C403.4.1.1~~**C403.6.9 Static pressure sensor location.** Static pressure sensors used to control VAV fans shall be located such that the controller setpoint is no greater than 1.2 inches w.c. (299 Pa). Where this results in one or more sensors being located downstream of major duct splits, not less than one sensor shall be located on each major branch to ensure that static pressure can be maintained in each branch.

Exception: Systems complying with Section ~~C403.4.1.2~~**C403.6.8.**

~~C403.7~~**C403.6.10 High efficiency variable air volume (VAV) systems.** For HVAC systems subject to the requirements of Section ~~C403.6~~**C403.3.5** but utilizing Exception 2 of that section, a high efficiency multiple-zone VAV system may be provided without a separate parallel DOAS when the system is designed, installed, and configured to comply with all of the following criteria (this exception shall not be used as a substitution for a DOAS per Section C406.6 ~~or as a modification to the requirements for the Standard Reference Design per Section C407~~):

1. Each VAV system must serve a minimum of 3,000 square feet (278.7 m²) and have a minimum of five VAV zones.
- ~~1.2.~~ The VAV systems are provided with airside economizer per Section ~~403.3~~**C403.5** without exceptions.
- ~~2.3.~~ A direct-digital control (DDC) system is provided to control the VAV air handling units and associated terminal units per Section ~~C403.2.4.12~~**C403.4.11** regardless of sizing thresholds of Table ~~C403.2.4.12.1~~**C403.4.11.1**.
- ~~3.4.~~ Multiple-zone VAV systems with a minimum outdoor air requirement of 2,500 cfm (1180 L/s) or greater shall be equipped with a device capable of measuring outdoor airflow intake under all load conditions. The system shall be capable of increasing or reducing the outdoor airflow intake based on feedback from the VAV terminal units as required by Section ~~C403.4.4.3~~**C403.6.5**, without exceptions, and Section ~~C403.2.6.2~~**C403.7.1** demand controlled ventilation.
- ~~4.5.~~ Multiple-zone VAV systems with a minimum outdoor air requirement of 2,500 cfm (1180 L/s) or greater shall be equipped with a device capable of measuring supply airflow to the VAV terminal units under all load conditions.
- ~~5.6.~~ In addition to meeting the zone isolation requirements of ~~C403.2.4.4~~**C403.2.1** a single VAV air handling unit shall not serve more than 50,000 square feet (~~2323-4645~~ m²) unless a single floor is greater than 50,000 square feet (~~2323-4645~~ m²) in which case the air handler is permitted to serve the entire floor.

Commented [BK(144)]:
M083-2018

Commented [BK(145)]:
P141-2018

Commented [BK(146)]:
M083-2018

~~6.7.~~ The primary maximum cooling air for the VAV terminal units serving interior cooling load driven zones shall be sized for a supply air temperature that is a minimum of 5°F greater than the supply air temperature for the exterior zones in cooling.

~~7.8.~~ Air terminal units with a minimum primary airflow setpoint of 50% or greater of the maximum primary airflow setpoint shall be sized with an inlet velocity of no greater than 900 feet per minute.

~~8.~~ ~~DDC systems be designed and configured per the guidelines set by High Performance Sequences of Operation for HVAC Systems (ASHRAE GPC 36, RP 1455).~~

9. Allowable fan motor horsepower shall not exceed 90% of the allowable HVAC fan system bhp (Option 2) as defined by Section ~~C403.2.11.1~~C403.8.1.1.

10. All fan powered VAV terminal units (series or parallel) shall be provided with electronically commutated motors. The DDC system shall be configured to vary the speed of the motor as a function of the heating and cooling load in the space. Minimum speed shall not be greater than 66 percent of design airflow required for the greater of heating or cooling operation. Minimum speed shall be used during periods of low heating and cooling operation and ventilation-only operation.

Exception: For series fan powered terminal units where the volume of primary air required to deliver the ventilation requirements at minimum speed exceeds the air that would be delivered at the speed defined above, the minimum speed setpoint shall be configured to exceed the value required to provide the required ventilation air.

~~11.~~ Fan-powered VAV terminal units shall only be permitted at perimeter zones with an envelope heating load requirement. All other VAV terminal units shall be single duct terminal units.

Exception: Fan powered VAV terminal units are allowed at interior spaces with an occupant load greater than or equal to 25 people per 1000 square feet of floor area (as established in Table 403.3.1.1 of the *International Mechanical Code*) with demand control ventilation in accordance with Section C403.7.1.

~~11.12.~~ When in occupied heating or in occupied deadband between heating and cooling all fan powered VAV terminal units shall be configured to reset the primary air supply setpoint, based on the VAV air handling unit outdoor air vent fraction, to the minimum ventilation airflow required per *International Mechanical Code* without utilizing exceptions 2, 3, or 4 of Section ~~C403.4.4~~C403.6.1.

~~12.13.~~ Spaces that are larger than 150 square feet (14 m²) and with an occupant load greater than or equal to 25 people per 1000 square feet (93 m²) of floor area (as established in Table 403.3.1.1 of the *International Mechanical Code*) shall be provided with all of the following features:

~~a.13.1.~~ A dedicated VAV terminal unit capable of controlling the space temperature and minimum ventilation shall be provided.

~~b.13.2.~~ Demand control ventilation (DCV) shall be provided that utilizes a carbon dioxide sensor to reset the ventilation setpoint of the VAV terminal unit from the design minimum to design maximum ventilation rate as required by Chapter 4 of the *International Mechanical Code*.

~~c.13.3.~~ Occupancy sensors shall be provided that are configured to reduce the minimum ventilation rate to zero and setback room temperature setpoints by a minimum of 5°F, for both cooling and heating, when the space is unoccupied.

~~13.14.~~ Dedicated server rooms, electronic equipment rooms, telecom rooms, or other similar spaces with cooling loads greater than 5 watts/ft² shall be provided with separate, independent HVAC systems to allow the VAV air handlers to turn off during unoccupied hours in the office space and to allow the supply air temperature reset to occur.

Exception: The VAV air handling unit and VAV terminal units may be used for secondary backup cooling when there is a failure of the primary HVAC system.

Additionally, server rooms, electronic equipment rooms, telecom rooms, or other similar spaces shall be provided with airside economizer per Section ~~403.3~~C403.5 without using the exceptions to Section ~~C403.3~~C403.5.

Exception: Heat recovery per exception 9 of Section ~~403.3~~C403.5 may be in lieu of airside economizer for the separate, independent HVAC system.

~~14.15.~~ HVAC system central heating or cooling plant will include a minimum of one of the following options:

~~a.15.1.~~ VAV terminal units with hydronic heating coils connected to systems with hot water generation equipment limited to the following types of equipment: gas-fired hydronic boilers with a thermal efficiency, E_t, of not less than ~~90-92~~ percent, air-to-water heat pumps or heat recovery chillers. Hydronic heating coils shall be sized for a maximum entering hot water temperature of 120°F (48.9°C) for peak anticipated heating load conditions.

~~b.15.2.~~ Chilled water VAV air handling units connected to systems with chilled water generation equipment with IPLV values more than 25 percent higher than the minimum part load efficiencies listed in Table

Commented [BK(147)]
M083-2018

Commented [BK(148)]
M083-2018

Commented [BK(149)]
M083-2018

Commented [BK(150)]
M083-2018

~~C403.2.3~~C403.3.2(7), in the appropriate size category, using the same test procedures. Equipment shall be listed in the appropriate certification program to qualify. The smallest chiller or compressor in the central plant shall not exceed 20% of the total central plant cooling capacity or the chilled water system shall include thermal storage sized for a minimum of 20% of the total central cooling plant capacity.

~~15.16.~~ The DDC system shall include a fault detection and diagnostics (FDD) system complying with the following:

~~a.16.1.~~ The following temperature sensors shall be permanently installed to monitor system operation:

~~i.16.1.1.~~ Outside air.

~~ii.16.1.2.~~ Supply air.

~~iii.16.1.3.~~ Return air.

~~b.16.2.~~ Temperature sensors shall have an accuracy of $\pm 2^{\circ}\text{F}$ (1.1°C) over the range of 40°F to 80°F (4°C to 26.7°C).

~~c.16.3.~~ The VAV air handling unit controller shall be configured to provide system status by indicating the following:

~~i.16.3.1.~~ Free cooling available.

~~ii.16.3.2.~~ Economizer enabled.

~~iii.16.3.3.~~ Compressor enabled.

~~iv.16.3.4.~~ Heating enabled.

~~v.16.3.5.~~ Mixed air low limit cycle active.

~~vi.16.3.6.~~ The current value of each sensor.

~~d.16.4.~~ The VAV air handling unit controller shall be capable of manually initiating each operating mode so that the operation of compressors, economizers, fans and the heating system can be independently tested and verified.

~~e.16.5.~~ The VAV air handling unit shall be configured to report faults to a fault management application accessible by day-to-day operating or service personnel or annunciated locally on zone thermostats.

~~f.16.6.~~ The VAV terminal unit shall be configured to report if the VAV inlet valve has failed by performing the following diagnostic check at a maximum interval of once a month:

~~i.16.6.1.~~ Command VAV terminal unit primary air inlet valve closed and verify that primary airflow goes to zero.

~~ii.16.6.2.~~ Command VAV thermal unit primary air inlet valve to design airflow and verify that unit is controlling to within 10% of design airflow.

~~g.16.7.~~ The VAV terminal unit shall be configured to report and trend when the zone is driving the following VAV air handling unit reset sequences. The building operator shall have the capability to exclude zones used in the reset sequences from the DDC control system graphical user interface:

~~i.16.7.1.~~ Supply air temperature setpoint reset to lowest supply air temperature setpoint for cooling operation.

~~ii.16.7.2.~~ Supply air duct static pressure setpoint reset for the highest duct static pressure setpoint allowable.

~~h.16.8.~~ The FDD system shall be configured to detect the following faults:

~~i.16.8.1.~~ Air temperature sensor failure/fault.

~~ii.16.8.2.~~ Not economizing when the unit should be economizing.

~~iii.16.8.3.~~ Economizing when the unit should not be economizing.

~~iv.16.8.4.~~ Outdoor air or return air damper not modulating.

~~v.16.8.5.~~ Excess outdoor air.

~~vi.16.8.6.~~ VAV terminal unit primary air valve failure.

C403.7 Ventilation and exhaust systems. In addition to other requirements of Section C403 applicable to the provisions of ventilation air or the exhaust of air, ventilation and exhaust systems shall be in accordance with Sections C403.7.1 through C403.7.8.

~~C403.2.6.2~~**C403.7.1 Demand control ventilation.** Demand control ventilation (DCV) shall be provided for spaces larger than 500 square feet (50 m^2) and with an occupant load greater than or equal to 25 people per 1000 square feet (93 m^2) of floor area (as established in Table 403.3.1.1 of the *International Mechanical Code*) and served by systems with one or more of the following:

1. An air-side economizer.
2. Automatic modulating control of the outdoor air damper.
3. A design outdoor airflow greater than 3,000 cfm (1416 L/s).

Exception: Demand control ventilation is not required for systems and spaces as follows:

1. Systems with energy recovery complying with Section ~~C403.5.4~~C403.7.6.1 or Section C403.3.5.1 (Energy recovery with DOAS).
2. Multiple-zone systems without direct digital control of individual zones communicating with a central control panel.
3. System with a design outdoor airflow less than 750 cfm (354 L/s).
4. Spaces where the supply airflow rate minus any makeup or outgoing transfer air requirement is less than 1,200 cfm (566 L/s).
5. Ventilation provided for process loads only.
6. Spaces with one of the following occupancy categories (as defined by the *International Mechanical Code*):
Correctional cells, daycare sickrooms, science labs, barbers, beauty and nail salons, and bowling alley seating.

~~C403.2.6.1~~ Reserved.

~~C403.2.6.3~~C403.7.2 Occupancy sensors. Classrooms, gyms, auditoriums, ~~and conference rooms, and other spaces with an occupant load greater than or equal to 25 people per 1000 square feet (93 m²) of floor area (as established in Table 403.3.1.1 of the *International Mechanical Code*) that are~~ larger than 500 square feet of floor area shall have occupancy sensor control that will either close outside air dampers, ~~ventilation supply dampers~~ or turn off ~~serving ventilation~~ equipment when the space is unoccupied except where equipped with another means to automatically reduce outside air intake below design rates when spaces are partially occupied.

Exceptions:

1. Spaces with one of the following occupancy categories (as defined by the *International Mechanical Code*):
 - 1.1. Correctional cells.
 - 1.2. Daycare sickrooms.
 - 1.3. Science labs.
 - 1.4. Barbers.
 - 1.5. Beauty and nail salons.
 - 1.6. Bowling alley seating.
- +2. When the space is unoccupied during occupied building hours a ventilation rate equal to or less than the zone outdoor airflow as defined in Section 403.3.1.1.1 of the *International Mechanical Code* with a zone population of zero.

C403.7.3. Ventilation air heating control. Units that provide ventilation air to multiple zones and operate in conjunction with zone heating and cooling systems shall not use heating or heat recovery to warm supply air to a temperature greater than 60°F (16°C) when representative building loads or outdoor air temperature indicate that the majority of zones require cooling.

~~C403.6 Dedicated outdoor air systems (DOAS).~~ For office, retail, education, libraries and fire stations, outdoor air shall be provided to each occupied space by a dedicated outdoor air system (DOAS) which delivers 100 percent outdoor air without requiring operation of the heating and cooling system fans for ventilation air delivery.

Exceptions:

1. ~~Occupied spaces that are not ventilated by a mechanical ventilation system and are only ventilated by a natural ventilation system per Section 402 of the *International Mechanical Code*.~~
2. ~~High efficiency variable air volume (VAV) systems complying with Section C403.7. This exception shall not be used as a substitution for a DOAS per Section C406.6 or as a modification to the requirements for the Standard Reference Design per Section C407.~~

~~C403.6.1 Energy recovery ventilation with DOAS.~~ The DOAS shall include ~~energy recovery ventilation that~~ complies with the minimum energy recovery efficiency and energy recovery bypass requirements, where applicable, of Section C403.5.1.

Exceptions:

- a. ~~Occupied spaces under the threshold of Section C403.5 with an average occupant load greater than 25 people per 1000 square feet (93 m²) of floor area (as established in Table 403.3.1.1 of the *International Mechanical Code*) that include demand control ventilation configured to reduce outdoor air by at least 50% below design minimum ventilation rates when the actual occupancy of the space served by the system is less than the design occupancy.~~
- b. ~~Systems installed for the sole purpose of providing makeup air for systems exhausting toxic, flammable, paint, or corrosive fumes or dust, dryer exhaust, or commercial kitchen hoods used for collecting and removing grease vapors and smoke.~~

Commented [BK(151)]
M084-2018

Commented [BK(152)]
m086-2018

Commented [BK(153)]
M086-2018

Commented [BK(154)]
M086-2018

Commented [BK(155)]
M087-2018

~~C403.6.2 Heating/cooling system fan controls.~~ Heating and cooling equipment fans, heating and cooling circulation pumps, and terminal unit fans shall cycle off and terminal unit primary cooling air shall be shut off when there is no call for heating or cooling in the zone.

~~Exception:~~ Fans used for heating and cooling using less than 0.12 watts per cfm may operate when space temperatures are within the setpoint deadband (Section C403.2.4.1.2) to provide destratification and air mixing in the space.

~~C403.6.3 Impracticality.~~ Where the code official determines full compliance with all of the requirements of Section C403.6.1 and C403.6.2 would be impractical, it is permissible to provide an approved alternate means of compliance that achieves a comparable level of energy efficiency. For the purposes of this section, impractical means that an HVAC system complying with Section C403.6 cannot effectively be utilized due to an unusual use or configuration of the building.

C403.7.4 Automatic control of HVAC systems serving guestrooms. In Group R-1 buildings containing more than 50 guestrooms, each guestroom shall be provided with controls complying with the provisions of Sections C403.7.4.1 and C403.7.4.2. Card key controls comply with these requirements.

C403.7.4.1 Temperature setpoint controls. Controls shall be provided on each HVAC system that are capable of and configured to automatically raise the cooling setpoint and lower the heating setpoint by not less than 4°F (2°C) from the occupant set-point within 30 minutes after the occupants have left the guestroom. The controls shall be capable of and configured to automatically raise the cooling setpoint to not lower than 80°F (27°C) and lower the heating set point to not higher than 60°F (16°C) when the guestroom is unrented or has been continuously unoccupied for over 16 hours or a networked guestroom control system indicates that the guestroom is unrented and the guestroom is unoccupied for more than 30 minutes. A networked guestroom control system that is capable of returning the thermostat setpoints to default occupied setpoints 60 minutes prior to the time a guestroom is scheduled to be occupied is not precluded by this section. Cooling that is capable of limiting relative humidity with a setpoint not lower than 65 percent Relative Humidity during unoccupied periods is not precluded by this section

C403.7.4.2 Ventilation controls. Controls shall be provided on each HVAC system that are capable of and configured to automatically turn off the ventilation and exhaust fans within 30 minutes of the occupants leaving the guestroom or isolation devices shall be provided to each guestroom that are capable of automatically shutting off the supply of outdoor air to and exhaust air from the guestroom.

Exception: Guestroom ventilation systems are not precluded from having an automatic daily pre-occupancy purge cycle that provides daily outdoor air ventilation during unrented periods at the design ventilation rate for 60 minutes, or at a rate and duration equivalent to one air change.

~~C403.2.6.4~~C403.7.5 Enclosed loading dock and parking garage exhaust ventilation system controls. Mechanical ventilation systems for enclosed loading docks and parking garages shall be designed to exhaust the airflow rates (maximum and minimum) determined in accordance with the *International Mechanical Code*.

Ventilation systems shall be equipped with a control device that operates the system automatically by means of carbon monoxide detectors applied in conjunction with nitrogen dioxide detectors. Controllers shall be configured to shut off fans or modulate fan speed to 50 percent or less of design capacity, or intermittently operate fans less than 20 percent of the occupied time or as required to maintain acceptable contaminant levels in accordance with the *International Mechanical Code* provisions.

Gas sensor controllers used to activate the exhaust ventilation system shall stage or modulate fan speed upon detection of specified gas levels. All equipment used in sensor controlled systems shall be designed for the specific use and installed in accordance with the manufacturer's recommendations. The system shall be arranged to operate automatically by means of carbon monoxide detectors applied in conjunction with nitrogen dioxide detectors. Garage and loading docks shall be equipped with a controller and a full array of carbon monoxide (CO) sensors set to maintain levels of carbon monoxide below 35 parts per million (ppm). Additionally, a full array of nitrogen dioxide detectors shall be connected to the controller set to maintain the nitrogen dioxide level below the OSHA standard for eight hour exposure.

Spacing and location of the sensors shall be installed in accordance with manufacturer recommendations.

~~C403.2.6.4.1~~C403.7.5.1 System activation devices for enclosed loading docks. Ventilation systems for enclosed loading docks shall be activated by one of the following:

1. Gas sensors installed in accordance with the *International Mechanical Code*; or
2. Occupant detection sensors used to activate the system that detects entry into the loading area along both the vehicle and pedestrian pathways.

~~C403.2.6.4.2~~C403.7.5.2 System activation devices for enclosed parking garages. Ventilation systems for enclosed

parking garages shall be activated by gas sensors.

Exception: A parking garage ventilation system having a total design capacity under 8,000 cfm may use occupant sensors.

C403.7.6 Reserved.

C403.5-C403.7.7 Energy recovery.

C403.5.4-C403.7.7.1 Energy recovery ventilation systems. Any system with minimum outside air requirements at design conditions greater than 5,000 cfm or any system where the system's supply airflow rate exceeds the value listed in Tables ~~C403.5.4-C403.7.7.1~~(1) and ~~C403.5.4-C403.7.7.2~~(2), based on the climate zone and percentage of outdoor airflow rate at design conditions, shall include an energy recovery system. Table ~~C403.5.4-C403.7.7.1~~(1) shall be used for all ventilation systems that operate less than 8,000 hours per year, and Table ~~C403.5.4-C403.7.7.1~~(2) shall be used for all ventilation systems that operate 8,000 hours or more per year. The energy recovery system shall have the capability to provide a change in the enthalpy of the outdoor air supply of not less than 50 percent of the difference between the outdoor air and return air enthalpies, at design conditions. Where an air economizer is required, the energy recovery system shall include a bypass or controls which permit operation of the economizer as required by Section ~~C403.3-C403.5~~. Where a single room or space is supplied by multiple units, the aggregate ventilation (cfm) of those units shall be used in applying this requirement. The return/exhaust air stream temperature for heat recovery device selection shall be 70°F (21°C) at 30 percent relative humidity, or as calculated by the registered design professional.

Exception: An energy recovery ventilation system shall not be required in any of the following conditions:

1. Where energy recovery systems are restricted per Section 514 of the *International Mechanical Code* to sensible energy, recovery shall comply with one of the following:
 - 1.1. Kitchen exhaust systems where they comply with Section C403.2.76.1.
 - 1.2. Laboratory fume hood systems where they comply with Exception 2 of Section C403.5.1.
 - 1.3. Other sensible energy recovery systems with the capability to provide a change in dry bulb temperature of the outdoor air supply of not less than 50 percent of the difference between the outdoor air and the return air dry bulb temperatures, at design conditions.
2. Laboratory fume hood systems that include at least one of the following features and also comply with Section C403.2.7.2:
 - 2.1. Variable-air-volume hood exhaust and room supply systems capable of reducing exhaust and makeup air volume to 50 percent or less of design values.
 - 2.2. Direct makeup (auxiliary) air supply equal to at least 75 percent of the exhaust rate, heated no warmer than 2°F (1.1°C) above room setpoint, cooled to no cooler than 3°F (1.7°C) below room setpoint, no humidification added, and no simultaneous heating and cooling used for dehumidification control.
3. Systems serving spaces that are heated to less than 60°F (15.5°C) and are not cooled.
4. Where more than 60 percent of the outdoor ~~air~~ heating energy is provided from site-recovered ~~or site solar~~ energy.
5. Systems exhausting toxic, flammable, paint or corrosive fumes or dust.
6. Cooling energy recovery in Climate Zones 3C, 4C, 5B, 5C, 6B, 7 and 8.
7. Systems requiring dehumidification that employ energy recovery in series with the cooling coil.
8. Multi-zone systems where the supply airflow rate is less than the values specified in Tables ~~C403.5.4-C403.7.7.1~~(1) and ~~C403.5.4-C403.7.7.1~~(2) for the corresponding percent of outdoor air. Where a value of NR is listed, energy recovery shall not be required.
- 8-9. ~~Equipment which meets the requirements of C403.9.8. Condenser heat recovery.~~
- 9-10. Systems serving Group R dwelling or sleeping units where the largest source of air exhausted at a single location at the building exterior is less than 25 percent of the design outdoor air flow rate.

Commented [BK(156)]
G004-2018

Commented [BK(157)]
M099-2018

TABLE ~~C403.5.4-C403.7.7.1~~(1)
ENERGY RECOVERY REQUIREMENT
(VENTILATION SYSTEMS OPERATING LESS THAN 8,000 HOURS PER YEAR)

CLIMATE ZONE	PERCENT (%) OUTDOOR AIR AT FULL DESIGN AIRFLOW RATE							
	≥ 10% and < 20%	≥ 20% and < 30%	≥ 30% and < 40%	≥ 40% and < 50%	≥ 50% and < 60%	≥ 60% and < 70%	≥ 70% and < 80%	≥ 80%

DESIGN SUPPLY FAN AIRFLOW RATE (cfm)								
4C, 5B	NR	NR	NR	NR	NR	NR	≥5000	≥ 5000

NR = not required

TABLE ~~C403.5.4~~C403.7.7.1(2)
ENERGY RECOVERY REQUIREMENT
(VENTILATION SYSTEMS OPERATING NOT LESS 8,000 HOURS PER YEAR)

CLIMATE ZONE	PERCENT (%) OUTDOOR AIR AT FULL DESIGN AIRFLOW RATE							
	≥ 10% and < 20%	≥ 20% and < 30%	≥ 30% and < 40%	≥ 40% and < 50%	≥ 50% and < 60%	≥ 60% and < 70%	≥ 70% and < 80%	≥ 80%
	DESIGN SUPPLY FAN AIRFLOW RATE (cfm)							
4C	NR	≥ 19500	≥ 9000	≥ 5000	≥ 4000	≥ 3000	≥ 1500	≥ 0 120
5B	≥ 2500	≥ 2000	≥ 1000	≥ 500	≥ 0	≥ 0	≥ 0	≥ 0 80

NR = not required

~~C403.5.2~~ Condensate systems. On-site steam heating systems shall have condensate water heat recovery. On-site includes a system that is located within or adjacent to one or more buildings within the boundary of a contiguous area or campus under one ownership and which serves one or more of those buildings.

~~Buildings using steam generated off-site with steam heating systems which do not have condensate water recovery shall have condensate water recovery.~~

~~C403.5.3~~ Condenser heat recovery. Facilities having food service, meat or deli departments and having 500,000-Btu/h or greater of remote refrigeration condensers shall have condenser waste heat recovery from freezers and coolers and shall use the waste heat for service water heating, space heating or for dehumidification reheat. Facilities having a gross conditioned floor area of 40,000 ft² or greater and 1,000,000 Btu/h or greater of remote refrigeration shall have condenser waste heat recovery from freezers and coolers and shall use the waste heat for service water heating, and either for space heating or for dehumidification reheat for maintaining low space humidity.

~~C403.2.7~~C403.7.8 Exhaust systems.

~~C403.2.7.1~~C403.7.8.1 Kitchen hood exhaust systems.

~~C403.7.8.1.1~~ Replacement air. Replacement Makeup Replacement air introduced directly into the exhaust hood cavity shall not be greater than 10 percent of the hood exhaust airflow rate. ~~Conditioned supply air delivered to any space shall not exceed the greater of the following:~~

- ~~1. The ventilation rate required to meet the space heating or cooling load.~~
- ~~2.1. The hood exhaust flow minus the available transfer air from adjacent space where available transfer air is considered that portion of outdoor ventilation air not required to satisfy other exhaust needs, such as restrooms, and not required to maintain pressurization of adjacent spaces.~~

~~C403.7.8.1.2~~ Kitchen exhaust hood certification and maximum airflow. Where a kitchen or kitchen/dining facility has a total kitchen hood exhaust airflow rate that is greater than 2,000 cfm, each hood shall be a factory built commercial exhaust hood listed by a nationally recognized testing laboratory in compliance with UL 710, and each hood shall have a maximum exhaust rate as specified in Table C403.27.78.1.2. ~~Where a single hood, or hood section, is installed over appliances with different duty ratings, the maximum allowable flow rate for the hood or hood section shall be based on the requirements for the highest appliance duty rating under the hood or hood section.~~

Exception: Type II dishwasher exhaust hoods that have an exhaust airflow of 1000 cfm or less.

TABLE ~~C403.2.7.1~~C403.7.8.1.2
MAXIMUM NET EXHAUST FLOW RATE,
CFM PER LINEAR FOOT OF HOOD LENGTH

TYPE OF HOOD	LIGHT-DUTY EQUIPMENT	MEDIUM-DUTY EQUIPMENT	HEAVY-DUTY EQUIPMENT	EXTRA-HEAVY-DUTY EQUIPMENT
Wall-mounted canopy	140	210	280	385
Single island	280	350	420	490

Commented [BK(158)]
M090-2018

Commented [BK(159)]
M090-2018

Double island (per side)	175	210	280	385
Eye brow	175	175	NA	NA
Backshelf/Pass-over	210	210	280	NA

For SI: 1 cfm = 0.4719 L/s; 1 foot = 305 mm.

NA = Not Allowed

C403.7.8.1.3 Kitchen exhaust hood system. ~~and Where a kitchen or kitchen/dining facility has a total kitchen hood exhaust airflow rate greater than 2000 cfm, it shall comply with one of the following:~~

1. Not less than 50 percent of all ~~replacement makeup replacement~~ air shall be transfer air that would otherwise be exhausted.
2. Demand ventilation systems on not less than 75 percent of the ~~total exhaust hood airflow~~ that are configured to provide not less than a 50-percent reduction in exhaust and replacement air system airflow rates, including controls necessary to modulate airflow in response to appliance operation and to maintain full capture and containment of smoke, effluent and combustion products during cooking and idle.
3. Listed energy recovery devices with a sensible heat recovery effectiveness of not less than 40 percent on not less than 50 percent of the total exhaust ~~hood~~ airflow.

~~Where a single hood, or hood section, is installed over appliances with different duty ratings, the maximum allowable flow rate for the hood or hood section shall be based on the requirements for the highest appliance duty rating under the hood or hood section.~~

Exceptions:

1. Where not less than 75 percent of all the ~~replacement makeup replacement~~ air is transfer air that would otherwise be exhausted.
2. ~~Certified grease extractor hoods that require a face velocity no greater than 60 fpm~~ UL 710 listed exhaust hoods that have a design maximum exhaust flow rate no greater than 250 cfm per linear foot of hood that serve kitchen or kitchen/dining facilities with a total kitchen hood exhaust airflow rate less than 5000 cfm.
- 2-3. Type II dishwasher exhaust hoods that have an exhaust airflow of 1000 cfm or less.

Commented [BK(160)]
m090-2018

~~C403.2.7.2~~ **C403.7.8.2 Laboratory exhaust systems.** Buildings with laboratory exhaust systems having a total exhaust rate greater than 5,000 cfm (2,360 L/s) shall include heat recovery systems to precondition makeup air from laboratory exhaust. The heat recovery system shall be capable of increasing the outside air supply temperature at design heating conditions by 25°F (13.9°C). A provision shall be made to bypass or control the heat recovery system to permit air economizer operation as required by Section ~~C403.3~~ C403.5.

Exceptions:

1. Variable air volume laboratory exhaust and room supply systems configured to reduce exhaust and make-up air volume to 50% or less of design values; or
2. Direct make-up (auxiliary) air supply equal to at least 75% of the exhaust rate, heated no warmer than 2°F (1.1°C) below room set point, cooled to no cooler than 3°F (1.7°C) above room set point, no humidification added, and no simultaneous heating and cooling used for dehumidification control; or
3. Combined energy reduction method: VAV exhaust and room supply system configured to reduce exhaust and makeup air volumes and a heat recovery system to precondition makeup air from laboratory exhaust that when combined will produce the same energy reduction as achieved by a heat recovery system with a 50% sensible recovery effectiveness as required above. For calculation purposes, the heat recovery component can be assumed to include the maximum design supply airflow rate at design conditions. The combined energy reduction (Q_{ER}) shall meet the following:

$$Q_{ER} \geq Q_{MIN}$$

$$Q_{MIN} = CFM_S \times (T_R - T_O) \times 1.1 \times 0.6$$

$$Q_{ER} = CFM_S \times (T_R - T_O) \times 1.1(A+B)/100$$

Where:

- Q_{MIN} = Energy recovery at 60% sensible effectiveness (Btu/h)
- Q_{ER} = Combined energy reduction (Btu/h)
- CFM_S = The maximum design supply airflow rate to conditioned spaces served by the system in cubic feet per minute
- T_R = Space return air dry bulb at winter design conditions
- T_O = Outdoor air dry bulb at winter design conditions

- A = Percentage that the exhaust and makeup air volumes can be reduced from design conditions
- B = Percentage sensible heat recovery effectiveness

C403.7.8.3 Transfer Air Conditioned supply air delivered to any space with mechanical exhaust shall not exceed the greater of:

1. The supply flow required to meet the space heating or cooling load;
2. The ventilation rate required by the authority having jurisdiction, the facility Environmental Health and Safety department, or Section C403.2.2; or
3. The mechanical exhaust flow minus the available transfer air from conditioned spaces or return air plenums that at their closest point are within 15 ft of each other on the same floor that are not in different smoke or fire compartments. Available transfer air is that portion of outdoor ventilation air that:
 - a. Is not required to satisfy other exhaust needs,
 - b. Is not required to maintain pressurization of other spaces, and
 - c. Is transferable according to applicable codes and standards and per the *International Mechanical Code*.

Exceptions:

1. Laboratories classified as biosafety level 3 or higher.
2. Vivarium spaces.
3. Spaces that are required by applicable codes and standards to be maintained at positive pressure relative to adjacent spaces. For spaces taking this exception, any transferable air that is not directly transferred shall be made available to the associated air-handling unit and shall be used whenever economizer or other options do not save more energy.
4. Spaces where the demand for transfer air may exceed the available transfer airflow rate and where the spaces have a required negative pressure relationship. For spaces taking this exception, any transferable air that is not directly transferred shall be made available to the associated air-handling unit and shall be used whenever economizer or other options do not save more energy.

C403.7.9 Shutoff dampers for building isolation. Outdoor air supply, exhaust openings and relief outlets and stairway and shaft vents shall be provided with Class I motorized dampers. Mechanical openings shall be provided with shutoff dampers in accordance with Sections C403.7.9.1 through C403.7.9.4.

C403.7.9.1 Shutoff dampers. Outdoor air supply, exhaust openings and relief outlets and stairway and elevator hoistway shaft vents shall be provided with Class I motorized dampers. See Sections C403.10.1 and C403.10.2 for ductwork insulation requirements upstream and downstream of the shutoff damper.

Exceptions:

1. Gravity (nonmotorized) dampers shall be permitted in lieu of motorized dampers as follows:
 - 1.1. Relief dampers serving systems less than 5,000 cfm total supply shall be permitted in buildings less than three stories in height.
 - 1.2. Gravity (nonmotorized) dampers in Group R occupancies where the design outdoor air intake or exhaust capacity does not exceed 400 cfm (189 L/s).
 - 1.3. Systems serving areas which require continuous operation for 24/7 occupancy schedules.
2. Shutoff dampers are not required in:
 - 2.1. Combustion air intakes.
 - 2.2. Systems serving areas which require continuous operation in animal hospitals, kennels and pounds, laboratories, and Group H, I and R Occupancies.
 - 2.3. Subduct exhaust systems or other systems that are required to operate continuously by the *International Mechanical Code*.
 - 2.4. Type I grease exhaust systems or other systems where dampers are prohibited by the *International Mechanical Code* to be in the airstream.
 - 2.5. Unconditioned stairwells or unconditioned elevator hoistway shafts that are only connected to unconditioned spaces.

C403.9.2 Shutoff dampers for return air. Return air openings used for airside economizer operation shall be equipped with Class I motorized dampers.

C403.9.3 Damper leakage rating. Class I dampers shall have a maximum leakage rate of 4 cfm/ft² (20.3 L/s x m²) at 1.0 inch water gauge (w.g.) (249 Pa) when tested in accordance with AMCA 500D and shall be labeled by an approved agency for such purpose. Gravity (nonmotorized) dampers shall have an air leakage rate not greater than 20 cfm/ft² (101.6 L/s x m²) where not less than 24 inches (610 mm) in either dimension and 40 cfm/ft² (201.2 L/s x

Commented [BK(161)]
M090-2018

Commented [BK(162)]
M091-2018

Commented [BK(163)]
M092-2018

Commented [BK(164)]
M092-2018

Commented [BK(165)]
M091-2018

Commented [BK(166)]
M092-2018

Commented [BK(167)]
M091-2018

Commented [BK(168)]
M091-2018

m²) where less than 24 inches in either dimension. The rate of air leakage shall be determined at 1.0 inch w.g. (249 Pa) when tested in accordance with AMCA 500D for such purpose. The dampers shall be labeled by an approve agency. Gravity dampers for ventilation air intakes shall be protected from direct exposure to wind.

Exceptions:

1. Gravity (nonmotorized) dampers are not required to be tested to verify the air leakage rating when installed in exhaust systems where the exhaust capacity does not exceed 400 cfm (189 L/s) and the gravity damper is provided with a gasketed seal.
- 1.2. Motorized dampers on return air openings in unitary packaged equipment that have the minimum leakage rate available from the manufacturer shall be deemed to comply.

C403.9.4 Damper actuation. Outdoor air intake relief and exhaust shutoff dampers shall be installed with automatic controls configured to close when the systems or spaces served are not in use or during unoccupied period warm-up and setback operation, unless the systems served require outdoor or exhaust air in accordance with the *International Mechanical Code* or the dampers are opened to provide intentional economizer cooling. Stairway and elevator hoistway shaft vent dampers shall be installed with automatic controls configured to open upon the activation of any fire alarm initiating device of the building's fire alarm system or the interruption of power to the damper.

Exceptions:

1. Gravity (nonmotorized) dampers shall be permitted to be used as follows:
 - 1.1. Relief dampers serving systems less than 5,000 cfm total supply shall be permitted in buildings less than three stories in height.
 - 1.2. Gravity (nonmotorized) dampers in Group R occupancies where the design outdoor air intake or exhaust capacity does not exceed 400 cfm (189 L/s).
2. Combustion air intakes.
 - Gravity (nonmotorized) dampers shall have an air leakage rate not greater than 20 cfm/ft² (101.6 L/s × m²) where not less than 24 inches (610 mm) in either dimension and 40 cfm/ft² (203.2 L/s × m²) where less than 24 inches in either dimension. The rate of air leakage shall be determined at 1.0 inch w.g. (249 Pa) when tested in accordance with AMCA 500D for such purpose. The dampers shall be labeled by an approved agency. Gravity dampers for ventilation air intakes shall be protected from direct exposure to wind.

C403.2.11 C403.8 Air system design and control Fan and fan controls. Each HVAC system having a total fan system motor nameplate horsepower (hp) exceeding 5 hp (3.7 kW) shall comply with the provisions of Sections C403.2.11.1 through C403.2.11.3. Fans in HVAC systems shall comply with Sections C403.8.1 through C403.8.5.1.

— The airflow requirements of Section C403.2.11.5 shall apply to all fan motors. Group R occupancy exhaust fans shall also comply with Section C403.2.11.4.

— The airflow requirements of Section C403.8.5.1 shall apply to all fan motors. Group R occupancy exhaust fans shall also comply with Section C403.8.4.

C403.8.1 C403.2.11.1 Allowable fan motor horsepower. Each HVAC system having a total fan system motor nameplate horsepower exceeding 5 hp (3.7 kW) at fan system design conditions shall not exceed the allowable fan system motor nameplate hp (Option 1) or fan system bhp (Option 2) as shown in Table C403.2.11.1 C403.8.1 (1). This includes supply fans, exhaust fans, return/relief fans, and fan-powered VAV air terminal units associated with systems providing heating or cooling capability. Single zone variable-air-volume systems shall comply with the constant volume fan power limitation. Zone heating and/or cooling terminal units installed in conjunction with a dedicated outdoor air system (DOAS) shall be evaluated as separate HVAC systems for allowable fan motor horsepower.

Exceptions:

1. Hospital, vivarium and laboratory systems that utilize flow control devices on exhaust and/or return to maintain space pressure relationships necessary for occupant health and safety or environmental control shall be permitted to use variable volume fan power limitation.
2. Individual exhaust fans with motor nameplate horsepower of 1 hp or less are exempt from the allowable fan motor horsepower requirements.

C403.2.11.2 C403.8.2 Motor nameplate horsepower. For each fan, the selected fan motor shall be no larger than the first available motor size greater than the brake horsepower (bhp). The fan bhp shall be indicated on the design documents to allow for compliance verification by the code official.

Exceptions:

1. For fans less than 6 bhp (4413 W), where the first available motor larger than the brake horsepower has a

Commented [BK(169)]
M092-2018

Commented [BK(170)]
M091-2018

Commented [BK(171)]
M092-2018

Commented [BK(172)]
M092-2018

Commented [BK(173)]
M094-2018

Commented [BK(174)]
M094-2018

nameplate rating within 50 percent of the bhp, selection of the next larger nameplate motor size is allowed.

2. For fans 6 bhp (4413 W) and larger, where the first available motor larger than the bhp has a nameplate rating within 30 percent of the bhp, selection of the next larger nameplate motor size is allowed.

3. For fans used only in *approved* life safety applications such as smoke evacuation.

~~3.4. Fans with motor nameplate horsepower less than 1 hp are exempt from this section.~~

~~C403.2.11.3~~C403.8.3 Fan efficiency. Fans shall have a fan efficiency grade (FEG) of 67 or higher based on manufacturers' certified data, as defined by AMCA 205. The total efficiency of the fan at the design point of operation shall be within 15 percentage points of the maximum total efficiency of the fan.

Exception: The following fans are not required to have a fan efficiency grade:

1. Fans of 5 hp (3.7 kW) or less as follows:
 - ~~a.1.1.~~ Single fan ~~Individual fans~~ with a motor nameplate horsepower of 5 hp (3.7 kW) or less, unless Exception 1.2 applies.
 - ~~b.1.2.~~ Multiple fans in series or parallel that have a combined motor nameplate horsepower of 5 hp (3.7 kW) or less and are operated as the functional equivalent of a single fan.
2. Fans that are part of equipment covered under Section ~~C403.2.3~~C403.3.2.
3. Fans included in an equipment package certified by an approved agency for air or energy performance.
4. Powered wall/roof ventilators.
5. Fans outside the scope of AMCA 205.
6. Fans that are intended to operate only during emergency conditions.

TABLE ~~C403.2.11.1~~C403.8.1(1)
FAN POWER LIMITATION

	LIMIT	CONSTANT VOLUME	VARIABLE VOLUME
Option 1: Fan system motor nameplate hp	Allowable nameplate motor hp	$hp \leq CFM_s \times 0.0011$	$hp \leq CFM_s \times 0.0015$
Option 2: Fan system bhp	Allowable fan system bhp	$bhp \leq CFM_s \times 0.00094 + A$	$bhp \leq CFM_s \times 0.0013 + A$

For SI: 1 bhp = 735.5 W, 1 hp = 745.5 W, 1 cfm = 0.471 L/s.

where:

CFM_s = The maximum design supply airflow rate to conditioned spaces served by the system in cubic feet per minute.

Hp = The maximum combined motor nameplate horsepower.

Bhp = The maximum combined fan brake horsepower.

A = Sum of $[PD \times CFMD / 4131]$

where:

PD = Each applicable pressure drop adjustment from Table ~~C403.2.40.1~~C403.8.1(2) in. w.c.

CFMD = The design airflow through each applicable device from Table ~~C403.2.10.1~~C403.8.1(2) in cubic feet per minute.

TABLE ~~C403.2.11.1~~C403.8.1(2)
FAN POWER LIMITATION PRESSURE DROP ADJUSTMENT

Device	Adjustment
Credits	
Fully ducted return and/or exhaust air systems <u>Return air or exhaust system required by code or accreditation standards to be fully ducted, or systems required to maintain air pressure differentials between adjacent rooms</u>	0.5 inch w.c. (2.15 inches w.c. for laboratory and vivarium systems)
Return and/or exhaust air flow control devices	0.5 inch w.c.
Exhaust filters, scrubbers, or other exhaust treatment	The pressure drop of device calculated at fan system design condition

Particulate filtration credit: MERV 9 - 12	0.5 inch w.c.
Particulate filtration credit: MERV 13 - 15	0.9 inch w.c.
Particulate filtration credit: MERV 16 and greater and electronically enhanced filters	Pressure drop calculated at 2x clean filter pressure drop at fan system design condition
Carbon and other gas-phase air cleaners	Clean filter pressure drop at fan system design condition
Biosafety cabinet	Pressure drop of device at fan system design condition
Energy recovery device, other than coil runaround loop	For each airstream (2.2 × energy recovery effectiveness) – 0.5 inch w.c.) for each airstream
Coil runaround loop	0.6 inch w.c. for each airstream
Evaporative humidifier/cooler in series with another cooling coil	Pressure drop of device at fan system design conditions
Sound attenuation section (fans serving spaces with design background noise goals below NC35)	0.15 inch w.c.
Exhaust system serving fume hoods	0.35 inch w.c.
Laboratory and vivarium exhaust systems in high-rise buildings	0.25 inch w.c./100 feet of vertical duct exceeding 75 feet
Deductions	
Systems without central cooling device	-0.6 inch w.c.
Systems without central heating device	-0.3 inch w.c.
Systems with central electric resistance heating	-0.2 inch w.c.

For SI: 1 inch w.c. = 249 Pa, 1 inch. = 25.4 mm.
w.c. := water column, NC = Noise criterion.

C403.2.11.4C403.8.4 Group R occupancy exhaust fan efficacy. The Group R occupancies of the building shall be provided with ventilation that meets the requirements of the *International Mechanical Code*, as applicable, or with other approved means of ventilation. Mechanical ventilation system fans with 400 cfm or less in capacity shall meet the efficacy requirements of Table C403.2.11.4C403.8.4.

Exceptions:

1. Group R heat recovery ventilator and energy recovery ventilator fans that are less than 400 cfm.
2. Where whole house ventilation fans are integrated with forced-air systems that are tested and listed HVAC equipment, ~~provided they shall be are~~ powered by an electronically commutated motor where required by Section C405.8
3. Domestic clothes dryer booster fans, domestic range hood exhaust fans, and domestic range booster fans that operate intermittently.

Commented [BK(175)]
M097-2018

TABLE C403.2.4.11.4C403.8.4
GROUP R MECHANICAL VENTILATION SYSTEM EXHAUST FAN EFFICACY

Fan location	Air Flow Rate Minimum (cfm)	Minimum Efficacy (cfm/watt)	Air Flow Rate Minimum (cfm)
Exhaust fan: Bathroom, utility room, whole house	10	1.4 2.8 cfm/watt	< 90
Exhaust fan: Bathroom, utility room, whole house	90	2.8 3.5 cfm/watt	Any
In-line (single-port and multi-port) fans	Any	3.8	Any

Commented [BK(176)]
M097-2018

~~C403.8.3~~**C403.8.5 Fan controls.** Controls shall be provided for fans in accordance with Section C403.8.5.1 and as required for specific systems provided in Section C403.

~~C403.2.4.11.5~~**C403.8.5.1 Fan airflow control.** Each cooling system listed in Table ~~C403.2.4.11.5~~**C403.8.5.1** shall be designed to vary the indoor fan airflow as a function of load and shall comply with the following requirements:

1. Direct expansion (DX) and chilled water cooling units that control the capacity of the mechanical cooling directly based on space temperature shall have not fewer than two stages of fan control. Low or minimum speed shall not be greater than 66 percent of full speed. At low or minimum speed, the fan system shall draw not more than 40 percent of the fan power at full fan speed. Low or minimum speed shall be used during periods of low cooling load and ventilation-only operation.
2. Other units including DX cooling units and chilled water units that control the space temperature by modulating the airflow to the space shall have modulating fan control. Minimum speed shall be not greater than 50 percent of full speed. At minimum speed, the fan system shall draw no more than 30 percent of the power at full fan speed. Low or minimum speed shall be used during periods of low cooling load and ventilation-only operation.
3. Units that include an airside economizer in accordance with Section ~~C403.3~~**C403.5** shall have not fewer than two speeds of fan control during economizer operation.

Exceptions:

1. Modulating fan control is not required for chilled water and evaporative cooling units with fan motors of less than 1 hp (0.746 kW) where the units are not used to provide ventilation air and the indoor fan cycles with the load.
2. Where the volume of outdoor air required to comply with the ventilation requirements of the *International Mechanical Code* at low speed exceeds the air that would be delivered at the minimum speed defined in ~~this section~~**Section C403.8.5**, the minimum speed shall be selected to provide the required ventilation air.

TABLE ~~C403.2.4.11.5~~C403.8.5.1****
FAN CONTROL

Cooling System Type	Fan Motor Size	Mechanical Cooling Capacity
DX cooling	Any	≥65,000 42,000 Btu/h
Chilled water and evaporative cooling	≥ 5 hp	Any
	≥ ¼ hp	Any

Commented [BK(177)]
98-2018

~~C403.4.3~~**C403.9 Heat rejection and heat recovery equipment.** Heat rejection equipment, ~~such as including~~ air-cooled condensers, dry coolers, open-circuit cooling towers, closed-circuit cooling towers and evaporative condensers, ~~used for comfort cooling applications~~ shall comply with this section.

Exception: Heat rejection devices where energy use is included in the equipment efficiency ratings listed in Tables ~~[IECC: C403.3.2(6) and C403.3.2(7)]~~**C403.3.2(1)A, C403.3.2(1)B, C403.3.2(1)C, C403.3.2(2), C403.3.2(3), C403.3.2(7) and C403.3.2(9).**

Heat rejection equipment shall have a minimum efficiency performance not less than values specified in Table C403.3.2(8). These requirements apply to all propeller, axial fan and centrifugal fan cooling towers. Table C403.3.2(8) specifies requirements for air-cooled condensers that are within rating conditions specified within the table.

~~C403.4.3.1~~**C403.9.1 Fan speed control.** ~~The fan speed shall be controlled as provided in Sections C403.4.3.1.1 and C403.4.3.1.2. Each fan powered by an individual motor or array of motors with a connected power, including the motor service factor, totaling 5 hp (3.7 kW) or more shall have controls and devices configured to automatically modulate the fan speed to control the leaving fluid temperature or condensing temperature and pressure of the heat rejection device. Fan motor power input shall be not more than 30 percent of design wattage at 50 percent of the design airflow.~~

Exceptions:

1. Fans serving multiple refrigerant or fluid cooling circuits.

2. Condenser fans serving flooded condensers.

~~C403.4.3.1.1 Fan motors not less than 7.5 hp.~~ Each fan powered by a motor of 7.5 hp (5.6 kW) or larger shall have controls that automatically change the fan speed to control the leaving fluid temperature or condensing temperature/pressure of the heat rejection device.

C403.9.1.1 Variable flow controls. Cooling tower fans 7.5 hp and greater shall have control devices that vary flow by controlling the leaving fluid temperature or condenser temperature/pressure of the heat rejection device.

C403.9.1.2 Limitation on centrifugal fan cooling towers. Open cooling towers with a combined rated capacity of 1,100 gpm and greater at 95°F condenser water return, 85°F condenser water supply and 75°F outdoor wet-bulb temperature shall meet the energy efficiency requirement for axial fan open circuit cooling towers.

~~C403.4.3.1.2~~ C403.9.2 Multiple-cell heat rejection equipment. Multiple-cell heat rejection equipment with variable speed fan drives shall be controlled ~~in both of the following manners:~~

~~To~~ to operate the maximum number of fans allowed that comply with the manufacturer's requirements for all system components ~~and so that -~~

~~So~~ all fans can operate at the same fan speed required for the instantaneous cooling duty, as opposed to staged (on/off) operation. The minimum fan speed shall be the minimum allowable speed of the fan drive system in accordance with the manufacturer's recommendations.

~~C403.4.3.2~~ C403.9.3 Limitation on centrifugal fan open-circuit cooling towers. Centrifugal fan open-circuit cooling towers with a combined rated capacity of 1,100 gpm (4164 L/m) or greater at 95°F (35°C) condenser water return, 85°F (29°C) condenser water supply, and 75°F (24°C) outdoor air wet-bulb temperature shall meet the energy efficiency requirement for axial fan open-circuit cooling towers listed in Table ~~C403.2.3~~ C403.3.2(8).

Exception: Centrifugal open-circuit cooling towers that are designed with inlet or discharge ducts or require external sound attenuation.

~~C403.4.3.3~~ C403.9.4 Tower flow turndown. Open-circuit cooling towers used on water-cooled chiller systems that are configured with multiple- or variable-speed condenser water pumps shall be designed so that all open circuit cooling tower cells can be run in parallel with the larger of the flow that is produced by the smallest pump at its minimum expected flow rate or at 50 percent of the design flow for the cell.

~~C403.4.5 Reserved.~~ (See ~~C403.5.4~~ for Heat recovery for service water heating.)

~~C403.5.4~~ C403.9.5 Heat recovery for service water heating. Condenser heat recovery shall be installed for heating or reheating of service hot water provided the facility operates 24 hours a day, the total installed heat capacity of water cooled systems exceeds 1,500,000 Btu/hr of heat rejection, and the design service water heating load exceeds 250,000 Btu/hr.

The required heat recovery system shall have the capacity to provide the smaller of:

1. Sixty percent of the peak heat rejection load at design conditions; or
2. The preheating required to raise the peak service hot water draw to 85°F (29°C).

Exceptions:

1. Facilities that employ condenser heat recovery for space heating or reheat purposes with a heat recovery design exceeding 30 percent of the peak water-cooled condenser load at design conditions.
2. Facilities that provide 60 percent of their service water heating from site solar or site recovered energy or from other sources.

C403.9.6 Steam condensate systems. On-site steam heating systems shall have condensate water heat recovery. On-site includes a system that is located within or adjacent to one or more buildings within the boundary of a contiguous area or campus under one ownership and which serves one or more of those buildings.

Buildings using steam generated off-site with steam heating systems which do not have condensate water recovery shall have condensate water recovery.

C403.9.7 Refrigeration condenser heat recovery. Facilities having food service, meat or deli departments and having 500,000 Btu/h or greater of remote refrigeration condensers shall have condenser waste heat recovery from freezers and coolers and shall use the waste heat for service water heating, space heating or for dehumidification reheat. Facilities having a gross conditioned floor area of 40,000 ft² or greater and 1,000,000 Btu/h or greater of remote refrigeration shall have condenser waste heat recovery from freezers and coolers and shall use the waste heat for service water heating, and either for space heating or for dehumidification reheat for maintaining low space humidity.

C403.9.8 Heat recovery for space heating. A condenser heat recovery system meeting the requirements of Sections C403.9.8.1 through C403.9.8.4 shall be installed to serving heating systems in buildings meeting the following criteria:

Commented [BK(178)]
M099-2018

1. The facility operates greater than 70 hours per week.
2. The sum of all heat rejection equipment capacity exceeds 1,500,000 BTU/hr.
3. The sum of zone minimum airflows in all zones with zone reheat coils divided by the conditioned floor area served by those systems is at least 0.45 cfm per square foot.

Exception: Systems complying with Section C403.3.5, Dedicated outdoor air systems (DOAS).

C403.9.8.1 Water to water heat recovery. Ninety percent (90%) of the total building space heat shall be served by systems that include heat recovery chiller or water to water heat pump equipment capable of rejecting heat from the cooling loop to the space heating loop as the first stage of heating.

Commented [BK(179)]
M099-2018

C403.9.8.2 Exhaust heat recovery. Heat shall be recovered by the condenser heat recovery system from 90 percent of the total building exhaust airflow. The maximum leaving air temperature of exhaust air after heat recovery shall be 55F dry-bulb when operating at full capacity.

Commented [BK(180)]
M099-2018

C403.9.8.3 Process heat recovery. Spaces with year-round cooling loads from lights and equipment of 5 watts and greater per square foot shall be served by water cooled equipment. Cooling loops serving the water cooled equipment shall be served by water to water heat recovery systems meeting the requirements of Section C403.9.8.1. Such spaces shall not be provided with an air or water economizer.

Commented [BK(181)]
M099-2018

C403.9.8.4 Water to water heat recovery sizing. The minimum total combined capacity of heat recovery chillers or water to water heat pumps shall match the total combined capacity of equipment meeting the requirements of Sections C403.9.8.2 and C403.9.8.3.

Commented [BK(182)]
m099-2018

C403.10 Construction of HVAC system elements. Ducts, plenums, piping and other elements that are part of an HVAC system shall be constructed and insulated in accordance with Sections C403.10.1 through C403.10.3.1

C403.2.8C403.10.1 Duct and plenum insulation and sealing.

C403.2.8.1C403.10.1.1 Ducts conveying outdoor air. Ducts, shafts and plenums conveying ~~outside outdoor~~ air from the exterior of the building to the mechanical system shall meet all air leakage and building envelope insulation requirements of Section C402, plus building envelope vapor control requirements from the *International Building Code*, extending continuously from the building exterior to an automatic shutoff damper or heating or cooling equipment. For the purposes of building envelope insulation requirements, duct surfaces shall be insulated with the minimum insulation values in Table C403.10.1 ~~meet the requirements for metal framed walls per Table C402.1.4.~~ Duct surfaces included as part of the building envelope shall not be used in the calculation of maximum glazing area as described in Section C402.4.1.

Commented [BK(183)]
M052-2018

Exceptions:

1. ~~Outside-Outdoor~~ air ducts serving individual supply air units with less than 2,800 cfm of total supply air capacity, provided these are insulated to ~~R-7~~ the minimum insulation values in Table C403.10.1.
2. Unheated equipment rooms with combustion air louvers, provided they are isolated from conditioned space at sides, top and bottom of the room with R-11 nominal insulation.

Commented [BK(184)]
M052-2018

**TABLE C403.10.1
OUTDOOR AIR DUCTWORK INSULATION**

Commented [BK(185)]
M052-2018

<u>Duct system</u>	<u>Duct Location and Use</u>	<u>Climate Zone</u>	<u>Airflow</u>	<u>Minimum Installed Duct Insulation R-value</u> ^{a,b}	<u>Notes</u>
<u>Outdoor Air</u>	<u>Inside conditioned space and upstream of automatic shutoff damper</u>	<u>4C and 5B</u>	<u>>= 2800 CFM</u>	<u>R-16</u>	<u>See Section C403.10.1.1 for additional requirements</u>
<u>Outdoor Air</u>	<u>Inside Conditioned Space and downstream of automatic shutoff damper to HVAC Unit or Room</u>	<u>4C</u>	<u>>= 2800 CFM</u>	<u>R-8</u>	
<u>Outdoor Air</u>	<u>Inside Conditioned Space and downstream of</u>	<u>5B</u>	<u>>= 2800 CFM</u>	<u>R-12</u>	

	<u>automatic shutoff damper to HVAC Unit or Room</u>				
<u>Outdoor Air</u>	<u>Inside Conditioned Space</u>	<u>4C and 5B</u>	<u>< 2800 CFM</u>	<u>R-7</u>	<u>See Exception 1 to Section C403.10.1.1 for additional details</u>

- a. Insulation R-values, measured in h·ft²·°F/Btu, are for the insulation as installed and do not include film resistance. The required minimum thicknesses do not consider water vapor transmission and possible surface condensation. Insulation resistance measured on a horizontal plane in accordance with ASTM C518 at a mean temperature of 75°F at the installed thickness.
- b. See International Mechanical Code Sections 603.12 and 604 for further details on duct insulation requirements.

C403.2.8.2C403.10.1.2 Other supply and return ducts. All other supply and return air ducts and plenums shall be insulated with a minimum of R-6 insulation where located in unconditioned spaces and where located outside the building with a minimum of R-8 insulation in Climate Zone 4 and R-12 insulation in Climate Zone 5. Where located within a building envelope assembly, the duct or plenum shall be separated from the building exterior or unconditioned or exempt spaces by minimum insulation value as required for exterior walls by Section C402.1.3.

Exceptions:

- Where located within equipment.
- Supply and return ductwork located in unconditioned spaces where the design temperature difference between the interior and exterior of the duct or plenum does not exceed 15°F (8°C) are insulated in accordance with Table C403.10.1.2.

Where located within conditioned space, supply ducts which convey supply air at temperatures less than 55°F or greater than 105°F shall be insulated with a minimum of R-3.3 insulation R-value in accordance with Table C403.10.1.2.

Exception: Ductwork exposed to view within a zone that serves that zone is not required to be insulated.

Where located within conditioned space, return or exhaust air ducts that convey return or exhaust air downstream of an energy recovery media shall be insulated with a minimum R-value in accordance with Table C403.10.1.2.

All ducts, air handlers, and filter boxes shall be sealed. Joints and seams shall comply with Section 603.9 of the *International Mechanical Code*.

**TABLE C403.10.1.2
SUPPLY, RETURN, EXHAUST AIR, RELIEF DUCTWORK INSULATION**

<u>Duct system</u>	<u>Duct Location and Use</u>	<u>Climate Zone</u>	<u>Minimum Installed Duct Insulation R-value^{a,b}</u>	<u>Notes</u>
<u>Supply Air or Return Air</u>	<u>Outside the Building (outdoors and exposed to weather)^c</u>	<u>4C</u>	<u>R-8</u>	<u>See Section C403.10.1.2 for details</u>
<u>Supply Air or Return Air</u>	<u>Outside the Building (outdoors and exposed to weather)^c</u>	<u>5B</u>	<u>R-12</u>	<u>See Section C403.10.1.2 for details</u>
<u>Supply Air or Return Air</u>	<u>Unconditioned Space (enclosed but not in the building conditioned envelope)</u>	<u>4C and 5B</u>	<u>R-6</u>	<u>See Section C403.10.1.2 for details</u>
<u>Supply Air or Return Air</u>	<u>Unconditioned Space where the duct conveys air that is within 15°F of the air temperature of the surrounding unconditioned space</u>	<u>4C and 5B</u>	<u>R-3.3</u>	<u>See IMC Section 603.12 for additional requirements for condensation control at ductwork</u>
<u>Supply Air or Return Air</u>	<u>Where located in a building envelope assembly</u>	<u>4C and 5B</u>	<u>R-16</u>	<u>Duct or plenum is separated from building envelope assembly with the minimum insulation value</u>
<u>Supply Air</u>	<u>Within Conditioned Space where the supply duct conveys air that is less than 55°F or greater than 105°F</u>	<u>4C and 5B</u>	<u>R-3.3</u>	<u>See Section C403.10.1.2 for details</u>
<u>Supply Air</u>	<u>Within Conditioned Space that the duct directly serves where the supply duct conveys air that is less</u>	<u>4C and 5B</u>	<u>None</u>	<u>See Section C403.10.1.2 for details</u>

Commented [BK(186)]
M052-2018

Commented [BK(187)]
M052-2018

Commented [BK(188)]
M052-2018

Commented [BK(189)]
M052-2018

	<u>than 55°F or greater than 105°F</u>			
<u>Supply Air</u>	<u>Within Conditioned Space where the supply duct conveys air that is 55 °F or greater and 105 °F or less</u>	<u>4C and 5B</u>	<u>None</u>	
<u>Return or Exhaust Air</u>	<u>Within Conditioned Space, Downstream of an Energy Recovery Media, upstream of an automatic shutoff damper</u>	<u>4C</u>	<u>R-8</u>	
<u>Return or Exhaust Air</u>	<u>Within Conditioned Space, Downstream of an Energy Recovery Media, upstream of an automatic shutoff damper</u>	<u>5B</u>	<u>R-12</u>	
<u>Relief or Exhaust Air</u>	<u>Conditioned Space and downstream of an automatic shutoff damper</u>	<u>4C and 5B</u>	<u>R-16</u>	

- a. Insulation R-values, measured in h·ft²·°F/Btu, are for the insulation as installed and do not include film resistance. The required minimum thicknesses do not consider water vapor transmission and possible surface condensation. Insulation resistance measured on a horizontal plane in accordance with ASTM C518 at a mean temperature of 75°F at the installed thickness.
- b. See International Mechanical Code Sections 603.12 and 604 for further details on duct insulation requirements.
- c. Includes attics above insulated ceilings, parking garages and crawl spaces.

~~C403.2.8.3~~C403.10.2 Duct construction. Ductwork shall be constructed and erected in accordance with the *International Mechanical Code*.

~~C403.2.8.3.1~~C403.10.2.1 Low-pressure duct systems. ~~AH~~Longitudinal and transverse joints, seams and connections of supply and return ducts operating at a static pressure less than or equal to 2 inches water gauge (w.g.) (500 Pa) shall be securely fastened and sealed with welds, gaskets, mastics (adhesives), mastic-plus embedded-fabric systems or tapes installed in accordance with the manufacturer's installation instructions. Pressure classifications specific to the duct system shall be clearly indicated on the construction documents in accordance with the *International Mechanical Code*.

Exception: Continuously welded and locking-type longitudinal joints and seams on ducts operating at static pressures less than 2 inches water gauge (w.g.) (500 Pa) pressure classification.

~~C403.2.8.3.2~~C403.10.2.2 Medium-pressure duct systems. ~~AH~~Ducts and plenums designed to operate at a static pressure greater than 2 inches water gauge (w.g.) (500 Pa) but less than 3 inches w.g. (750 Pa) shall be insulated and sealed in accordance with Section C403.2.8. Pressure classifications specific to the duct system shall be clearly indicated on the construction documents in accordance with the *International Mechanical Code*.

~~C403.2.8.3.3~~C403.10.2.3 High-pressure duct systems. Ducts designed to operate at static pressures ~~in excess of~~equal to or greater than 3 inches water gauge (w.g.) (750 Pa) shall be insulated and sealed in accordance with Section C403.2.8. In addition, ducts and plenums shall be leak-tested in accordance with the SMACNA *HVAC Air Duct Leakage Test Manual* and shown to have a rate of air leakage (*CL*) less than or equal to 4.0 as determined in accordance with Equation 4-9.

$$CL = F/P^{0.65} \quad \text{(Equation 4-9)}$$

Where:

F = The measured leakage rate in cfm per 100 square feet of duct surface.

P = The static pressure of the test.

Documentation shall be furnished by the designer demonstrating that representative sections totaling at least 25 percent of the duct area have been tested and that all tested sections meet the requirements of this section.

~~C403.2.9~~C403.10.3 Piping insulation. All piping serving as part of a heating or cooling system shall be thermally insulated in accordance with Table ~~C403.2.9~~C403.10.3.

Exceptions:

1. Factory-installed piping within HVAC equipment tested and rated in accordance with a test procedure referenced by this code.
2. Factory-installed piping within room fan-coils and unit ventilators tested and rated according to AHRI 440 (except that the sampling and variation provisions of Section 6.5 shall not apply) and 840, respectively.
3. Piping that conveys fluids that have a design operating temperature range between 60°F (15°C) and 105°F

(41°C).

4. Piping that conveys fluids that have not been heated or cooled through the use of fossil fuels or electric power.
5. Strainers, control valves, and balancing valves associated with piping 1 inch (25 mm) or less in diameter.
6. Direct buried piping that conveys fluids at or below 60°F (15°C).

C403.2.9.4C403.10.3.1 Protection of piping insulation. Piping insulation exposed to weather shall be protected from damage, including that due to sunlight, moisture, equipment maintenance and wind, and shall provide shielding from solar radiation that can cause degradation of the material. Adhesives tape shall not be permitted.

**TABLE C403.2.9C403.10.3
MINIMUM PIPE INSULATION THICKNESS (thickness in inches)^a**

FLUID OPERATING TEMPERATURE RANGE AND USAGE (°F)	INSULATION CONDUCTIVITY		NOMINAL PIPE OR TUBE SIZE (inches)				
	Conductivity Btu · in./ (h · ft ² · °F) ^b	Mean Rating Temperature, °F	< 1	1 to < 1-1/2	1-1/2 to < 4	4 to < 8	≥ 8
> 350	0.32 – 0.34	250	4.5	5.0	5.0	5.0	5.0
251 – 350	0.29 – 0.32	200	3.0	4.0	4.5	4.5	4.5
201 – 250	0.27 – 0.30	150	2.5	2.5	2.5	3.0	3.0
141 – 200	0.25 – 0.29	125	1.5	1.5	2.0	2.0	2.0
105 – 140	0.21 – 0.28	100	1.0	1.0	1.5	1.5	1.5
40 – 60	0.21 – 0.27	75	0.5	0.5	1.0	1.0	1.0
< 40	0.20 – 0.26	75	0.5	1.0	1.0	1.0	1.5

- a. For piping smaller than 1 1/2 inch (38 mm) and located in partitions within *conditioned spaces*, reduction of these thicknesses by 1 inch (25 mm) shall be permitted (before thickness adjustment required in footnote b) but not to a thickness less than 1 inch (25 mm).
- b. For insulation outside the stated conductivity range, the minimum thickness (*T*) shall be determined as follows:

$$T = r \{ (1 + t/r) K/k - 1 \}$$
 where:
T = minimum insulation thickness,
r = actual outside radius of pipe,
t = insulation thickness listed in the table for applicable fluid temperature and pipe size,
K = conductivity of alternate material at mean rating temperature indicated for the applicable fluid temperature (Btu × in/h × ft² × °F) and
k = the upper value of the conductivity range listed in the table for the applicable fluid temperature.
- c. For direct-buried heating and hot water system piping, reduction of these thicknesses by 1 1/2 inches (38 mm) shall be permitted (before thickness adjustment required in footnote b) but not to thicknesses less than 1 inch (25 mm).

C403.11 Mechanical systems located outside of the building thermal envelope. Mechanical systems providing heat outside of the thermal envelope of a building shall comply with Section C403.11.1 through C403.11.3.

C403.2.12C403.11.1 Heating outside a building. Systems installed to provide heat outside a building shall be radiant systems.

Such heating systems shall be controlled by an occupancy sensing device or a timer switch, so that the system is automatically deenergized when no occupants are present.

C403.2.4.5C403.11.2 Snow- and ice-melt system controls. Snow- and ice-melting systems, supplied through energy service to the building, shall include automatic controls configured to shut off the system when the pavement temperature is above 50°F (10°C) and no precipitation is falling and an automatic ~~or manual~~ control that is configured to shut off when the outdoor temperature is above 40°F (4°C) so that the potential for snow or ice accumulation is negligible.

C403.2.4.6C403.11.3 Freeze protection system controls. Freeze protection systems, such as heat tracing of outdoor piping and heat exchangers, including self-regulating heat tracing, shall include automatic controls configured to shut off the systems when outdoor air temperatures are above 40°F (4°C) or when the conditions of the protected fluid will prevent freezing.

C403.12 Commissioning. Mechanical systems shall be commissioned in accordance with Section C408.

Commented [BK(190)]
C147-2018

SECTION C404 SERVICE WATER HEATING (MANDATORY) AND PRESSURE-BOOSTER SYSTEMS

C404.1 General. This section covers the minimum efficiency of, and controls for, service water-heating equipment and insulation of service hot water piping.

C404.2 Service water-heating equipment performance efficiency. Water-heating equipment and hot water storage tanks

shall meet the requirements of Table C404.2. The efficiency shall be verified through certification and *listed* under an *approved* certification program, or if no certification program exists, the equipment efficiency ratings shall be supported by data furnished by the manufacturer. Water-heating equipment ~~also~~ intended to be used to provide space heating shall meet the applicable provisions of Table C404.2.

C404.2.1 High input-rated service water heating systems. ~~Gas-fired~~ All water-heating equipment installed in new buildings, for other than Group R-1 and R-2 occupancies, shall be in compliance with this section. Where a singular piece of water-heating equipment serves the entire building and the input rating of the equipment is 1,000,000 Btu/h (293 kW) or greater, such equipment shall ~~have a thermal efficiency, E_t , of not less than 90 percent. Where multiple pieces of water-heating equipment serve the building and the combined input rating of the water-heating equipment is 1,000,000 Btu/h (293 kW) or greater, the combined input-capacity-weighted-average thermal efficiency~~ be a heat pump water heater or have no less than an E_t or E_F of ~~shall not be less than 90 percent as determined by the applicable test procedures in Table C404.2.~~

Where multiple pieces of water-heating equipment serve the building and the combined input rating of the water-heating equipment is 1,000,000 Btu/h (293 kW) or greater, the combined input-capacity-weighted-average shall be no less than the following for each water heating fuel source:

1. A rated COP of no less than 2.0. For air-source heat pump equipment, the COP rating will be reported at the design leaving heat pump water temperature with an entering air temperature of 60°F (15.6°C) or less.
2. A rated E_t of no less than 90 percent as determined by the applicable test procedures in Table C404.2.

Exceptions: Where not less than 25 percent of the annual service water-heating requirement is provided from any of the following sources:

1. ~~by site solar or site-recovered energy, the minimum thermal efficiency requirements of this section shall not apply.~~ Renewable energy generated on site that is not being used to satisfy another requirement of this code, or
2. ~~Heat recovered on site from the building's wastewater, or from air that would otherwise be exhausted to the outdoors without heat recovery, that is not being used to satisfy other requirements of this code.~~
3. ~~The input rating of water heaters installed in individual dwelling units shall not be required to be included in the total input rating of the service water-heating equipment for a building.~~
4. ~~The input rating of water heaters with an input rating of not greater than 100,000 Btu/h (29 kW) shall not be required to be included in the total input rating of service water-heating equipment for a building.~~

C404.2.2 High input-rated service water heating system for Group R-1 and R-2 occupancies. In new construction with over 1,000,000 Btu/h installed service water heating capacity serving Group R-1 and R-2 occupancies, at least 25 percent of annual water heating energy shall be provided from any combination of the following water heating sources:

1. Renewable energy generated on site that is not being used to satisfy other requirements of this code, or
2. Heat recovered on site from the building's wastewater, air source heat pumps, or from air that would otherwise be exhausted to the outdoors without heat recovery, that is not being used to satisfy other requirements of this code.

Exception: Compliance with this section is not required if the combined input-capacity-weighted average equipment rating for each service water heating fuel source type is no less than the following.

1. A heat pump water heater or an electric water heater with a rating of 125% of the rated efficiency of Table C404.2.
2. A rated COP of no less than 2.0. For air-source heat pump equipment the COP rating will be reported at the design leaving heat pump water temperature with an entering air temperature of 60°F (15.6°C) or lower.
3. A rated E_t or E_F of no less than 90 percent as determined by the applicable test procedures in Table C404.2.

Commented [BK(191)]
W101-2018

Commented [BK(192)]
W101-2018

**TABLE C404.2
MINIMUM PERFORMANCE OF WATER-HEATING EQUIPMENT**

EQUIPMENT TYPE	SIZE CATEGORY (input)	SUBCATEGORY OR RATING CONDITION	PERFORMANCE REQUIRED ^{a, b}	TEST PROCEDURE
Water heaters, electric	≤ 12 kW	Tabletop^e, >20 gal and <120 gal Resistance ≥20 gal and <55 gal Grid-enabled^f >75 gal and <120 gal	0.93 - 0.00132V, EF 0.97-960 - 0.0013240.0003V, EF 1.06-0.00168V, EF	DOE 10 CFR Part 430
	> 12 kW	Resistance ≥20 gal	0.3 + 27/V _m %/h ^g	Section G.2 of ANSI Z21.10.3
	≤ 24 amps and ≤250 volts	Heat pump	0.93 - 0.001322.57 - 0.00113V, EF	DOE 10 CFR Part 430
Instantaneous water heaters, electric	All	Resistance	0.97 - 0.00132V, EF	DOE 10 CFR Part 430
Storage water heaters, gas	≤ 75,000 Btu/h	≥ 20 gal and < 55 gal ≥55 gal and <100 gal	0.675 - 0.001940.0015V, EF 0.8012 - 0.00078V, EF	DOE 10 CFR Part 430
	> 75,000 Btu/h	< 4,000 Btu/h/gal	80% E _t (Q/800 + 110√V)SL, Btu/h	Section G.1 and G.2 of ANSI Z21.10.3
Instantaneous water heaters, gas	> 50,000 Btu/h and < 200,000 Btu/h	≥ 4,000 (Btu/h)/gal and < 2 gal	0.620.82 - 0.0019V, EF	DOE 10 CFR Part 430
	≥ 200,000 Btu/h ^c	≥ 4,000 Btu/h/gal and < 10 gal	80% E _t	Section G.1 and G.2 of ANSI Z21.10.3
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and ≥10 gal	80% E _t (Q/800 + 110√V)SL, Btu/h	
Storage water heaters, oil	≤ 105,000 Btu/h	≥20 gal	0.590.68 - 0.0019V, EF	DOE 10 CFR Part 430
	> 105,000 Btu/h	< 4,000 Btu/h/gal	80% E _t (Q/800 + 110√V)SL, Btu/h	Section G.1 and G.2 of ANSI Z21.10.3
Instantaneous water heaters, oil	≤ 210,000 Btu/h	≥ 4,000 Btu/h/gal and < 2 gal	0.59 - 0.0019V, EF	DOE 10 CFR Part 430
	> 210,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E _t	Section G.1 and G.2 of ANSI Z21.10.3
	> 210,000 Btu/h	≥ 4,000 Btu/h/gal and ≥10 gal	78% E _t (Q/800 + 110√V)SL, Btu/h	
Hot water supply boilers, gas and oil	≥ 300,000 Btu/h and < 12,500,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E _t	Section G.1 and G.2 of ANSI Z21.10.3
Hot water supply boilers, gas	≥ 300,000 Btu/h and < 12,500,000 Btu/h	≥4,000 Btu/h/gal and ≥ 10 gal	80% E _t (Q/800 + 110√V)SL, Btu/h	
Hot water supply boilers, oil	≥300,000 Btu/h and < 12,500,000 Btu/h	≥ 4,000 Btu/h/gal and > 10 gal	78% E _t (Q/800 + 110√V)SL, Btu/h	
Pool heaters, gas and oil	All	—	7882% E_t	ASHRAE 146
Heat pump pool heaters	All	—	4.0 COP	AHRI 1160
Unfired storage tanks	All	—	Minimum insulation requirement R-12.5 (h x ft ² x °F)/Btu	(none)

For SI: °C = [(°F) - 32]/1.8, 1 British thermal unit per hour = 0.2931 W, 1 gallon = 3.785 L, 1 British thermal unit per hour per gallon = 0.078 W/L.

- Energy factor (EF) and thermal efficiency (E_t) are minimum requirements. In the EF equation, V is the rated volume in gallons.
- Standby loss (SL) is the maximum Btu/h based on a nominal 70°F temperature difference between stored water and ambient requirements. In the SL equation, Q is the nameplate input rate in Btu/h. In the SL equation for electric water heaters, V is the rated volume in gallons and V_m is the measured volume in gallons. In the SL equation for oil and gas water heaters and boilers, V is the rated volume in gallons.

- c. Instantaneous water heaters with input rates below 200,000 Btu/h must comply with these requirements if the water heater is designed to heat water to temperatures 180°F or higher.
- d. Electric water heaters with an input rating of 12kW (40,950 Btu/h) or less that are designed to heat water to temperatures of 180°F or greater shall comply with the requirements for electric water heaters that have an input rating greater than 12 kW.
- e. A tabletop water heater is a water heater that is enclosed in a rectangular cabinet with a flat top surface not more than three feet (0.91 m) in height.
- f. A grid-enabled water heater is an electric resistance water heater that meets all of the following:
 - 1. Has a rated storage tank volume of more than 75 gallons.
 - 2. Is manufactured on or after April 16, 2015.
 - 3. Is equipped at the point of manufacture with an activation lock.
 - 4. Bears a permanent label applied by the manufacturer that complies with all of the following:
 - 4.1 Is made of material not adversely affected by water.
 - 4.2 Is attached by means of non-water soluble adhesive.
 - 4.3 Advises purchasers and end-users of the intended and appropriate use of the product with the following notice printed in 16.5 point Arial Narrow Bold font: "IMPORTANT INFORMATION: This water heater is intended only for use as a part of an electric thermal storage or demand response program. It will not provide adequate hot water unless enrolled in such a program and activated by your utility company or another program operator. Confirm the availability of a program in your local area before purchasing or installing this product."
- g. %h is the energy consumed to replace the heat lost from the tank while on standby, expressed as a percentage of the total energy in the stored water per hour.

C404.3 Efficient heated water supply piping. Heated water supply piping shall be in accordance with Section C404.3.1 or C404.3.2. The flow rate through 1/4-inch (6.4 mm) piping shall be not greater than 0.5 gpm (1.9 L/m). The flow rate through 5/16-inch (7.9 mm) piping shall be not greater than 1 gpm (3.8 L/m). The flow rate through 3/8-inch (9.5 mm) piping shall be not greater than 1.5 gpm (5.7 L/m). Water heaters, circulating water systems and heat trace temperature maintenance systems shall be considered sources of heated water.

C404.3.1 Maximum allowable pipe length method. The maximum allowable piping length from the nearest source of heated water to the termination of the fixture supply pipe shall be in accordance with the following. Where the piping contains more than one size of pipe, the largest size of pipe within the piping shall be used for determining the maximum allowable length of the piping in Table C404.3.1.

- 1. For a public lavatory faucet, use the "Public lavatory faucets" column in Table C404.3.1.
- 2. For all other plumbing fixtures and plumbing appliances, use the "Other fixtures and appliances" column in Table C404.3.1.

C404.3.2 Maximum allowable pipe volume method. The water volume in the piping shall be calculated in accordance with Section C404.3.2.1. The volume from the nearest source of heated water to the termination of the fixture supply pipe shall be as follows:

- 1. For a public lavatory faucet: Not more than 2 ounces (0.06 L).
- 2. For other plumbing fixtures or plumbing appliances; not more than 0.5 gallon (1.89 L).

C404.3.2.1 Water volume determination. The volume shall be the sum of the internal volumes of pipe, fittings, valves, meters and manifolds between the nearest source of heated water and the termination of the fixture supply pipe. The volume in the piping shall be determined from the "Volume" column in Table C404.3.1. The volume contained within fixture shutoff valves, within flexible water supply connectors to a fixture fitting and within a fixture fitting shall not be included in the water volume determination. Where heated water is supplied by a recirculating system or heat-traced piping, the volume shall include the portion of the fitting on the branch pipe that supplies water to the fixture.

C404.4 Heat traps for hot water storage tanks. ~~Water heating equipment not supplied with integral heat traps and serving noncirculating systems shall be provided with heat traps on the supply and discharge piping associated with the equipment.~~ Storage tank-type water heaters and hot water storage tanks that have vertical water pipes connecting to the inlet and outlet of the tank shall be provided with integral heat traps at those inlets and outlets or shall have pipe configured heat traps in the piping connected to those inlets and outlets. Tank inlets and outlets associated with solar water heating system circulation loops shall not be required to have heat traps.

C404.5 Water heater installation. Electric water heaters in unconditioned spaces or on concrete floors shall be placed on an incompressible, insulated surface with a minimum thermal resistance of R-10.

C404.6 Insulation of piping. Piping from a water heater to the termination of the heated water fixture supply pipe shall be

insulated in accordance with Table ~~C403.2.9~~C403.10.3. On both the inlet and outlet piping of a storage hot water heater or heated water storage tank, the piping to a heat trap or the first 8 feet (2438 mm) of piping, whichever is less, shall be insulated. Piping that is heat traced shall be insulated in accordance with Table ~~C403.2.9~~C403.10.3 or the heat trace manufacturer's instructions. Tubular pipe insulation shall be installed in accordance with the insulation manufacturer's instructions. Pipe insulation shall be continuous, including through hangers and supports, such that thermal bridging is presented, except where the piping passes through a framing member. The minimum insulation thickness requirements of this section shall not supersede any greater insulation thickness requirements necessary for the protection of piping from freezing temperatures or the protection of personnel against external surface temperatures on the insulation.

Commented [BK(193)]
W109-2018

Exception: Tubular pipe insulation shall not be required on the following:

- ~~2.1.~~ The tubing from the connection at the termination of the fixture supply piping to a plumbing fixture or plumbing appliance.
- ~~3.2.~~ Valves, pumps, strainers and threaded unions in piping that is 1 inch (25 mm) or less in nominal diameter.
- ~~4.3.~~ Piping from user-controlled shower and bath mixing valves to the water outlets.
- ~~5.4.~~ Cold-water piping of a demand recirculation water system.
- ~~6.5.~~ Tubing from a hot drinking-water heating unit to the water outlet.
- ~~7.6.~~ Piping at locations where a vertical support of the piping is installed.
- ~~7.~~ Piping surrounded by building insulation with a thermal resistance (*R*-value) of not less than R-3.
8. Hot water piping that is part of the final pipe run to the plumbing fixture and is not part of the heated-water circulation system circulation path is not required to meet the minimum insulation requirements of Section C404.6.

Commented [BK(194)]
W105/107-2018

**TABLE C404.3.1
PIPING VOLUME AND MAXIMUM PIPING LENGTHS**

NOMINAL PIPE SIZE (inches)	VOLUME (liquid ounces per foot length)	MAXIMUM PIPING LENGTH (feet)	
		Public lavatory faucets	Other fixtures and appliances
1/4	0.33	6	50
5/16	0.5	4	50
3/8	0.75	3	50
1/2	1.5	2	43
5/8	2	1	32
3/4	3	0.5	21
7/8	4	0.5	16
1	5	0.5	13
1 1/4	8	0.5	8
1 1/2	11	0.5	6
2 or larger	18	0.5	4

C404.7 Heated-water circulating and temperature maintenance systems. Heated-water circulation systems shall be in accordance with Section C404.7.1. Heat trace temperature maintenance systems shall be in accordance with Section C404.7.2. Controls for hot water storage shall be in accordance with Section C404.7.3. Automatic controls, temperature sensors and pumps shall be accessible in a location with access. Manual controls shall be readily accessible in a location with ready access.

C404.7.1 Circulation systems. Heated-water circulation systems shall be provided with a circulation pump. The system return pipe shall be a dedicated return pipe or a cold water supply pipe. Gravity and thermo-syphon circulation systems shall be prohibited. Controls for circulating hot water system pumps shall start the pump based on the identification of a demand for hot water within the occupancy. The controls shall automatically turn off the pump when the water in the circulation loop is at the desired temperature and when there is no demand for hot water.

C404.7.2 Heat trace systems. Electric heat trace systems shall comply with IEEE 515.1. Controls for such systems shall be able to automatically adjust the energy input to the heat tracing to maintain the desired water temperature in the piping in accordance with the times when heated water is used in the occupancy. Heat trace shall be arranged to be turned off automatically when there is no hot water demand.

C404.7.3 Controls for hot water storage. The controls on pumps that circulate water between a water heater and a heated-water storage tank shall limit operation of the pump from heating cycle startup to not greater than 5 minutes after the end of the cycle.

C404.8 Demand recirculation controls. ~~A water distribution system having one or more recirculation pumps that pump water from a heated water supply pipe back to the heated water source through a cold water supply pipe shall be a Demand recirculation water system.~~ ~~Pumps~~ shall have controls that comply with both of the following:

- ~~3.1.~~ The controls shall start the pump upon receiving a signal from the action of a user of a fixture or appliance, sensing the presence of a user of a fixture or sending the flow of hot or tempered water to a fixture fitting or appliance.
- ~~4.2.~~ The controls shall limit the temperature of the water entering the cold water-piping to not greater than 104°F (40°C)

C404.9 Domestic hot water meters. Each individual dwelling unit in a Group R-2 ~~multi-family residential~~ occupancy with central service domestic hot water systems shall be provided with a domestic hot water meter to allow for domestic hot water billing based on actual domestic hot water usage.

Exception: Dwelling units in other than Group R-2 apartment and live/work units are not required to provide domestic hot water metering at each dwelling unit where domestic hot water is metered separately for each of the following building end uses:

1. Dwelling units.
2. Sleeping units.
3. Commercial kitchens.
- ~~4. Central laundries.~~

Commented [BK(195)]
W110-2018

C404.10 Drain water heat recovery units. Drain water heat recovery units shall comply with CSA B55.2. Potable waterside pressure loss shall be less than 10 psi (69 kPa) at maximum design flow. For Group R occupancies, the efficiency of drain water heat recovery unit efficiency shall be in accordance with CSA B55.1.

C404.11 Energy consumption of pools and permanent spas ~~(Mandatory).~~ The energy consumption of pools and permanent spas shall be controlled by the requirements in Sections C404.11.1 through C404.11.4.

C404.11.1 Heaters. Heat pump pool heaters shall have a minimum COP of 4.0 determined in accordance with ASHRAE Standard 146. Other pool heating equipment shall comply with the applicable efficiencies in Section C404.2.

The electric power to all heaters shall be controlled by a readily accessible on-off switch that is an integral part of the heater, mounted on the exterior of the heater, or external to and within 3 feet of the heater in a location with ready access. Operation of such switch shall not change the setting of the heater thermostat. Such switches shall be in addition to a circuit breaker for the power to the heater. Gas fired heaters shall not be equipped with constant burning pilot lights.

C404.11.2 Time switches. Time switches or other control method that can automatically turn off and on heaters and pump motors according to a preset schedule shall be installed for heaters and pump motors. Heaters and pump motors that have built in time switches shall be in compliance with this section.

Exceptions:

1. Where public health standards require 24-hour pump operation.
2. Pumps that are required to operate solar- and waste-heat-recovery pool heating systems.

C404.11.3 Covers. Heated pools and in-ground permanent spas shall be provided with a vapor-retardant cover on or at the water surface. Pools heated to more than 90°F shall have a pool cover with a minimum insulation value of R-12, and the sides and bottom of the pool shall also have a minimum insulation value of R-12.

C404.11.4 Heat recovery. Heated indoor swimming pools, spas or hot tubs with water surface area greater than 200 square feet shall provide for energy conservation by an exhaust air heat recovery system that heats ventilation air, pool water or domestic hot water. The heat recovery system shall be configured to decrease the exhaust air temperature at design heating conditions (80°F indoor) by 36°F (10°C).

Exception: Pools, spas or hot tubs that include system(s) that provide equivalent recovered energy on an annual basis through one of the following methods:

1. ~~Renewable energy~~ Solar water heating systems not claimed in Section C406.5 or Section C407;
2. Dehumidification heat recovery;
3. Waste heat recovery; or

Commented [BK(196)]
G004-2018

4. A combination of these system sources capable of and configured to provide at least 70 percent of the heating energy required over an operating season.

C404.12 Energy consumption of portable spas (Mandatory). The energy consumption of electric-powered portable spas shall be controlled by the requirements of APSP 14.

~~**C404.13 Service water heating system commissioning and completion requirements.** Service water heating systems, swimming pool water heating systems, spa water heating systems and the controls for those systems shall be commissioned and completed in accordance with Section C408.~~

C404.13 Service water pressure-booster systems. Service water pressure-booster systems shall be designed and configured such that the following apply:

Commented [BK(197)]
M100-2018

1. One or more pressure sensors shall be used to vary pump speed and/or start and stop pumps. The sensors shall either be located near the critical fixtures that determine the pressure required, or logic shall be employed that adjusts the set point to simulate operations of remote sensors.
2. No devices shall be installed for the purpose of reducing the pressure of all of the water supplied by any booster system pump or booster system, except for safety devices.
3. Booster system pumps shall not operate when there is no service water flow except to refill hydro pneumatic tanks.
4. Systems pump motors 7.5 hp and greater shall be provided with variable flow capacity in accordance with Section C403.2.3.

C404.14 Commissioning. Service water heating systems shall be commissioned in accordance with Section C408.

Commented [BK(198)]
C147-2018

SECTION C405 ELECTRICAL POWER AND LIGHTING SYSTEMS

C405.1 General (Mandatory). This section covers lighting system controls, the maximum lighting power for interior and exterior applications, electrical energy consumption, vertical and horizontal transportation systems, and minimum efficiencies for motors and transformers.

~~**Exception:** Dwelling units within commercial buildings shall not be required to comply with Sections C405.2 through C405.5 provided that they multi-family buildings shall comply with Section R404.1. All other dwelling units shall comply with Section R404.1, or with Sections C405.2.5 and C405.4. No less than 90 percent of the permanently installed lighting serving dwelling units shall be provided by lamps with an efficacy of not less than 60 lumens per watt or luminaires with an efficacy of not less than 55 lumens per watt, or comply with Sections C405.2.4 and C405.3. Dwelling units within multi-family residential occupancies shall comply with this section. All other dwelling units in dormitory, hotel and other residential occupancies that are not classified as multi-family residential occupancies shall comply with Section C405.2.5 and with this section or Section C405.4. No less than 90 percent of the permanently installed lighting serving dwelling units or sleeping units shall be provided by lamps with an efficacy of not less than 60 lumens per watt or luminaire with an efficacy of not less than 55 lumens per watt. Sleeping units shall comply with Section C405.2.5, and with Section R404.1 or C405.4.~~

Commented [BK(199)]
L111-2018

Lighting installed in walk-in coolers, walk-in freezers, refrigerated warehouse coolers and refrigerated warehouse freezers shall comply with the lighting requirements of Section C410.2.

Transformers, motors and electrical power processing equipment in data center systems shall comply with Section 8 of ASHRAE Standard 90.4, including appendices a, b, c and d in addition to this code.

Commented [BK(200)]
L112-2018

C405.2 Lighting controls (Mandatory). Lighting systems shall be provided with controls as specified in Sections C405.2.1 through C405.2.8 that comply with one of the following:

Commented [BK(201)]
M051-2018

1. Lighting controls as specified in Sections C405.2.1 through C405.2.8.
2. Luminaire level lighting controls (LLLC) and lighting controls as specified in Sections C405.2.1, C405.2.3 and C405.2.5. The LLLC luminaire shall be independently configured to:
 - 2.1. Monitor occupant activity to brighten or dim lighting when occupied or unoccupied, respectively.
 - 2.2. Monitor ambient light, both electric and daylight, and brighten or dim artificial light to maintain desired light level.
 - 2.3. For each control strategy, configuration and re-configuration of performance parameters including: bright and dim setpoints, timeouts, dimming fade rates, sensor sensitivity adjustments, and wireless zoning configuration.

Exception: Except for specific application controls required by Section C405.2.5, lighting controls are not required for the following:

1. Areas designated as security or emergency areas that are required to be continuously lighted.
2. Interior exit stairways, interior exit ramps and exit passageways. Means of egress illumination serving the exit access that does not exceed 0.02 watts per square foot of building area is exempt from this requirement.

Commented [BK(202)]
L113-2018

3. Emergency egress lighting that is normally off.
4. Industrial or manufacturing process areas, as may be required for production and safety.
5. ~~Luminaire-level lighting controls (LLLC) that control interior lighting. The LLLC luminaire shall be independently configured to:~~
 - 5.1. ~~Monitor occupant activity to brighten or dim its lighting when occupied or unoccupied, respectively.~~
 - 5.2. ~~Monitor ambient light (both electric light and daylight) and brighten or dim electric light to maintain desired light level.~~
 - 5.3. ~~Configuration and reconfiguration of performance parameters, including bright and dim setpoints, time-outs, dimming, fade rates, sensor sensitivity adjustments, and wireless zoning configurations, for each control strategy.~~
 - 5.4.4.1. ~~Meet the operational and commissioning requirements of Sections C405.2.1, C405.2.2, C405.2.3, C405.2.4, and C408.~~

C405.2.1 Occupancy-Occupant sensor controls. ~~Occupancy-Occupant~~ sensor controls shall be installed to control lights in the following space types:

1. Classrooms/lecture/training rooms.
2. Conference/meeting/multipurpose rooms.
3. Copy/print rooms.
4. Lounge/~~breakrooms~~.
5. ~~Employee lunch and break rooms~~ Enclosed offices.
6. ~~Private-Open plan~~ office areas.
7. Restrooms.
8. Storage rooms.
9. ~~Janitorial closets.~~
- 10.9. Locker rooms.
- 11.10. Other spaces 300 square feet (28 m²) or less that are enclosed by floor-to- ceiling height partitions.
11. Warehouse ~~spaces~~ storage areas.
12. Enclosed fire rated stairways.
13. Service corridors.
- 12.14. Covered parking areas.

Occupant sensor controls in warehouse storage areas, stairways, corridors and library stacks shall comply with Section C405.2.1.1. Occupant sensor controls in open plan office areas shall comply with Section C405.2.1.3. Occupant sensor controls in covered parking areas shall comply with Section C405.2.1.4. Occupant sensor controls for all other spaces shall comply with Section C405.2.1.1.

Exceptions.

1. Corridors in manufacturing facilities.
2. ~~For each of the following space types, when under 300 square feet, Digital timer switch controls may be provided in lieu of occupant sensor controls in the following space types if under 300 square feet: copy/print rooms, storage rooms, janitorial closets~~

Digital timer switches shall comply with the following:

- 2.1. Turn lights on or off with operation of a button, switch or other manual means.
- 2.2. Automatically turn lights off within 15 minutes of the lights being turned on. The means for setting the time delay shall not be visible on the front of the switch.
- 2.3. The switch shall provide both audible and visual indication of impending time-out of the switch. Audible and visual indication shall be given at least once within five minutes of time-out of the switch. Visual indication shall consist of turning the lights momentarily off, and then back on.

C405.2.1.1 Occupant sensor control function. Occupant sensor controls ~~in warehouses shall comply with Section C405.2.1.2. Occupant sensor controls for open plan office areas shall comply with Section C405.2.1.3. Occupant sensor controls for all other spaces specified in Section C405.2.1~~ shall comply with all of the following:

1. ~~They shall be configured to~~ automatically turn off lights within ~~30-20~~ minutes of all occupants leaving the space.
2. ~~They shall~~ be manual on or shall be ~~controlled configured~~ to automatically turn the lighting on to not more than 50 percent power.

Exception: Full automatic-on controls shall be permitted to control lighting in public corridors, stairways, restrooms, primary building entrance areas and lobbies, and areas where manual-on operation would endanger the safety or security of the room or building occupants.

3. ~~They~~ shall incorporate a manual control to allow occupants to turn lights off.

Commented [BK(203)]
L113-2018

Commented [BK(204)]
L113-2018

Commented [BK(205)]
L113-2018

Commented [BK(206)]
L113-2018

Commented [BK(207)]
L113-2018

Commented [BK(208)]
L113-2018

C405.2.1.2 Occupant sensor control function in warehouses, storage areas and service corridors. ~~In warehouses, the lighting in aiseways and open areas shall be controlled with occupant sensors that automatically reduce lighting power by not less than 50 percent when the areas are unoccupied. The occupancy sensor shall control lighting in each aisleway independently, and shall not control lighting beyond the aisleway being controlled by the sensor. Occupant sensor controls shall be configured to comply with all of the following:~~

1. ~~Automatically reduce lighting power by not less than 50 percent within 20 minutes of all occupants leaving the area.~~
2. ~~Control lighting in each aisleway and corridor independently, and shall not control lighting beyond the aisleway or corridor being controlled by the sensor.~~
3. ~~Automatically turn lighting off within 20 minutes of all occupants leaving the space, or comply with Section C405.2.2 to turn lighting off when the building is vacant.~~
4. ~~Restore lighting to full power when occupants enter the space.~~

Commented [BK(209)]
L113-2018

C405.2.1.3 Occupant sensor control function in open plan office areas. ~~Occupant sensor controls in open plan office spaces less than 300 square feet (28 m²) in area shall comply with Section C405.2.1.1. Occupant sensor controls in all other open plan office spaces shall be configured to comply with all of the following:~~

1. ~~The controls shall be configured so that General lighting can be is controlled separately in control zones with floor areas not greater than 600 square feet (55m²) within the open plan office space.~~
2. ~~The controls shall automatically turn off general lighting in all control zones within 20 minutes after all occupants have left the open plan office space.~~
3. ~~The controls shall be configured so that General lighting power in each control zone is reduced by not less than 80 percent of the full zone general lighting power in a reasonably uniform illumination pattern within 20 minutes of all occupants leaving that control zone. Control functions that switch control zone lights completely off when the zone is vacant/unoccupied meet this requirement.~~
- a.4. ~~The controls shall be configured such that any Daylight responsive controls will activate open plan office space general lighting or control zone general lighting only when occupancy for the same area is detected.~~

Commented [BK(210)]
L113-2018

Commented [BK(211)]
L113-2018

Commented [BK(212)]
L113-2018

Commented [BK(213)]
L113-2018

Commented [BK(214)]
L113-2018

Commented [BK(215)]
L113-2018

Commented [BK(216)]
L113-2018

C405.2.1.4 Occupant sensor control function in parking garages. ~~Occupant sensor controls shall be configured to comply with all of the following:~~

1. ~~Lighting power of each luminaire shall be automatically reduced by a minimum of 30 percent when there is no vehicle or pedestrian activity detected within a lighting zone for 20 minutes. Lighting zones for this requirement shall be no larger than 3600 square feet.~~

Exceptions:

1.1 ~~Lighting in daylight transition zones and ramps without parking.~~

1.2 ~~Covered parking garages with a total lighting power less than 0.07 watts per square foot.~~

2. ~~Automatically turn all the lighting off within 20 minutes of all occupants leaving the space and restore lighting to full power when occupants enter the space, or comply with Section C405.2.2 to turn lighting off when building is vacant.~~

Commented [BK(217)]
L113-2018

C405.2.1.5 Occupant sensor control function in enclosed fire rated stairways. ~~Occupant sensor controls shall be configured to automatically reduce lighting power by not less than 50 percent when no occupants have been detected in the stairway for a period not exceeding 20 minutes and restore lighting to full power when occupants enter the stairway. All portions of stairways shall remain illuminated to meet the requirements of Section 1009 of the International Building Code when the lighting power is reduced.~~

Commented [BK(218)]
L113-2018

C405.2.2 Time switch controls. ~~Each area of the building that is not provided with occupant sensor controls complying with Section C405.2.1.1 or digital timer switch controls complying with Section C405.2.6-1 shall be provided with time switch controls complying with Section C405.2.2.1.~~

Exception: ~~Where a manual control provides light reduction in accordance with Section C405.2.2.2, automatic controls-time-switch controls shall not be required for the following:~~

1. ~~Sleeping units.~~
2. Spaces where patient care is directly provided.
3. Spaces where an automatic shutoff would endanger occupant safety or security.
4. Lighting intended for continuous operation.
5. Shop and laboratory classrooms.

C405.2.2.1 Time switch control function. ~~Each space provided with time switch controls shall also be provided with a manual control for light reduction in accordance with Section C405.2.2.2. Time switch controls shall comply with the following:~~

1. Have a minimum 7 day clock.

2. Be capable of being set for 7 different day types per week.
3. Incorporate an automatic holiday "shut-off" feature, which turns off all controlled loads for at least 24 hours and then resumes normally scheduled operations.
4. Have program back-up capabilities, which prevent the loss of program and time settings for at least 10 hours, if power is interrupted.
5. Include an override switching device that complies with the following:

4.1.5.1 The override switch shall be a manual control.

4.2.5.2 The override switch, when initiated, shall permit the controlled lighting to remain on for not more than 2 hours.

5.3 Any individual override switch shall control the lighting for an area not larger than 5,000 square feet (465 m²).

5.6. Time switch controls are allowed to automatically turn on lighting to full power in corridors, lobbies, restrooms, storage rooms less than 50 square feet, and medical areas of healthcare facilities. In all other spaces, time switch controls are allowed to automatically turn on the lighting to not more than 50 percent power.

Exceptions: Within ~~malls, arcades~~ small concourses, auditoriums, ~~single tenant retail spaces~~ sales areas, ~~industrial-manufacturing~~ facilities and ~~sports~~ arenas:

~~a.1.1.~~ The time limit shall be permitted to be greater than 2 hours provided the ~~override~~ switch is a captive key device.

~~b.1.2.~~ The area controlled by the override switch ~~is permitted to be greater than shall not be limited to~~ 5,000 square feet (465 m²); ~~but shall not be greater than~~ provided that such area is less than 20,000 square feet (1860 m²).

~~2. Where provided with manual control, the following areas are not required to have light reduction control:~~

~~a. Spaces that have only one luminaire with a rated power of less than 100 watts.~~

~~b. Spaces that use less than 0.6 watts per square foot (6.5 W/m²).~~

~~c. Corridors, equipment rooms, public lobbies, electrical or mechanical rooms.~~

C405.2.2.2 Light reduction controls. ~~Spaces required to have light reduction controls shall have a manual control that allows the occupant to reduce the connected lighting load in a reasonably uniform illumination pattern by at least 50 percent. Lighting reduction shall be achieved by one of the following approved methods:~~

~~1. Controlling all lamps or luminaires.~~

~~2. Dual switching of alternate rows of luminaires, alternate luminaires or alternate lamps.~~

~~3. Switching the middle lamp luminaires independently of the outer lamps.~~

~~4. Switching each luminaire or each lamp.~~

~~1. Exception: Light reduction controls are not required in daylight zones with daylight responsive controls complying with Section C405.2.4.~~

C405.2.3 Manual controls. ~~Where required by this code, All lighting shall have manual controls for lights shall complying with the following:~~

~~1. They shall be readily accessible in a location with ready access to occupants.~~

~~2. They shall be located where the controlled lights are visible, or shall identify the area served by the lights and indicate their status.~~

~~2.3. Each control device shall control an area no larger than a single room, or 2500 square feet if the room area is less than or equal to 10,000 square feet, or 10,000 square feet if the room area is greater than 10,000 square feet.~~

Exceptions:

~~1. A manual control may be installed in a remote location for the purpose of safety or security provided each remote control device has an indicator pilot light as part of or next to the control device and the light is clearly labeled to identify the controlled lighting.~~

~~2. Restrooms.~~

C405.2.3.1 Light reduction controls. ~~Spaces required to have light reduction controls shall have a Manual controls shall be configured to provide light reduction control that allows the occupant to reduce the connected lighting load between 30 percent to 70 percent in a reasonably uniform illumination pattern by at least 50 percent. Lighting reduction shall be achieved by one of the following approved methods:~~

~~5.1.~~ Controlling all lamps or luminaires.

~~6.2.~~ Dual switching of alternate rows of luminaires, alternate luminaires or alternate lamps.

~~7.3.~~ Switching the middle lamp luminaires independently of the outer lamps.

Commented [BK(219)]
L113-2018

Commented [BK(220)]
L113-2018

Commented [BK(221)]
L113-2018 - moved to C405.2.3.1

Commented [BK(222)]
L113-2018

Commented [BK(223)]
L113-2018

Commented [BK(224)]
L113-2018

8.4. Switching each luminaire or each lamp.

Exceptions:

1. Light reduction controls are not required in daylight zones with *daylight responsive controls* complying with Section C405.2.4.
2. ~~Where provided with manual control, the following areas are not required to have light reduction control:~~
 - 2.1. ~~Spaces that have only one luminaire with a rated power of less than 100 watts.~~
 - 2.2. ~~Spaces that use less than 0.6 watts per square foot (6.5 W/m²).~~
 - 2.3. ~~Lighting in corridors, lobbies, electrical rooms, restrooms, storage rooms, airport concourse baggage areas, dwelling and sleeping rooms and mechanical rooms.~~

Commented [BK(225)]
1113-2018

C405.2.4 Daylight responsive controls. *Daylight responsive controls* complying with Section C405.2.4.1 shall be provided to control the lighting within *daylight zones* in the following spaces:

1. ~~Sidelight~~ ~~Sidelit~~ ~~daylight~~ zones as defined in Section C405.2.4.2 with more than two general lighting fixtures within the ~~combined~~ primary and secondary ~~sidelight-sidelit~~ daylight zones.
2. ~~Toplight~~ ~~Toplit~~ ~~daylight~~ zones as defined in Section C405.2.4.3 with more than two general lighting fixtures within the daylight zone.

Commented [BK(226)]
L116-2018

Exception: Daylight responsive controls are not required for the following:

1. Spaces in health care facilities where patient care is directly provided.
2. ~~Dwelling units and sleeping units.~~
3. Lighting that is required to have specific application control in accordance with Section C405.2.5.
4. ~~Sidelight~~ ~~Sidelit~~ ~~daylight~~ zones on the first floor above grade in Group A-2 and Group M occupancies.
5. Daylight zones where the total proposed lighting power density is less than 35 percent of the lighting power allowance per Section C405.4.2.
6. ~~New buildings where the total connected lighting power calculated under Section C405.4.1 is not greater than the adjusted interior lighting power allowance (LPA_{adj}) calculated in accordance with Equation 4-9:~~

$$LPA_{adj} = LPA_{norm} - (1.0 - 0.4 \times UDZFA/TBFA) \quad \text{(Equation 4-9)}$$

~~Where:~~

~~LPA_{adj} = Adjusted building interior lighting power allowance in watts~~

~~LPA_{norm} = Normal building lighting power allowance in watts calculated in accordance with Section C405.4.2 and reduced in accordance with Section C406.3 when Option 2 is used to comply with the requirements of Section C406~~

~~UDZFA = Uncontrolled daylight zone floor area is the sum of all sidelit and toplit zones, calculated in accordance with Sections C405.2.4.2 and C405.2.4.3, that do not have daylight responsive controls~~

~~TBFA = Total building floor area is the sum of all floor areas included in the lighting power allowance calculation in Section C405.4.2~~

C405.2.4.1 Daylight responsive controls function. Where required, daylight responsive controls shall be provided within each space for control of lights in that space and shall comply with all of the following:

1. Lights in primary ~~sidelight-sidelit~~ ~~daylight~~ zones shall be controlled independently of lights in secondary ~~sidelight-sidelit~~ ~~daylight~~ zones in accordance with Section C405.2.4.2.

Exception: Spaces enclosed by walls or ceiling height partitions with no more than three general lighting fixtures may have combined daylight zone control of primary and secondary daylight zones provided *uniform illumination* can be achieved.

2. Lights in ~~toplight-toplit~~ ~~daylight~~ zones in accordance with Section C405.2.4.3 shall be controlled independently of lights in ~~sidelight-sidelit~~ ~~daylight~~ zones in accordance with Section C405.2.4.2.
3. Daylight responsive controls within each space shall be configured so that they can be calibrated from within that space by authorized personnel.
4. Calibration mechanisms shall be ~~readily accessible~~ ~~in a location with ready access~~.
5. Daylight responsive controls shall be configured to completely shut off all controlled lights in that zone.
6. Lights in ~~sidelight-sidelit~~ ~~daylight~~ zones in accordance with Section C405.2.4.2 facing different cardinal orientations (i.e., within 45 degrees of due north, east, south, west) shall be controlled independently of each other.

Exception: Up to two light fixtures in each space are permitted to be controlled together with lighting in a daylight zone facing a different cardinal orientation.
7. Incorporate time-delay circuits to prevent cycling of light level changes of less than three minutes.

8. The maximum area a single daylight responsive control device serves shall not exceed 2,500 square feet (232 m²).
9. Occupant override capability of daylight dimming controls is not permitted, other than a reduction of light output from the level established by the daylighting controls.

C405.2.4.1.1 Dimming. *Daylight responsive controls* shall be configured to automatically reduce the power of *general lighting* in the *daylight zone* in response to available daylight, while maintaining *uniform illumination* in the space through one of the following methods:

1. Continuous dimming using dimming ballasts/dimming drivers and daylight-sensing automatic controls. The system shall reduce lighting power continuously to less than 15 percent of rated power at maximum light output.
2. Stepped dimming using multi-level switching and daylight-sensing controls. The system shall provide a minimum of two steps of uniform illumination between 0 and 100 percent of rated power at maximum light output. Each step shall be in equal increments of power, plus or minus 10 percent.

General lighting within daylight zones in offices, classrooms, laboratories and library reading rooms shall use the continuous dimming method. Stepped dimming is not allowed as a method of daylight zone control in these spaces.

C405.2.4.2 Sidelight daylight Sidelit zone. The ~~sidelight daylight zone~~ sidelit zone is the floor area adjacent to *vertical fenestration* which complies with the following:

1. Where the *fenestration* is located in a wall, the sidelit zone includes the primary and secondary daylight zones. The primary daylight zone shall extend laterally to the nearest full height wall, or up to 1.0 times the height from the floor to the top of the fenestration, and longitudinally from the edge of the fenestration to the nearest full height wall, or up to 2 feet (610 mm), whichever is less, as indicated in Figure C405.2.4.2(1). The secondary daylight zone begins at the edge of the primary daylight zone and extends laterally to the nearest full height wall, or up to 2.0 times the height from the floor to the top of the fenestration, whichever is less, as indicated in Figure C405.2.4.2(1).
- ~~2. Where the fenestration is located in a rooftop monitor, the sidelight daylight zone shall extend laterally to the nearest obstruction that is taller than 0.7 times the ceiling height, or up to 1.0 times the height from the floor to the bottom of the fenestration, whichever is less, and longitudinally from the edge of the fenestration to the nearest obstruction that is taller than 0.7 times the ceiling height, or up to 0.25 times the height from the floor to the bottom of the fenestration, whichever is less, as indicated in Figures C405.2.4.2(2) and C405.2.4.2(3).~~
- ~~3.2.~~ Where *clerestory fenestration* is located in a wall, the sidelit zone includes a lateral area twice the depth of the clerestory fenestration height, projected upon the floor at a 45 degree angle from the center of the clerestory fenestration. The longitudinal width of the daylight-sidelit zone is calculated the same as for fenestration located in a wall. Where the 45 degree angle is interrupted by an obstruction greater than 0.7 times the ceiling height, the daylight zone shall remain the same lateral area but be located between the clerestory and the obstruction, as indicated in Figure C405.2.4.2(2).
- ~~4.3.~~ If the rough opening area of a vertical fenestration assembly is less than 10 percent of the calculated primary daylight-sidelit zone area for this fenestration, it does not qualify as a daylight-sidelit zone.
- ~~5.4.~~ ~~Where located in existing buildings,~~ The visible transmittance of the fenestration is no less than 0.20.
- ~~6.5.~~ In parking garages with floor area adjacent to perimeter wall openings, the daylight-sidelit zone shall include the area within 20 feet of any portion of a perimeter wall that has a net opening to wall ratio of at least 40 percent.

C405.2.4.3 Toplight daylight Toplit zone. The ~~toplight daylight zone~~ toplit zone is the floor area underneath a roof fenestration assembly which complies with the following:

1. The ~~toplight daylight~~ toplit zone shall extend laterally and longitudinally beyond the edge of the roof fenestration assembly to the nearest obstruction that is taller than 0.7 times the ceiling height, or up to 0.7 times the ceiling height, whichever is less, as indicated in Figure C405.2.4.3(1).
- ~~2.~~ Where the fenestration is located in a rooftop monitor, the toplit zone shall extend laterally to the nearest obstruction that is taller than 0.7 times the ceiling height, or up to 1.0 times the height from the floor to the bottom of the fenestration, whichever is less, and longitudinally from the edge of the fenestration to the nearest obstruction that is taller than 0.7 times the ceiling height, or up to 0.25 times the height from the floor to the bottom of the fenestration, whichever is less, as indicated in Figures C405.2.4.3(2) and C405.2.4.3(3).
- ~~2.3.~~ Where ~~toplight daylight~~ toplit zones overlap with ~~sidelight daylight~~ sidelit zones, lights within the overlapping area shall be assigned to the toplit ~~daylight~~ toplit zone.
- ~~3.4.~~ ~~Where located in existing buildings,~~ The product of the *visible transmittance* of the roof fenestration assembly and the area of the rough opening of the roof fenestration assembly, divided by the area of the daylight-toplit zone is no less than 0.008.
- ~~4.5.~~ Where located under atrium fenestration, the daylight-toplit zone shall include the bottom floor area directly beneath the atrium fenestration, and the top floor directly under the atrium fenestration, as indicated in Figure

C405.2.4.3(4). The ~~daylight toplit~~ zone area at the top floor is calculated the same as for a ~~toplight daylight~~ toplit zone. Intermediate levels below the top floor that are not directly beneath the atrium are not included.

FIGURE C405.2.4.2(1)
DAYLIGHT SIDELIT ZONE ADJACENT TO FENESTRATION IN A WALL

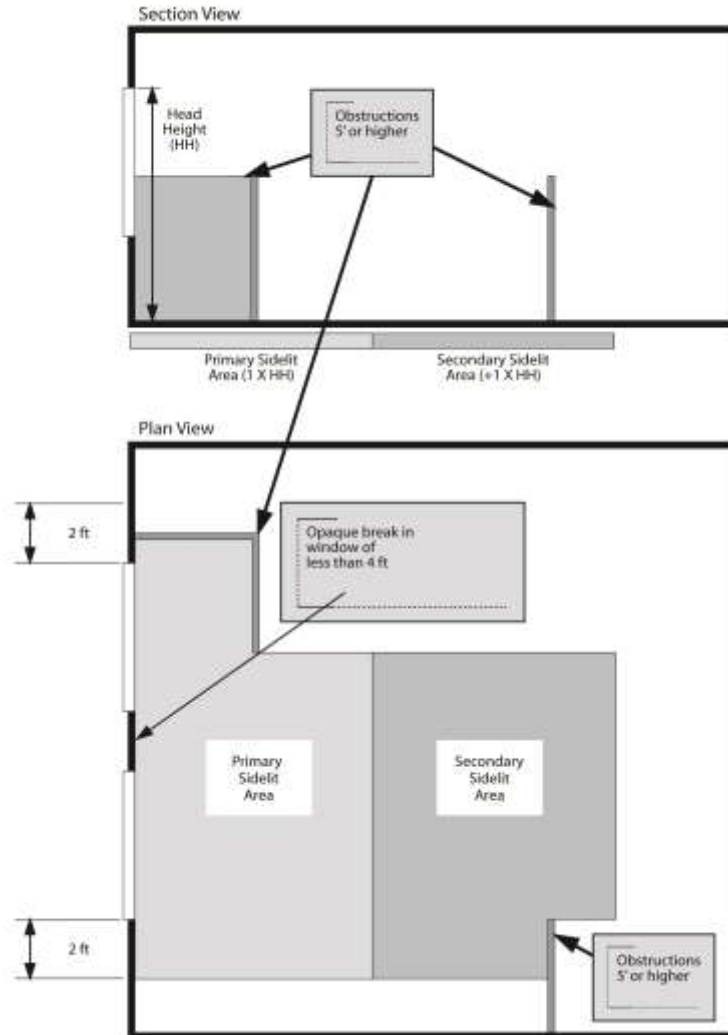


FIGURE C405.2.4.2(42)
DAYLIGHT SIDELIT ZONE ADJACENT TO CLERESTORY FENESTRATION IN A WALL

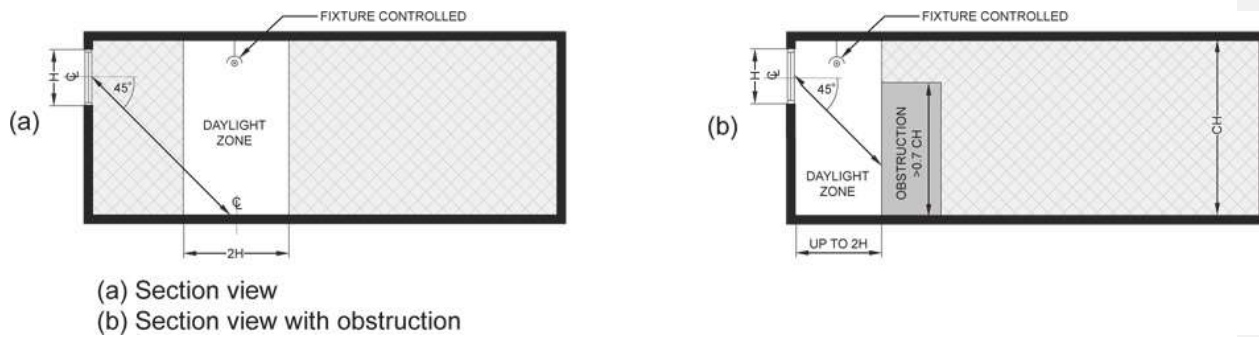


FIGURE C405.2.4.3(1)
DAYLIGHT-TOPLIT ZONE UNDER A ROOFTOP FENESTRATION ASSEMBLY

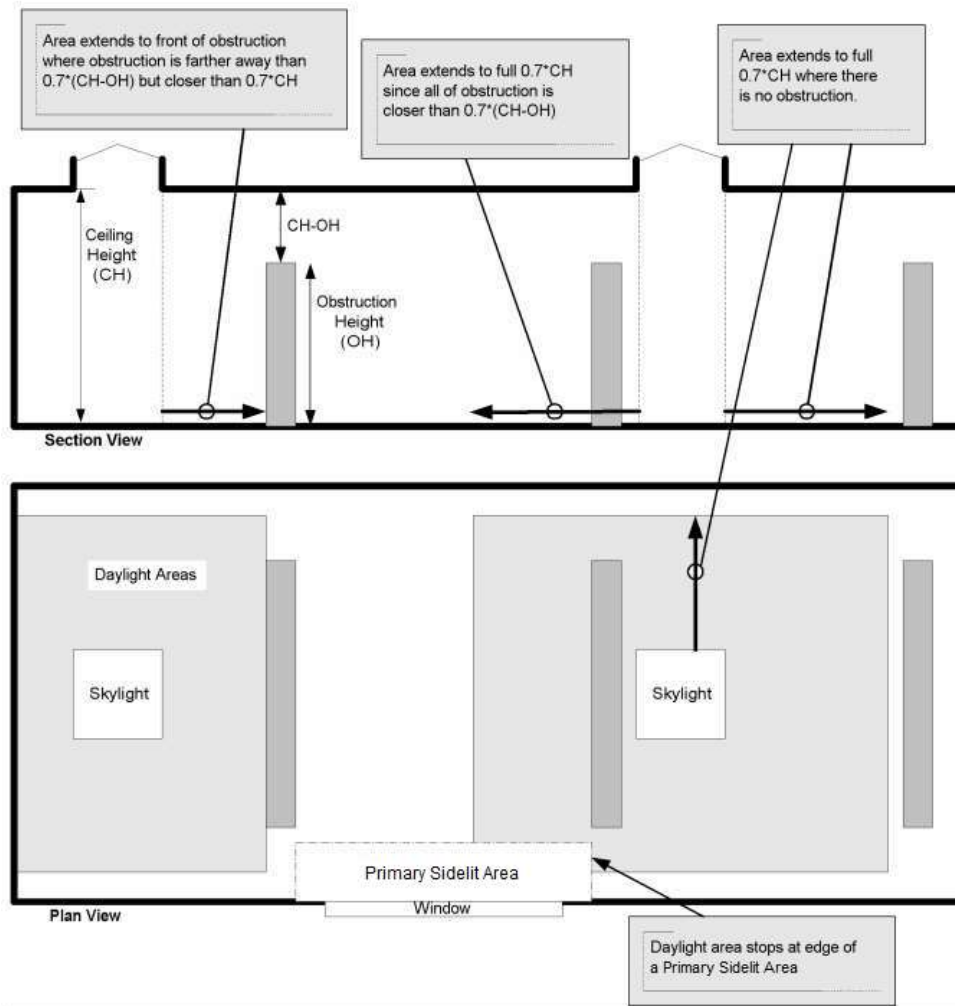


FIGURE C405.2.4.23(2)
DAYLIGHT-TOPLIT ZONE UNDER A ROOFTOP MONITOR

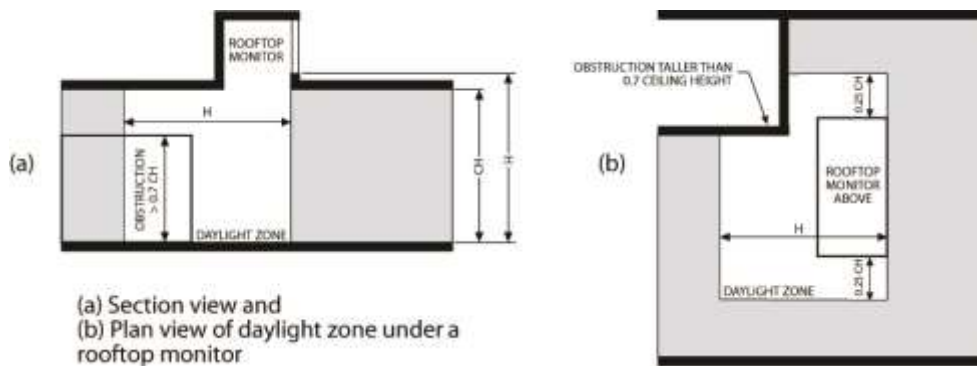


FIGURE C405.2.4.2(3)
DAYLIGHT-TOPLIT ZONE UNDER A SLOPED ROOFTOP MONITOR


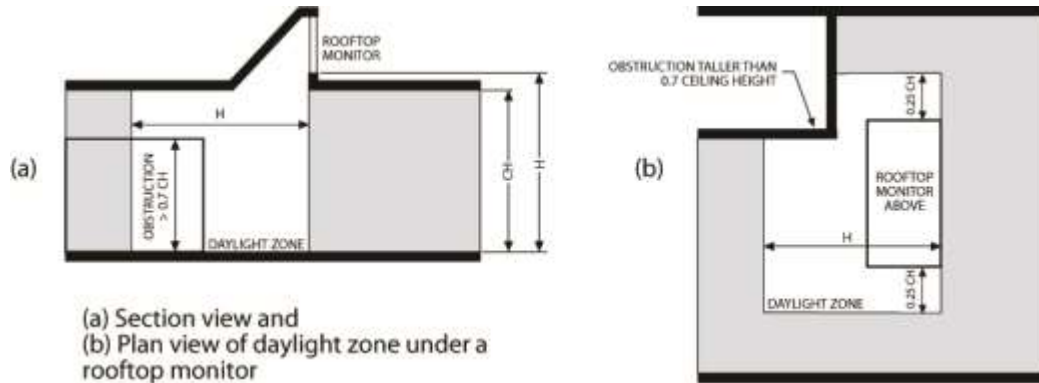


FIGURE C405.2.4.3(24)
DAYLIGHT-TOPLIT ZONE UNDER ATRIUM FENESTRATION

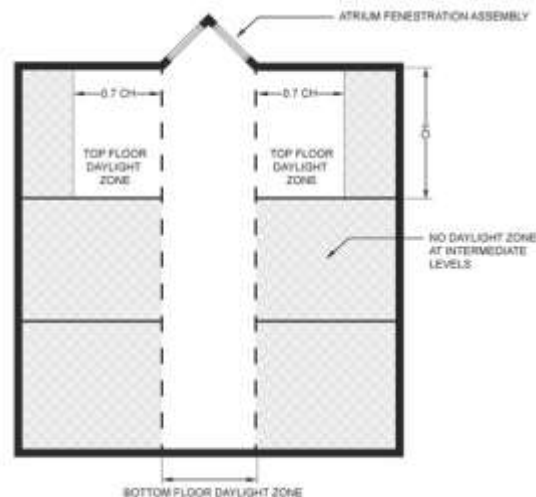

C405.2.5 Additional lighting controls. Specific application lighting shall be provided with controls, in addition to controls required by other sections, for the following:

1. ~~Display and accent light shall be controlled by a dedicated control that is independent of the controls for other lighting within the room or space.~~ The following lighting shall be controlled by an occupant sensor complying with Section C405.2.1.1 or a time-switch control complying with Section C405.2.2.1. In addition, a manual control shall be provided to control such lighting separately from the general lighting in the space:
 - 1.1. Display and accent.
 - 1.2. Lighting in display cases.
 - 1.3. Supplemental task lighting, including permanently installed under-shelf or under-cabinet lighting.
 - 1.4. Lighting equipment that is for sale or demonstration in lighting education.
2. ~~Lighting in cases used for display case purposes shall be controlled by a dedicated control that is independent of the controls for other lighting within the room or space.~~

~~3.2. Hotel and motel sleeping units and guest suites~~ shall have control devices or systems configured to automatically switch off all permanently installed luminaires and switched receptacles within 20 minutes after all occupants ~~leave the room~~ have left the unit.

Exceptions: 1. Lighting and switched receptacles controlled by ~~eaptive-card~~ key ~~controls~~ systems.

2. Spaces where patient care is directly provided.

3. Permanently installed luminaires within dwelling units shall be provided with controls complying with either Section C405.2.1.1 or C405.2.2.2.

~~4. Supplemental task lighting, including permanently installed under shelf or under cabinet lighting, shall be automatically shut off whenever that space is unoccupied and shall have a control device integral to the luminaires or be controlled by a wall-mounted control device provided that the control device is readily accessible in a location with ready access.~~

5. Lighting for nonvisual applications, such as plant growth and food warming, shall be controlled by a dedicated control that is independent of the controls for other lighting within the room or space. Each control zone shall be no greater than the area served by a single luminaire or 4,000 square feet, whichever is larger.

~~6. Lighting equipment that is for sale or for demonstrations in lighting education shall be controlled by a dedicated control that is independent of the controls for other lighting within the room or space.~~

~~7.6.~~ Luminaires serving the exit access and providing means of egress illumination required by Section 1006.1 of the *International Building Code*, including luminaires that function as both normal and emergency means of egress illumination shall be controlled by a combination of listed emergency relay and occupancy sensors, or signal from another building control system, that automatically shuts off the lighting when the areas served by that illumination are unoccupied.

Exception: Means of egress illumination serving the exit access that does not exceed 0.02 watts per square foot of building area is exempt from this requirement.

C405.2.6 ~~Reserved. Digital timer switch.~~ For each of the following space types, when under 300 square feet, digital timer switch controls may be provided in lieu of occupancy sensor controls:

- ~~1. Copy/print rooms.~~
- ~~2. Storage rooms.~~
- ~~3. Janitorial closets~~

C405.2.6.1 ~~Digital timer switch function.~~ Digital timer switches shall comply with the following:

- ~~1. Turn lights on or off with operation of a button, switch or other manual means.~~
- ~~2. Automatically turn lights off within 15 minutes of the lights being turned on. The means for setting the time delay shall not be visible on the front of the switch.~~
- ~~3.1. The switch shall provide both audible and visual indication of impending time out of the switch. Audible and visual indication shall be given at least once within five minutes of time out of the switch. Visual indication shall consist of turning the lights momentarily off, and then back on.~~

C405.2.7 Exterior lighting controls. ~~Lighting for exterior applications other than emergency lighting that is intended to be automatically off during building operation, lighting specifically required to meet health and life safety requirements, or decorative gas lighting systems shall~~ Exterior lighting systems shall be provided with controls that comply with Sections C405.2.7.1 through C405.2.7.4. Decorative lighting systems shall comply with Sections C405.2.7.1, C405.2.7.2 and C405.2.7.4.

~~1. Be provided with a control that automatically turns off the lighting as a function of available daylight.~~

~~2.1. Where lighting the building facade or landscape, the lighting shall have controls that automatically shut off the lighting as a function of dawn/dusk and a set opening and closing time.~~

~~3.1. Where not covered in Item 2, the lighting shall have controls configured to automatically reduce the connected lighting power by at least 30 percent from no later than 12 midnight to 6 a.m. or from one hour after business closing to one hour before business opening or during any period when no activity has been detected for a time of no longer than 15 minutes.~~

~~Time switches shall be capable of retain programming and the time setting during loss of power for a period of at least 10 hours.~~

Exceptions:

1. Lighting for covered vehicle entrances or exits from buildings or parking structures where required for safety, security or eye adaption.
2. Lighting controlled from within dwelling units.

C405.2.7.1 Daylight shutoff. Lights shall be ~~Be provided with a control that a~~ configured to automatically ~~turns turn~~ off the lighting as a function of available ~~when daylight is present and satisfies the lighting needs.~~

C405.2.7.2 Decorative lighting shutoff. Facade and landscape lighting shutoff. ~~Where lighting the Building facade or and landscape, the lighting shall have controls that be configured to automatically shut off from not later than one hour after business closing to not earlier than one hour before business opening the lighting as a function of dawn/dusk and a set opening and closing time for a minimum of 6 hours per night or from not later than one hour after business closing to not earlier than one hour before business opening, whichever is less.~~

Exception: Areas where an automatic shutoff would endanger safety or security.

C405.2.7.3 Lighting setback. Lighting that is not controlled in accordance with Section C405.2.7.2 shall be controlled ~~Where not covered in Item 2, the lighting shall have controls configured to so that the total wattage of such lighting is automatically reduced the connected lighting power by at least not less than 30 percent by selectively switching off or dimming luminaires at one of the following times:~~

1. ~~From not later than 12 midnight to 6 a.m.~~
2. ~~or From not later than one hour after business closing to not earlier than one hour before business opening.~~
3. ~~or During any period when no activity has been detected for a time of no longer than 15 minutes or more.~~

C405.2.7.4 Exterior time-switch control functions. Time switches controls for exterior lighting shall comply with the following:

1. They shall have a clock capable of being programmed for not fewer than 7 days.
2. They shall be capable of being set for seven different day types per week.
3. They shall incorporate an automatic holiday setback feature.
4. They shall have program backup capabilities that prevent the loss of program and time settings ~~of retain programming and the time setting during loss of power for a period of at least 10 hours in the event that power is interrupted.~~

C405.2.8 Area controls. The maximum lighting power that may be controlled from a single switch or automatic control device shall not exceed that which is provided by a 20 ampere circuit loaded to not more than 80 percent. A master control may be installed provided the individual switches retain their capability to function independently. Circuit breakers may not be used as the sole means of switching.

Exception: Areas less than 5 percent of the building footprint for footprints over 100,000 ft².

C405.3 Exit signs (Mandatory). Internally illuminated exit signs shall not exceed 5 watts per side. **Reserved**

C405.4 Interior lighting power requirements (Prescriptive). A building complies with this section if its total connected interior lighting power calculated under Section C405.4.1 is no greater than the interior lighting power allowance calculated under Section C405.4.2.

C405.4.1 Total connected interior lighting power. The total connected interior lighting power shall be determined in accordance with Equation 4-10.

$$TCLP = [SL + LVL + LTPB + Other] [LVL + BLL + TRK + POE + Other]$$

(Equation 4-10)

Where:

- $TCLP$ = Total connected lighting power (watts)
- SL = Labeled wattage of luminaires for screw-in lamps.
- LVL = Wattage of the transformer supplying low voltage lighting. ~~For luminaires with lamps connected directly to building power, such as line voltage lamps, the rated wattage of the lamp, which must be minimum 60 lumen/watt.~~
- $LTPB$ = ~~Wattage of line voltage lighting tracks and plug-in busways as the specified wattage of the luminaires but at least 50 W/lin. ft., or the wattage limit of the system's circuit breaker, or the wattage limit of other permanent current-limiting devices on the system.~~
- BLL = ~~For luminaires incorporating a ballast or transformer, the rated input wattage of the ballast or transformer when operating the lamp.~~
- TRK = ~~For lighting track, cable conductor, rail conductor and plug-in busway systems that allow the addition and relocation of luminaires without rewiring. The wattage shall be one of the following:~~
1. The specified wattage of the luminaires, but not less than 16 W/lin.

Commented [BK(227)]
L117-2018

Commented [BK(228)]
L117-2018

Commented [BK(229)]
L117-2018

Commented [BK(230)]
L118-2018

Commented [BK(231)]
L119-2018

Commented [BK(232)]
L118-2018

Commented [BK(233)]
L119-2018

ft. (52 W/lin. M).

2. The wattage limit of the permanent current-limiting devices protecting the system.

3. The wattage limit of the transformer supplying the system.

POE = For other modular lighting systems served with power supplied by a driver, power supply or transformer, including but not limited to low-voltage lighting systems, the wattage of the system shall be the maximum rated input wattage of the driver, power supply or transformer published in the manufacturer's catalogs, as specified by UL 2108 or 8750. For power-over-Ethernet lighting systems, power provided to installed non-lighting devices may be subtracted from the total power rating of the power-over-Ethernet system.

Commented [BK(234)]
L119-2018

Other = The wattage of all other luminaires and lighting, sources not covered above and associated with interior lighting verified by data supplied by the manufacturer or other *approved* sources.

Commented [BK(235)]
L119-2018

Exceptions: The connected power associated with the following lighting equipment and applications is not included in calculating total connected lighting power

~~8.1. The connected power associated with the following lighting equipment is not included in calculating total connected lighting power~~ Television broadcast lighting for playing areas in sports arenas:

~~9. Professional sports arena playing field lighting.~~

~~10.2. Emergency lighting automatically off during normal building operation.~~

~~11.3. Lighting in spaces specifically designed for use by occupants with special lighting needs including the visually impaired those with visual impairment and other medical and age-related issues.~~

~~12.4. Casino gaming areas.~~

~~13.5. General area lighting power in industrial and manufacturing occupancies dedicated to the inspection or quality control of goods and products.~~

~~14.6. Lighting in sleeping units, provided that the lighting complies with Section R404.1.~~

~~15.7. Mirror lighting in dressing rooms.~~

~~16. Lighting equipment used for the following shall be exempt provided that it is in addition to general lighting and is controlled by an independent control device:~~

~~17.8. Task lighting for medical and dental purposes that is in addition to general lighting and controlled by an independent control device.~~

~~18.9. Display lighting for exhibits in galleries, museums and monuments that is in addition to general lighting and controlled by an independent control device.~~

~~19.10. Lighting for theatrical purposes, including performance, stage, film production and video production.~~

~~20.11. Lighting for photographic processes.~~

~~21.12. Lighting integral to equipment or instrumentation and is installed by the manufacturer.~~

~~22.13. Task lighting for plant growth or maintenance where the lamp efficacy is not less than 90 lumens per watt.~~

~~23.14. Advertising signage or directional signage.~~

~~24.15. In restaurant buildings and areas, Lighting for food warming or integral to food preparation equipment.~~

~~25.16. Lighting equipment that is for sale.~~

~~26.17. Lighting demonstration equipment in lighting education facilities.~~

~~27.18. Lighting approved because of safety or emergency considerations, inclusive of exit lights.~~

~~28. Lighting integral to both open and glass enclosed refrigerator and freezer cases.~~

~~29.19. Lighting in retail display windows, provided the display area is enclosed by ceiling-height partitions.~~

~~20. Furniture mounted supplemental task lighting that is controlled by automatic shutoff.~~

~~30.21. Exit signs.~~

~~31.22. Lighting used for aircraft painting.~~

C405.4.2 Interior lighting power allowance. The total interior lighting power allowance (watts) is determined according to Table C405.4.2(1) using the Building Area Method, or Table C405.4.2(2) using the Space-by-Space

Method, for all areas of the building covered in this permit.

C405.4.2.1 Building area method. For the Building Area Method, the interior lighting power allowance is the floor area for each building area type listed in Table C405.4.2(1) times the value from Table C405.4.2(1) for that area. For the purposes of this method, an "area" shall be defined as all contiguous spaces that accommodate or are associated with a single building area type as listed in Table C405.4.2(1). Where this method is used to calculate the total interior lighting power for an entire building, each building area type shall be treated as a separate area.

C405.4.2.2 Space-by-space method. For the Space-by-Space Method, the interior lighting power allowance is determined by multiplying the floor area of each space times the value for the space type in Table C405.4.2(2) that most closely represents the proposed use of the space, and then summing the lighting power allowances for all spaces. Tradeoffs among spaces are permitted.

Each area enclosed by partitions that are 80 percent of the ceiling height or taller shall be considered a separate space and assigned the appropriate space type from Table C405.4.2(2). If a space has multiple functions where more than one space type is applicable, that space shall be broken up into smaller subspaces, each using their own space type. Any of these subspaces that are smaller in floor area than 20 percent of the enclosed space and less than 1,000 square feet need not be broken out separately.

C405.4.2.2.1 Additional interior lighting power. Where using the Space-by-Space Method, an increase in the interior lighting power allowance is permitted for specific lighting functions. Additional power shall be permitted only where the specified lighting is installed and automatically controlled separately from the general lighting, to be turned off during nonbusiness hours. This additional power shall be used only for the specified luminaires and shall not be used for any other purpose. An increase in the interior lighting power allowance is permitted for lighting equipment to be installed in sales areas specifically to highlight merchandise. The additional lighting power shall be determined in accordance with Equation 4-11:

$$\text{Additional interior lighting power allowance} = 500 \text{ watts} + (\text{Retail Area 1} \times 0.60.45 \text{ W/ft}^2) + (\text{Retail Area 2} \times 0.60.45 \text{ W/ft}^2) + (\text{Retail Area 3} \times 1.41.05 \text{ W/ft}^2) + (\text{Retail Area 4} \times 2.51.87 \text{ W/ft}^2)$$

(Equation 4-11)

Where:

- Retail Area 1 = The floor area for all products not listed in Retail Area 2, 3 or 4.
- Retail Area 2 = The floor area used for the sale of vehicles, sporting goods and small electronics.
- Retail Area 3 = The floor area used for the sale of furniture, clothing, cosmetics and artwork.
- Retail Area 4 = The floor area used for the sale of jewelry, crystal and china.

Exception: Other merchandise categories are permitted to be included in Retail Areas 2 through 4, provided that justification documenting the need for additional lighting power based on visual inspection, contrast, or other critical display is *approved* by the *code official*.

TABLE C405.4.2(1)
INTERIOR LIGHTING POWER ALLOWANCES: BUILDING AREA METHOD

Building Area Type	LPD (w/ft ²)	LPD (w/ft ²)
Automotive facility	0.64	0.60
Convention center	0.810.76	0.65
Court house	0.81	0.70
Dining: Bar lounge/leisure	0.79	0.79
Dining: Cafeteria/fast food	0.72	0.70
Dining: Family	0.71	0.70

Commented [BK(236)]
L119-2018

Dormitory ^{a,b}	0.46	<u>0.61</u>
Exercise center	0.67 <u>0.65</u>	<u>0.65</u>
Fire station ^a	0.54 <u>0.53</u>	<u>0.53</u>
Gymnasium	0.75 <u>0.68</u>	<u>0.65</u>
Health care clinic	0.70	<u>0.70</u>
Hospital ^a	0.84	<u>0.90</u>
Hotel ^{a,b}	0.70	<u>0.70</u>
Library	0.94 <u>0.78</u>	<u>0.78</u>
Manufacturing facility	0.89	<u>0.89</u>
Motion picture theater	0.61	<u>0.61</u>
Multifamily ^c	0.41	<u>0.41</u>
Museum	0.80	<u>0.80</u>
Office	0.66	<u>0.65</u>
Parking garage	0.16 <u>0.15</u>	<u>0.14</u>
Penitentiary	0.65	<u>0.65</u>
Performing arts theater	1.00	<u>1.00</u>
<u>Personal service – salon, cleaners, laundromat</u>		<u>0.60</u>
Police station	0.70	<u>0.70</u>
Post office	0.70 <u>0.67</u>	<u>0.67</u>
Religious building	0.80	<u>0.80</u>
Retail	1.01	<u>0.90</u>
School/university	0.70	<u>0.65</u>
Sports arena	0.62	<u>0.75</u>
Town hall	0.71	<u>0.71</u>
Transportation	0.56	<u>0.50</u>
Warehouse	0.40	<u>0.40</u>
Workshop	0.95 <u>0.90</u>	<u>0.90</u>

- a. Where sleeping units are excluded from lighting power calculations by application of Section R404.1, neither the area of the sleeping units nor the wattage of lighting in the sleeping units is counted.
- b. Where dwelling units are excluded from lighting power calculations by application of Section R404.1, neither the area of the dwelling units nor the wattage of lighting in the dwelling units is counted.
- b-c. Dwelling units are excluded. Neither the area of the dwelling units nor the wattage of lighting in the dwelling units is counted.

TABLE C405.4.2(2)
INTERIOR LIGHTING POWER ALLOWANCES: SPACE-BY-SPACE METHOD

COMMON SPACE-BY-SPACE TYPES ^a	LPD ^a (w/ft ²)	<u>LPD^d (w/ft²)</u> <u>Option 1</u>	<u>LPD^d (w/ft²)</u> <u>Option 2</u>	<u>LPD^d (w/ft²)</u> <u>Option 3</u>
Atrium - First 40 feet in height ^e - (per foot)	0.02 per ft. ht.	<u>0.48</u>	<u>0.02</u>	<u>0.48</u>
Atrium - Above 40 feet in height ^e - (per foot)	0.3 + 0.02 per ft. in total ht.	<u>0.70</u>	<u>0.02</u>	<u>0.70</u>
Audience/seating area - Permanent In an auditorium	0.50	<u>0.61</u>	<u>0.61</u>	<u>0.61</u>

Commented [BK(238)]
onlin MR

Commented [BK(239)]
aylon MR

Commented [BK(237)]
L119-2018

In a convention center	0.66	<u>0.65</u>	<u>0.25</u>	<u>0.25</u>
In a gymnasium	0.34	<u>0.34</u>	<u>0.23</u>	<u>0.23</u>
In an motion picture theater	0.91	<u>0.82</u>	<u>0.27</u>	<u>0.27</u>
In a penitentiary	0.22	<u>0.67</u>	<u>0.44</u>	<u>0.67</u>
In an performing arts theater	1.94	<u>1.06</u>	<u>1.06</u>	<u>1.06</u>
In a religious building	1.22	<u>1.22</u>	<u>0.72</u>	<u>0.72</u>
In a sports arena	0.34	<u>0.33</u>	<u>0.33</u>	<u>0.33</u>
Otherwise	0.34	<u>0.23</u>	<u>0.23</u>	<u>0.23</u>
Banking activity area	0.81	<u>0.79</u>	<u>0.61</u>	<u>0.61</u>
<u>Beauty salon, barber area</u>		<u>1.00</u>	<u>1.00</u>	<u>1.00</u>
Breakroom (see Lounge/breakroom)				
Classroom/lecture/training				
In a penitentiary	1.07	<u>1.38</u>	<u>1.07</u>	<u>1.38</u>
Otherwise	1.000.96	<u>0.84^m</u>	<u>0.84^m</u>	<u>0.74^m</u>
Computer room	1.371.33	<u>1.33</u>	<u>1.00</u>	<u>1.00</u>
Conference/meeting/multipurpose	0.98	<u>0.97</u>	<u>0.97</u>	<u>0.97</u>
<u>Confinement cell</u>		<u>0.70</u>	<u>0.70</u>	<u>0.70</u>
Copy/print room	0.580.56	<u>0.70</u>	<u>0.50</u>	<u>0.31</u>
Corridor				
In a facility for the visually impaired (and not used primarily by the staff) ^b	0.74	<u>0.71</u>	<u>0.71</u>	<u>0.71</u>
In a hospital	0.63	<u>0.71</u>	<u>0.63</u>	<u>0.71</u>
In a manufacturing facility	0.330.29	<u>0.41</u>	<u>0.29</u>	<u>0.41</u>
Otherwise	0.53	<u>0.41</u>	<u>0.41</u>	<u>0.41</u>
Courtroom	1.38	<u>1.25</u>	<u>1.25</u>	<u>1.25</u>
Dining area				
In a penitentiary	0.77	<u>0.42</u>	<u>0.42</u>	<u>0.42</u>
In a facility for the visually impaired (and not used primarily by the staff) ^b	1.52	<u>1.38</u>	<u>1.38</u>	<u>1.38</u>
In a bar/lounge or leisure dining	0.86	<u>0.86ⁿ</u>	<u>0.86ⁿ</u>	<u>0.86ⁿ</u>
<u>In cafeteria or fast food dining</u>		<u>0.63</u>	<u>0.40</u>	<u>0.40</u>
In a family dining area	0.71	<u>0.71ⁿ</u>	<u>0.60ⁿ</u>	<u>0.60ⁿ</u>
Otherwise	0.52	<u>0.52</u>	<u>0.43</u>	<u>0.43</u>
Electrical/mechanical	0.760.43	<u>0.42</u>	<u>0.42</u>	<u>0.42</u>
Emergency vehicle garage	0.450.41	<u>0.52</u>	<u>0.41</u>	<u>0.52</u>
Food preparation	0.79	<u>1.29</u>	<u>0.92</u>	<u>1.29</u>
Guest room ^{g,h}	0.38	<u>0.41</u>	<u>0.41</u>	<u>0.41</u>
Laboratory				
In or as a classrooms	1.02	<u>1.17</u>	<u>1.02</u>	<u>1.17</u>
Otherwise	1.45	<u>1.70^o</u>	<u>1.45^o</u>	<u>1.70^o</u>
Laundry/washing area	0.480.43	<u>0.59</u>	<u>0.43</u>	<u>0.59</u>
Loading dock, interior	0.38	<u>0.38</u>	<u>0.38</u>	<u>0.38</u>
Lobby ^c				
In a facility for the visually impaired (and not used primarily by the staff) ^b	1.44	<u>2.49</u>	<u>1.44</u>	<u>2.49</u>
For an elevator	0.51	<u>0.71</u>	<u>0.51</u>	<u>0.71</u>

Commented [BK(240)]
L121-2018

Commented [BK(241)]
L121-2018

Commented [BK(242)]
L121-2018

Commented [BK(243)]
L121-2018

In a hotel	0.85	<u>0.51</u>	<u>0.51</u>	<u>0.51</u>
In a motion picture theater	0.42	<u>0.23</u>	<u>0.23</u>	<u>0.23</u>
In a performing arts theater	1.60	<u>1.25</u>	<u>1.25</u>	<u>1.25</u>
Otherwise	0.72	<u>1.11</u>	<u>0.72</u>	<u>1.11</u>
Locker room	0.60 <u>0.48</u>	<u>0.52</u>	<u>0.86</u>	<u>0.52</u>
Lounge /breakroom		<u>0.67</u>	<u>0.58</u>	
In a health care facility	0.74			<u>0.42</u>
Otherwise	0.58			<u>0.59</u>
Office ^f				
Enclosed < 250	0.89	0.88 ^h	<u>0.88</u> ^p	<u>0.70</u> ^p
Enclosed >250		0.79 ^h	<u>0.79</u> ^p	<u>0.70</u> ^p
Open plan	0.78	0.67 ^h	<u>0.67</u> ^p	<u>0.60</u> ^p
Parking area, interior	0.15 <u>0.14</u>	<u>0.15</u>	<u>0.15</u>	<u>0.15</u>
Parking facility, dedicated ramp		<u>0.25</u>	<u>0.25</u>	<u>0.25</u>
Pharmacy area	0.94	<u>1.90</u>	<u>1.23</u>	<u>1.90</u>
Restroom				
In a facility for the visually impaired (and not used primarily by the staff) ^b	0.97 <u>0.96</u>	<u>1.26</u>	<u>0.96</u>	<u>1.26</u>
Otherwise	0.78	0.78 ^{h,r}	<u>0.75</u> ^{h,r}	<u>0.63</u> ^{h,r}
Sales area	1.27 <u>1.22</u>	<u>1.12</u>	<u>1.12</u>	<u>1.04</u>
Sales area, grocery		<u>1.05</u>	<u>1.05</u>	<u>1.05</u>
Seating area, general	0.43 <u>0.42</u>	<u>0.23</u>	<u>0.23</u>	<u>0.23</u>
Stairway (See space containing stairway)				
Stairwell	0.55	0.55 ^{h,r}	<u>0.49</u> ^{h,r}	<u>0.49</u> ^{h,r}
Storage room	0.50 <u>0.46</u>			
< 50 ft ²		<u>0.40</u>	<u>0.40</u>	<u>0.40</u>
50-100 ft ²		<u>0.38</u>	<u>0.38</u>	<u>0.38</u>
All other storage		<u>0.38</u>	<u>0.38</u>	<u>0.38</u>
Vehicular maintenance	0.54	<u>0.60</u>	<u>0.54</u>	<u>0.60</u>
Workshop	1.27 <u>1.14</u>	<u>1.26</u>	<u>1.14</u>	<u>1.26</u>

Commented [BK(244)]
L121-2018

Commented [BK(245)]
L121-2018

Commented [BK(246)]
L121-2018

Commented [BK(247)]
L121-2018

Commented [BK(248)]
L121-2018

Commented [BK(249)]
L121-2018

Commented [BK(250)]
L121-2018

BUILDING SPECIFIC SPACE-BY-SPACE TYPES

BUILDING SPECIFIC SPACE-BY-SPACE TYPES ^a	LPD ^a (w/ft ²)	LPD ^d (w/ft ²) Option 1	LPD ^d (w/ft ²) Option 2	LPD ^d (w/ft ²) Option 3
Automotive (see Vehicular maintenance, above)		<u>0.60</u>	<u>0.54</u>	<u>0.60</u>
Convention center - Exhibit space	1.16 <u>0.88</u>	<u>0.50</u>	<u>0.50</u>	<u>0.50</u>
Dormitory living quarters ^{a,h}	0.30	<u>0.84</u>	<u>0.46</u>	<u>0.46</u>
Facility for the visually impaired ^b				
In a chapel (and not used primarily by the staff) ^b	1.77 <u>1.06</u>	<u>0.70</u>	<u>0.70</u>	<u>0.70</u>
In a recreation room (and not used primarily by the staff) ^b	1.93 <u>1.80</u>	<u>1.77</u>	<u>1.77</u>	<u>1.77</u>
Fire stations ^a				
Engine rooms	0.45	<u>0.45</u>	<u>0.45</u>	<u>0.45</u>
Sleeping quarters	0.18	<u>0.20</u>	<u>0.18</u>	<u>0.20</u>

Commented [BK(251)]
L119-2018

Commented [BK(252)]
onlin MR

Commented [BK(253)]
aylon MR

Gymnasium/fitness center				
In an exercise area	0.58 <u>0.50</u>	<u>0.90</u>	<u>0.50</u>	<u>0.90</u>
In a playing area	0.96 <u>0.82</u>	<u>0.85</u>	<u>0.82</u>	<u>0.85</u>

BUILDING SPECIFIC SPACE-BY-SPACE TYPES--Continued

BUILDING SPECIFIC SPACE-BY-SPACE TYPES ^a	LPD ^d (w/ft ²)	LPD ^d (w/ft ²) Option 1	LPD ^d (w/ft ²) Option 2	LPD ^d (w/ft ²) Option 3
Health care facility				
In an exam/treatment room	1.33	<u>1.40</u>	<u>1.33</u>	<u>1.40</u>
In an imaging room	1.06	<u>0.85</u>	<u>0.85</u>	<u>0.85</u>
In a medical supply room	0.59 <u>0.54</u>	<u>0.62</u>	<u>0.54</u>	<u>0.62</u>
In a nursery	<u>0.70</u>	<u>1.37</u>	<u>0.94</u>	<u>1.37</u>
In a nurse's station	0.57	<u>1.11</u>	<u>0.75</u>	<u>1.11</u>
In an operating room	1.51	<u>2.26</u>	<u>1.90</u>	<u>2.26</u>
In a patient room ^g	<u>0.50</u>	<u>1.15</u>	<u>0.68</u>	<u>0.68</u>
In a physical therapy room	<u>0.73</u>	<u>0.91</u>	<u>0.85</u>	<u>0.91</u>
In a recovery room	0.92	<u>1.25</u>	<u>0.92</u>	<u>1.25</u>
Library ^f				
In a reading area	<u>0.74</u>	<u>0.96</u>	<u>0.80</u>	<u>0.96</u>
In the stacks	1.37 <u>1.20</u>	<u>1.16</u>	<u>1.16</u>	<u>1.16</u>
Manufacturing facility				
In a detailed manufacturing area	1.03 <u>0.93</u>	<u>0.80</u>	<u>0.80</u>	<u>0.80</u>
In an equipment room	0.59	<u>0.76</u>	<u>0.65</u>	<u>0.76</u>
In an extra high bay area (> 50-foot floor-ceiling height)	<u>0.84</u>	<u>1.42</u>	<u>0.84</u>	<u>1.42</u>
In a high bay area (25 - 50-foot floor-ceiling height)	0.98 <u>0.75</u>	<u>1.24</u>	<u>0.75</u>	<u>1.24</u>
In a low bay area (< 25-foot floor-ceiling height)	<u>0.95</u>	<u>0.86</u>	<u>0.86</u>	<u>0.86</u>
Museum				
In a general exhibition area	<u>0.84</u>	<u>0.84</u>	<u>0.31</u>	<u>0.31</u>
In a restoration room	<u>0.82</u>	<u>1.10</u>	<u>1.10</u>	<u>1.10</u>
Performing arts theater dressing/fitting room	<u>0.32</u>	<u>0.41</u>	<u>0.41</u>	<u>0.41</u>
Post office—Sorting area	0.75 <u>0.68</u>	<u>0.76</u>	<u>0.68</u>	<u>0.76</u>
Religious building				
In a fellowship hall	0.51	<u>0.54</u>	<u>0.51</u>	<u>0.54</u>
In a worship pulpit/choir area	1.22	<u>0.85</u>	<u>0.85</u>	<u>0.84</u>
Retail				
In a dressing/fitting room	0.57 <u>0.50</u>	<u>0.51</u>	<u>0.50</u>	<u>0.51</u>
In a mall concourse	<u>0.88</u>	<u>1.03</u>	<u>0.88</u>	<u>1.03</u>
Sports arena—Playing area				
For a Class 1 facility ⁱ	2.41	<u>2.94</u>	<u>2.41</u>	<u>2.94</u>
For a Class 2 facility ⁱ	1.54	<u>2.01</u>	<u>2.01</u>	<u>2.01</u>
For a Class 3 facility ^k	0.96	<u>1.30</u>	<u>0.96</u>	<u>1.30</u>
For a Class 4 facility ^l	0.58	<u>0.86</u>	<u>0.72</u>	<u>0.86</u>
Transportation				

Commented [BK(254)]
L119-2018

Commented [BK(255)]
onlin MR

Commented [BK(256)]
aylon MR

In a baggage/carousel area	0.42	<u>0.39</u>	<u>0.39</u>	<u>0.39</u>
In an airport concourse	0.29	<u>0.25</u>	<u>0.25</u>	<u>0.25</u>
At a terminal ticket counter	0.64 <u>0.62</u>	<u>0.51</u>	<u>0.51</u>	<u>0.51</u>
Warehouse—Storage area				
For medium to bulky palletized items	0.46 <u>0.35</u>	<u>0.33</u>	<u>0.33</u>	<u>0.33</u>
For smaller, hand-carried items	0.76 <u>0.69</u>	<u>0.69</u>	<u>0.69</u>	<u>0.69</u>

For SI: 1 foot = 304.8 mm, 1 watt per square foot = 11 W/m².

- a. In cases where both a common space type and a building area specific space type are listed, the building area specific space type shall apply.
- b. A ~~“Facility for the visually impaired”~~ is a facility that is licensed or will be licensed by local or state authorities for senior long-term care, adult daycare, senior support or people with special visual needs.
- c. For spaces in which lighting is specified to be installed in addition to, and controlled separately from, the general lighting for the purposed of highlighting art or exhibits, provided that the additional lighting power shall not exceed 0.5 W/ft² of such spaces.
- d. ~~The watts per square foot may be increased by 2 percent per foot of ceiling height above 20 feet, unless specifically directed otherwise by subsequent footnotes.~~ **RESERVED.**
- e. ~~Footnote d may not be used for these occupancy types.~~ **RESERVED.**
- f. ~~The watts per square foot may be increased by 2 percent per foot of ceiling height above 9 feet. Footnote d may not be used for these occupancy types.~~ **RESERVED.**
- g. ~~Where sleeping units are excluded from lighting power calculations by application of Section R404.1, neither the area of the sleeping units nor the wattage of lighting in the sleeping units is counted.~~
- h. ~~Where dwelling units are excluded from lighting power calculations by application of Section R404.1, neither the area of the dwelling units nor the wattage of lighting in the dwelling units is counted.~~
- i. ~~Class I facilities consist of professional facilities; and semi-professional, collegiate or club facilities with seating for 5,000 or more spectators.~~
- j. ~~Class II facilities consist of collegiate and semi-professional facilities with seating for fewer than 5,000 spectators; club facilities with seating between 2,000 and 5,000 spectators; and amateur league and high school facilities with seating for more than 2,000 spectators.~~
- k. ~~Class III facilities consist of club, amateur league and high school facilities with seating for 2,000 or fewer spectators.~~
- l. ~~Class IV facilities consist of elementary school and recreational facilities; and amateur league and high school facilities without provisions for spectators.~~
- m. ~~For classrooms, additional lighting power allowance of 4.50 W/lineal foot of white or chalk boards for directional lighting dedicated to white or chalk boards.~~
- n. ~~Additional lighting power allowance of 0.30 W/square foot for ornamental lighting. Qualifying ornamental lighting includes luminaires such as chandeliers, sconces, lanterns, neon and cold cathode, light emitting diodes, theatrical projectors, moving lights and light color panels when any of those lights are used in a decorative manner that does not serve as display lighting or general lighting.~~
- o. ~~For scientific laboratories, additional lighting power allowance of 0.35 Watts per square foot for specialized task work – lighting that provides for small-scale, cognitive or fast performance visual tasks; lighting required for operating specialized equipment associated with pharmaceutical/laboratorial activities.~~
- p. ~~For offices, additional lighting power allowance of 0.20 W/square foot for portable lighting, which includes under shelf or furniture-mounted supplemental task lighting qualifies when controlled by a time clock or an occupancy sensor.~~
- q. ~~Additional lighting power allowance of 0.15 W/square foot for decorative lighting. Primary function shall be decorative and not to provide general lighting.~~
- r. ~~Additional lighting power allowance of 0.20 W/square foot for accent, display and feature lighting -luminaires shall be adjustable or directional.~~

Commented [BK(257)]
L119-2018

Commented [BK(258)]
L121-2018

C405.5 Exterior lighting power requirements(Mandatory). ~~Where the power for exterior lighting is supplied through the energy service to the building, all exterior lighting shall comply with Sections C405.5.1 and C405.5.2. The total connected exterior lighting power calculated in accordance with Section C405.5.2 shall not be greater than the exterior lighting power allowance calculated in accordance with Section C405.5.3.~~

Exception: ~~Where approved because of historical, safety, signage or emergency considerations.~~

C405.5.1 Exterior building grounds lighting. All exterior building grounds luminaires that operate at greater than 100 watts shall have a minimum efficacy of 80 lumens per watt unless the luminaire is controlled by a motion sensor or qualifies for one of the exceptions under Section C405.5.2.

Exceptions:

1. Solar-powered lamps not connected to any electrical service.
2. Luminaires controlled by a motion sensor.
3. Luminaires that qualify for one of the exceptions under Section C405.5.2.

Commented [BK(259):
L122-2018

C405.5.2 Total connected exterior building lighting power. ~~The total exterior connected lighting power allowance for shall be the total maximum rated wattage of all lighting that is powered through the energy service for the building. all exterior building applications is the sum of the base site allowance plus the individual allowances for areas that are to be illuminated and are permitted in Table C405.5.2(2) for the applicable lighting zone. Tradeoffs are allowed only among exterior lighting applications listed in Table C405.5.2(2), Tradable Surfaces section. The lighting zone for the building exterior is determined from Table C405.5.2(1) unless otherwise specified by the local jurisdiction.~~

Exception: ~~Lighting used for the following exterior applications is exempt where equipped with a control device independent of the control of the nonexempt lightingshall not be included:~~

1. Lighting approved because of safety considerations.
2. Emergency lighting automatically off during normal business operation.
3. Exit signs
- ~~4.~~ Specialized signal, directional and marker lighting associated with transportation.
- ~~5.~~ Advertising signage or directional signage.
- ~~6.~~ Integral to equipment or instrumentation and is installed by its manufacturer.
- ~~7.~~ Theatrical purposes, including performance, stage, film production and video production.
- ~~8.~~ Athletic playing areas.
- ~~9.~~ Temporary lighting.
- ~~10.~~ Industrial production, material handling, transportation sites and associated storage areas.
- ~~11.~~ Theme elements in theme/amusement parks.
12. Used toLighting integrated within or used to highlight features of art, public monuments and ~~registered historic landmark structures or buildings~~the national flag.
13. Lighting for water features and swimming pools.
14. Lighting that is controlled from within dwelling units, where the lighting complies with Section R404.1.

C405.5.3 Exterior lighting power allowance. ~~The total exterior lighting power allowance is the sum of the base site allowance plus the individual allowances for areas that are to be illuminated by lighting that is powered through the energy service for the building. Lighting power allowances are as specified in Table C405.5.3(2). The lighting zone for the building exterior is determined in accordance with Table C405.5.3(1) unless otherwise specified by the code official.~~

C405.5.3.1 Additional exterior lighting power. ~~Any increase in the exterior lighting power allowance is limited to the specific lighting applications indicated in Table C405.5.3(3). The additional power shall be used only for the luminaires that are serving these applications and shall not be used for any other purpose.~~

C405.5.4 Gas lighting. Gas-fired lighting appliances shall not be equipped with continuously burning pilot ignition systems.

TABLE C405.5.23(1)
EXTERIOR LIGHTING ZONES

LIGHTING ZONE	DESCRIPTION
1	Developed areas of national parks, state parks, forest land, and rural areas
2	Areas predominantly consisting of residential zoning, neighborhood business districts, light industrial with limited nighttime use and residential mixed use areas
3	All other areas not classified as lighting zone 1, 2 or 4
4	High-activity commercial districts in major metropolitan areas as designated by the local land use planning authority

TABLE C405.5.23(2)
INDIVIDUAL LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

		LIGHTING ZONES			
		Zone 1	Zone 2	Zone 3	Zone 4
Base Site Allowance (Base allowance is usable in tradable or nontradable surfaces.)	Base Site Allowance	500-350 W	600-400 W	750-500 W	1300-900 W
Tradable Surfaces— (Lighting power densities for uncovered parking areas, building grounds, building entrances and exits, canopies and overhangs and outdoor sales areas are tradable.)	Uncovered Parking Areas				
	Parking areas and drives	0.040-0.03 W/ft²	0.060-0.04 W/ft²	0.080-0.06 W/ft²	0.100-0.08 W/ft²
	Building Grounds				
	Walkways <u>and ramps</u> less than 10 feet wide	0.70-0.5 W/linear foot	0.70-0.5 W/linear foot	0.80-0.6 W/linear foot	1.00-0.7 W/linear foot
	Walkways <u>and ramps</u> 10 feet wide or greater, plaza areas special feature areas	0.140-0.10 W/ft²	0.140-0.10 W/ft²	0.160-0.11 W/ft²	0.20-0.14 W/ft²
	Dining areas	0.65 W/ft²	0.65 W/ft²	0.75 W/ft²	0.95 W/ft²
	Stairways	0.750-0.6 W/ft²	1.00-0.7 W/ft²	1.00-0.7 W/ft²	1.00-0.7 W/ft²
	Pedestrian tunnels	0.150-0.12 W/ft²	0.150-0.12 W/ft²	0.20-0.14 W/ft²	0.30-0.21 W/ft²
	Landscaping	0.03 W/ft²	0.04 W/ft²	0.04 W/ft²	0.04 W/ft²
	Building Entrances and Exits				
	Main entries <u>Pedestrian and vehicular entrances and exits</u>	20-14 W/linear foot of door-width opening	20-14 W/linear foot of door-width opening	30-21 W/linear foot of door-width opening	30-21 W/linear foot of door-width opening
	Other doors	20 W/linear foot of door-width	20 W/linear foot of door-width	20 W/linear foot of door-width	20 W/linear foot of door-width
	Entry canopies	0.250-0.2 W/ft²	0.25 W/ft²	0.4 W/ft²	0.4 W/ft²
	Loading docks	0.35 W/ft²	0.35 W/ft²	0.35 W/ft²	0.35 W/ft²
	Sales Canopies				
	Free-standing and attached	0.60-0.4 W/ft²	0.60-0.4 W/ft²	0.80-0.6 W/ft²	1.00-0.7 W/ft²
	Outdoor Sales				
	Open areas (including vehicle sales lots)	0.250-0.2 W/ft²	0.250-0.2 W/ft²	0.50-0.35 W/ft²	0.70-0.5 W/ft²
	Street frontage for vehicle sales lots in addition to "open	No allowance	10-7 W/linear foot	10-7 W/linear foot	30-21 W/linear foot

	area” allowance				
Nontradable Surfaces (Lighting power-density calculations for the following applications can be used only for the specific application and cannot be traded between surfaces or with other exterior lighting. The following allowances are in addition to any allowance otherwise permitted in the “Tradable Surfaces” section of this table.)	Building facades	No allowance	0.075 W/ft ² of gross above-grade wall area	0.113 W/ft ² of gross above-grade wall area	0.150 W/ft ² of gross above-grade wall area
	Automated teller machines and night depositories	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location
	Entrances and gatehouse inspection stations at guarded facilities	0.75 W/ft ² of covered and uncovered area	0.75 W/ft ² of covered and uncovered area	0.75 W/ft ² of covered and uncovered area	0.75 W/ft ² of covered and uncovered area
	Loading areas for law enforcement, fire, ambulance and other emergency service vehicles	0.5 W/ft ² of covered and uncovered area	0.5 W/ft ² of covered and uncovered area	0.5 W/ft ² of covered and uncovered area	0.5 W/ft ² of covered and uncovered area
	Drive-up windows/doors	400 W per drive-through	400 W per drive-through	400 W per drive-through	400 W per drive-through
	Parking near 24-hour retail entrances	800 W per main entry	800 W per main entry	800 W per main entry	800 W per main entry

For SI: 1 foot = 304.8 mm, 1 watt per square foot = W/0.0929 m².

TABLE C405.5.3(3)
INDIVIDUAL LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

	LIGHTING ZONES			
	<u>Zone 1</u>	<u>Zone 2</u>	<u>Zone 3</u>	<u>Zone 4</u>
<u>Building facades</u>	<u>No Allowance</u>	<u>0.075 W/ft² of gross above-grade wall area</u>	<u>0.113 W/ft² of gross above-grade wall area</u>	<u>0.150 W/ft² of gross above-grade wall area</u>
<u>Automated teller machines (ATM) and night depositories</u>	<u>135 W per location plus 45 W per additional ATM per location</u>			
<u>Uncovered entrances and gatehouse inspection stations at guarded facilities</u>	<u>0.5 W/ft²</u>			
<u>Uncovered loading areas for law enforcement, fire, ambulance and other emergency service vehicles</u>	<u>0.35 W/ft²</u>			
<u>Drive-up windows/doors</u>	<u>200 W per drive-through</u>			
<u>Parking near 24-hour retail entrances</u>	<u>400 W per main entry</u>			

C405.6 Electrical transformers ~~(Mandatory)~~. Low-voltage dry-type distribution electric transformers shall meet the minimum efficiency requirements of Table C405.6 as tested and rated in accordance with the test procedure listed in DOE 10 CFR 431. The efficiency shall be verified through certification under an approved certification program or, where no certification program exists, the equipment efficiency ratings shall be supported by data furnished by the transformer manufacturer.

Exception: The following transformers are exempt:

1. Transformers that meet the Energy Policy Act of 2005 exclusions based on the DOE 10 CFR 431 definition of special purpose applications.
2. Transformers that meet the Energy Policy Act of 2005 exclusions that are not to be used in general purpose applications based on information provided in DOE 10 CFR 431.
3. Transformers that meet the Energy Policy Act of 2005 exclusions with multiple voltage taps where the highest tap is at least not less than 20 percent more than the lowest tap.
4. Drive transformers.
5. Rectifier transformers.
6. Auto-transformers.
7. Uninterruptible power system transformers.
8. Impedance transformers.
9. Regulating transformers.
10. Sealed and nonventilating transformers.
11. Machine tool transformer.
12. Welding transformer.
13. Grounding transformer.
14. Testing transformer.

**TABLE C405.6
MINIMUM NOMINAL EFFICIENCY LEVELS FOR 10 CFR 431 LOW VOLTAGE DRY-TYPE DISTRIBUTION TRANSFORMERS**

Single Phase Transformers		Three Phase Transformers	
kVA ^a	Efficiency (%) ^b	kVA ^a	Efficiency (%) ^b
15	97.70	15	97.0 97.89
25	98.00	30	97.5 98.23
37.5	98.20	45	97.7 98.40
50	98.30	75	98.0 98.60
75	98.50	112.5	98.2 98.74
100	98.60	150	98.3 98.83
167	98.70	225	98.5 98.94
250	98.80	300	98.6 99.02
333	98.90	500	98.7 99.14
		750	98.8 99.23
		1000	98.9 99.28

a. kiloVolt-Amp rating.

b. Nominal efficiencies shall be established in accordance with the DOE 10 CFR 431 test procedure for low voltage dry-type transformers.

C405.7 Dwelling unit electrical energy consumption ~~(Mandatory)~~. Each dwelling unit located in a Group R-2 building shall have a separate electrical meter. A utility tenant meter meets this requirement. See Section C409 for additional requirements for energy metering and energy consumption management.

Exception: Dwelling units in other than Group R-2 apartment and live/work units are not required to provide a separate electrical metering at each dwelling unit where electrical usage is metered separately for each of the following building end uses:

1. Dwelling units.
2. Sleeping units.
3. Commercial kitchens.
4. Central laundries.

C405.8 Electric motor efficiency ~~(Mandatory)~~. All electric motors, fractional or otherwise, shall meet the minimum efficiency requirements of Tables C405.8(1) through C405.8(4) when tested and rated in accordance with DOE 10 CFR.

~~2015-2018~~ Washington State Energy Code

CE-119

Commented [BK(260)]
L123-2018

The efficiency shall be verified through certification under an approved certification program, or, where no certification program exists, the equipment efficiency rating shall be supported by data furnished by the motor manufacturer.

Exception: The standards in this section shall not apply to the following exempt electric motors.

1. Air-over electric motors
2. Component sets of an electric motor
3. Liquid-cooled electric motors
4. Submersible electric motors
- 4.5. Inverter-only electric motors

Fractional hp fan motors that are 1/12 hp or greater and less than 1 hp (based on output power) which are not covered by Tables C405.8(3) and C405.8(4) shall be electronically commutated motors or shall have a minimum motor efficiency of 70 percent when rated in accordance with DOE 10 CFR 431. These motors shall also have the means to adjust motor speed for either balancing or remote control. Belt-driven fans may use sheave adjustment for airflow balancing in lieu of a varying motor speed.

Commented [BK(261)]
L124-2018

Exceptions:

4. Motors that are an integral part of specialized process equipment.
5. Where the motor is integral to a listed piece of equipment for which no complying motor has been approved.
6. Motors used as a component of the equipment meeting the minimum efficiency requirements of Section C403.2.3 and Tables C403.2.3(1) through C403.2.3(10), provided that the motor input is included when determining the equipment efficiency.
7. Motors in the airstream within fan coils and terminal units that operate only when providing heating to the space served.
8. Fan motors that are not covered by Tables C405.8(1) through C405.8(4) and are used to power heat recovery ventilators, energy recovery ventilators, or local exhaust fans in Group R subject to the high efficacy requirements of Section C403.2.11.4.
9. Domestic clothes dryer booster fans, range hood exhaust fans, and domestic range booster fans that operate intermittently.
10. Radon and contaminated soil exhaust fans.
11. Group R heat recovery ventilator and energy recovery ventilator fans that are less than 400 cfm.

TABLE C405.8(1)
MINIMUM NOMINAL FULL-LOAD EFFICIENCY FOR 60 HZ NEMA GENERAL PURPOSE ELECTRIC MOTORS (SUBTYPE I) RATED 600 VOLTS OR LESS (RANDOM WOUND) NEMA DESIGN A, NEMA DESIGN B AND IEC DESIGN N MOTORS (EXCLUDING FIRE PUMP) ELECTRIC MOTORS AT 60 HZ^{a,b}

NUMBER OF POLES▶	OPEN DRIP-PROOF MOTORS			TOTALLY ENCLOSED FAN-COOLED MOTORS		
	2 3600	4 1800	6 1200	2 3600	4 1800	6 1200
SYNCHRONOUS SPEED – (RPM)▶						
MOTOR HORSEPOWER ▼						
1	77.0	85.5	82.5	77.0	85.5	82.5
1.5	84.0	86.5	86.5	84.0	86.5	87.5
2	85.5	86.5	87.5	85.5	86.5	88.5
3	85.5	89.5	88.5	86.5	89.5	89.5
5	86.5	89.5	89.5	88.5	89.5	89.5
7.5	88.5	91.0	90.2	89.5	91.7	91.0
10	89.5	91.7	91.7	90.2	91.7	91.0
15	90.2	93.0	91.7	91.0	92.4	91.7
20	91.0	93.0	92.4	91.0	93.0	91.7
25	91.7	93.6	93.0	91.7	93.6	93.0
30	91.7	94.1	93.6	91.7	93.6	93.0
40	92.4	94.1	94.1	92.4	94.1	94.1
50	93.0	94.5	94.1	93.0	94.5	94.1
60	93.6	95.0	94.5	93.6	95.0	94.5
75	93.6	95.0	94.5	93.6	95.4	94.5
100	93.6	95.4	95.0	94.1	95.4	95.0
125	94.1	95.4	95.0	95.0	95.4	95.0
150	94.1	95.8	95.4	95.0	95.8	95.8
200	95.0	95.8	95.4	95.4	96.2	95.8

250	95.0	95.8	95.4	95.8	96.2	95.8
300	95.4	95.8	95.4	95.8	96.2	95.8
350	95.4	95.8	95.4	95.8	96.2	95.8
400	95.8	95.8	95.8	95.8	96.2	95.8
450	95.8	96.2	96.2	95.8	96.2	95.8
500	95.8	96.2	96.2	95.8	96.2	95.8

Motor horsepower (Standard kilowatt equivalent)	Nominal full-load efficiency (%) as of June 1, 2016									
	2 pole		4 pole		6 pole		8 pole			
	Enclosed	Open	Enclosed	Open	Enclosed	Open	Enclosed	Open		
<u>1 (0.75)</u>	<u>77.0</u>	<u>77.0</u>	<u>85.5</u>	<u>85.5</u>	<u>82.5</u>	<u>82.5</u>	<u>75.5</u>	<u>75.5</u>		
<u>1.5 (1.1)</u>	<u>84.0</u>	<u>84.0</u>	<u>86.5</u>	<u>86.5</u>	<u>87.5</u>	<u>86.5</u>	<u>78.5</u>	<u>77.5</u>		
<u>2 (1.5)</u>	<u>85.5</u>	<u>85.5</u>	<u>86.5</u>	<u>86.5</u>	<u>88.5</u>	<u>87.5</u>	<u>84.0</u>	<u>86.5</u>		
<u>3 (2.2)</u>	<u>86.5</u>	<u>85.5</u>	<u>89.5</u>	<u>89.5</u>	<u>89.5</u>	<u>88.5</u>	<u>85.5</u>	<u>87.5</u>		
<u>5 (3.7)</u>	<u>88.5</u>	<u>86.5</u>	<u>89.5</u>	<u>89.5</u>	<u>89.5</u>	<u>89.5</u>	<u>86.5</u>	<u>88.5</u>		
<u>7.5 (5.5)</u>	<u>89.5</u>	<u>88.5</u>	<u>91.7</u>	<u>91.0</u>	<u>91.0</u>	<u>90.2</u>	<u>86.5</u>	<u>89.5</u>		
<u>10 (7.5)</u>	<u>90.2</u>	<u>89.5</u>	<u>91.7</u>	<u>91.7</u>	<u>91.0</u>	<u>91.7</u>	<u>89.5</u>	<u>90.2</u>		
<u>15 (11)</u>	<u>91.0</u>	<u>90.2</u>	<u>92.4</u>	<u>93.0</u>	<u>91.7</u>	<u>91.7</u>	<u>89.5</u>	<u>90.2</u>		
<u>20 (15)</u>	<u>91.0</u>	<u>91.0</u>	<u>93.0</u>	<u>93.0</u>	<u>91.7</u>	<u>92.4</u>	<u>90.2</u>	<u>91.0</u>		
<u>25 (18.5)</u>	<u>91.7</u>	<u>91.7</u>	<u>93.6</u>	<u>93.6</u>	<u>93.0</u>	<u>93.0</u>	<u>90.2</u>	<u>91.0</u>		
<u>30 (22)</u>	<u>91.7</u>	<u>91.7</u>	<u>93.6</u>	<u>94.1</u>	<u>93.0</u>	<u>93.6</u>	<u>91.7</u>	<u>91.7</u>		
<u>40 (30)</u>	<u>92.4</u>	<u>92.4</u>	<u>94.1</u>	<u>94.1</u>	<u>94.1</u>	<u>94.1</u>	<u>91.7</u>	<u>91.7</u>		
<u>50 (37)</u>	<u>93.0</u>	<u>93.0</u>	<u>94.5</u>	<u>94.5</u>	<u>94.1</u>	<u>94.1</u>	<u>92.4</u>	<u>92.4</u>		
<u>60 (45)</u>	<u>93.6</u>	<u>93.6</u>	<u>95.0</u>	<u>95.0</u>	<u>94.5</u>	<u>94.5</u>	<u>92.4</u>	<u>93.0</u>		
<u>75 (55)</u>	<u>93.6</u>	<u>93.6</u>	<u>95.4</u>	<u>95.0</u>	<u>94.5</u>	<u>94.5</u>	<u>93.6</u>	<u>94.1</u>		
<u>100 (75)</u>	<u>94.1</u>	<u>93.6</u>	<u>95.4</u>	<u>95.4</u>	<u>95.0</u>	<u>95.0</u>	<u>93.6</u>	<u>94.1</u>		
<u>125 (90)</u>	<u>95.0</u>	<u>94.1</u>	<u>95.4</u>	<u>95.4</u>	<u>95.0</u>	<u>95.0</u>	<u>94.1</u>	<u>94.1</u>		
<u>150 (110)</u>	<u>95.0</u>	<u>94.1</u>	<u>95.8</u>	<u>95.8</u>	<u>95.8</u>	<u>95.4</u>	<u>94.1</u>	<u>94.1</u>		
<u>200 (150)</u>	<u>95.4</u>	<u>95.0</u>	<u>96.2</u>	<u>95.8</u>	<u>95.8</u>	<u>95.4</u>	<u>94.5</u>	<u>94.1</u>		
<u>250 (186)</u>	<u>95.8</u>	<u>95.0</u>	<u>96.2</u>	<u>95.8</u>	<u>95.8</u>	<u>95.8</u>	<u>95.0</u>	<u>95.0</u>		
<u>300 (224)</u>	<u>95.8</u>	<u>95.4</u>	<u>96.2</u>	<u>95.8</u>	<u>95.8</u>	<u>95.8</u>				
<u>350 (261)</u>	<u>95.8</u>	<u>95.4</u>	<u>96.2</u>	<u>95.8</u>	<u>95.8</u>	<u>95.8</u>				
<u>400 (298)</u>	<u>95.8</u>	<u>95.8</u>	<u>96.2</u>	<u>95.8</u>						
<u>450 (336)</u>	<u>95.8</u>	<u>96.2</u>	<u>96.2</u>	<u>96.2</u>						
<u>500 (373)</u>	<u>95.8</u>	<u>96.2</u>	<u>96.2</u>	<u>96.2</u>						

- a. ~~a.~~ Nominal efficiencies shall be established in accordance with DOE 10 CFR 431.
- b. For purposes of determining the required minimum nominal full-load efficiency of an electric motor that has a horsepower or kilowatt rating between two horsepower or two kilowatt ratings listed in this table, each such motor shall be deemed to have a listed horsepower or kilowatt rating, determined as follows:
1. A horsepower at or above the midpoint between the two consecutive horsepowers shall be rounded up to the higher of the two horsepowers.
 2. A horsepower below the midpoint between the two consecutive horsepowers shall be rounded down to the lower of the two horsepowers.
 - ~~1-3.~~ A kilowatt rating shall be directly converted from kilowatts to horsepower using the formula $1 \text{ kW} = (1/0.746) \text{ horsepower}$. The conversion should be calculated to three significant decimal places, and the resulting horsepower shall be rounded in accordance with 1 or 2, whichever applies.

TABLE C405.8(2)
MINIMUM NOMINAL FULL-LOAD EFFICIENCY ~~OF GENERAL PURPOSE ELECTRIC~~ FOR NEMA DESIGN C
AND IEC DESIGN H MOTORS AT 60HZ^{a,b}
(SUBTYPE II) AND ALL DESIGN B MOTORS GREATER THAN 200 HORSEPOWER^a

NUMBER OF POLES ►	OPEN-DRIP-PROOF MOTORS				TOTALLY ENCLOSED FAN-COOLED- MOTORS			
	2	4	6	8	2	4	6	8
SYNCHRONOUS SPEED (RPM) ►	3600	1800	1200	900	3600	1800	1200	900
MOTOR HORSEPOWER ▼								
1	NR	82.5	80.0	74.0	75.5	82.5	80.0	74.0
1.5	82.5	84.0	84.0	75.5	82.5	84.0	85.5	77.0
2	84.0	84.0	85.5	85.5	84.0	84.0	86.5	82.5
3	84.0	86.5	86.5	86.5	85.5	87.5	87.5	84.0
5	85.5	87.5	87.5	87.5	87.5	87.5	87.5	85.5
7.5	87.5	88.5	88.5	88.5	88.5	89.5	89.5	85.5
10	88.5	89.5	90.2	89.5	89.5	89.5	89.5	88.5
15	89.5	91.0	90.2	89.5	90.2	91.0	90.2	88.5
20	90.2	91.0	91.0	90.2	90.2	91.0	90.2	89.5
25	91.0	91.7	91.7	90.2	91.0	92.4	91.7	89.5
30	91.0	92.4	92.4	91.0	91.0	92.4	91.7	91.0
40	91.7	93.0	93.0	91.0	91.7	93.0	93.0	91.0
50	92.4	93.0	93.0	91.7	92.4	93.0	93.0	91.7
60	93.0	93.6	93.6	92.4	93.0	93.6	93.6	91.7
75	93.0	94.1	93.6	93.6	93.0	94.1	93.6	93.0
100	93.0	94.1	94.1	93.6	93.6	94.5	94.1	93.0
125	93.6	94.5	94.1	93.6	94.5	94.5	94.1	93.6
150	93.6	95.0	94.5	93.6	94.5	95.0	95.0	93.6
200	94.5	95.0	94.5	93.6	95.0	95.0	95.0	94.1
250	94.5	95.4	95.4	94.5	95.4	95.0	95.0	94.5
300	95.0	95.4	95.4	NR	95.4	95.4	95.0	NR
350	95.0	95.4	95.4	NR	95.4	95.4	95.0	NR
400	95.4	95.4	NR	NR	95.4	95.4	NR	NR
450	95.8	95.8	NR	NR	95.4	95.4	NR	NR
500	95.8	95.8	NR	NR	95.4	95.8	NR	NR

Motor horsepower (Standard kilowatt equivalent)	Nominal full-load efficiency (%) as of June 1, 2016					
	4 pole		6 pole		8 pole	
	Enclosed	Open	Enclosed	Open	Enclosed	Open
<u>1 (0.75)</u>	<u>85.5</u>	<u>85.5</u>	<u>82.5</u>	<u>82.5</u>	<u>75.5</u>	<u>75.5</u>
<u>1.5 (1.1)</u>	<u>86.5</u>	<u>86.5</u>	<u>87.5</u>	<u>86.5</u>	<u>78.5</u>	<u>77.5</u>
<u>2 (1.5)</u>	<u>86.5</u>	<u>86.5</u>	<u>88.5</u>	<u>87.5</u>	<u>84.0</u>	<u>86.5</u>
<u>3 (2.2)</u>	<u>89.5</u>	<u>89.5</u>	<u>89.5</u>	<u>88.5</u>	<u>85.5</u>	<u>87.5</u>
<u>5 (3.7)</u>	<u>89.5</u>	<u>89.5</u>	<u>89.5</u>	<u>89.5</u>	<u>86.5</u>	<u>88.5</u>
<u>7.5 (5.5)</u>	<u>91.7</u>	<u>91.0</u>	<u>91.0</u>	<u>90.2</u>	<u>86.5</u>	<u>89.5</u>
<u>10 (7.5)</u>	<u>91.7</u>	<u>91.7</u>	<u>91.0</u>	<u>91.7</u>	<u>89.5</u>	<u>90.2</u>
<u>15 (11)</u>	<u>92.4</u>	<u>93.0</u>	<u>91.7</u>	<u>91.7</u>	<u>89.5</u>	<u>90.2</u>
<u>20 (15)</u>	<u>93.0</u>	<u>93.0</u>	<u>91.7</u>	<u>92.4</u>	<u>90.2</u>	<u>91.0</u>
<u>25 (18.5)</u>	<u>93.6</u>	<u>93.6</u>	<u>93.0</u>	<u>93.0</u>	<u>90.2</u>	<u>91.0</u>
<u>30 (22)</u>	<u>93.6</u>	<u>94.1</u>	<u>93.0</u>	<u>93.6</u>	<u>91.7</u>	<u>91.7</u>

40 (30)	94.1	94.1	94.1	94.1	91.7	91.7
50 (37)	94.5	94.5	94.1	94.1	92.4	92.4
60 (45)	95.0	95.0	94.5	94.5	92.4	93.0
75 (55)	95.4	95.0	94.5	94.5	93.6	94.1
100 (75)	95.4	95.4	95.0	95.0	93.6	94.1
125 (90)	95.4	95.4	95.0	95.0	94.1	94.1
150 (110)	95.8	95.8	95.8	95.4	94.1	94.1
200 (150)	96.2	95.8	95.8	95.4	94.5	94.1

NR - No requirement.

~~a.~~ ~~a.~~ Nominal efficiencies shall be established in accordance with DOE 10 CFR 431.

~~a-b.~~ For purposes of determining the required minimum nominal full-load efficiency of an electric motor that has a horsepower or kilowatt rating between two horsepower or two kilowatt ratings listed in this table, each such motor shall be deemed to have a listed horsepower or kilowatt rating, determined as follows:

1. A horsepower at or above the midpoint between the two consecutive horsepower shall be rounded up to the higher of the two horsepower.
2. A horsepower below the midpoint between the two consecutive horsepower shall be rounded down to the lower of the two horsepower.
- ~~4-3.~~ A kilowatt rating shall be directly converted from kilowatts to horsepower using the formula $1 \text{ kW} = (1/0.746)$ horsepower. The conversion should be calculated to three significant decimal places, and the resulting horsepower shall be rounded in accordance with 1 or 2, whichever applies.

TABLE C405.8(3)
MINIMUM AVERAGE FULL LOAD EFFICIENCY FOR
POLYPHASE SMALL ELECTRIC MOTORS^a

NUMBER OF POLES ►	OPEN MOTORS		
	2	4	6
SYNCHRONOUS SPEED (RPM) ►	3600	1800	1200
MOTOR HORSEPOWER ▼			
0.25	65.6	69.5	67.5
0.33	69.5	73.4	71.4
0.50	73.4	78.2	75.3
0.75	76.8	81.1	81.7
1	77.0	83.5	82.5
1.5	84.0	86.5	83.8
2	85.5	86.5	N/A
3	85.5	86.9	N/A

a. Average full load efficiencies shall be established in accordance with 10 CFR 431.

TABLE C405.8(4)
**MINIMUM AVERAGE FULL LOAD EFFICIENCY FOR CAPACITOR-
 START CAPACITOR-RUN AND CAPACITOR-START INDUCTION-
 RUN SMALL ELECTRIC MOTORS^a**

NUMBER OF POLES ►	OPEN MOTORS		
	2	4	6
SYNCHRONOUS SPEED (RPM) ►	3600	1800	1200
MOTOR HORSEPOWER ▼			
0.25	66.6	68.5	62.2
0.33	70.5	72.4	66.6
0.50	72.4	76.2	76.2
0.75	76.2	81.8	80.2
1	80.4	82.6	81.1
1.5	81.5	83.8	N/A
2	82.9	84.5	N/A
3	84.1	N/A	N/A

a. Average full load efficiencies shall be established in accordance with 10 CFR. 431.

C405.9 Vertical and horizontal transportation systems and equipment. Vertical and horizontal transportation systems and equipment shall comply with this section.

C405.9.1 Elevator cabs. For the luminaires in each elevator cab, not including signals and displays, the sum of the lumens divided by the sum of the watts shall be not less than 35 lumens per watt. Ventilation fans in elevators that do not have their own air conditioning system shall not consume more than 0.33 watts/cfm at the maximum rated speed of the fan. Controls shall be provided that will de-energize ventilation fans and lighting systems when the elevator is stopped, unoccupied and with its doors closed for over 15 minutes.

C405.9.2 Escalators and moving walks. Escalators and moving walks shall comply with ASME A17.1/CSA B44 and shall have automatic controls configured to reduce speed to the minimum permitted speed in accordance with ASME A17.1/CSA B44 or applicable local code when not conveying passengers.

Exception: A ~~power factor controller-variable voltage drive system~~ that reduces operating voltage in response to light loading conditions may be provided in place of the variable speed function.

C405.9.3 Regenerative drive. An escalators designed either for one-way down operation only or for reversible operation shall have a variable frequency regenerative drive that supplies electrical energy to the building electrical system when the escalator is loaded with passengers whose combined weight exceeds 750 pounds.

C405.10 Controlled receptacles. At least 50 percent of all 125 volt 15- and 20-ampere receptacles installed in private offices, open offices, conference rooms, rooms used primarily for printing and/or copying functions, break rooms, individual workstations and classrooms, including those installed in modular partitions and modular office workstation systems, shall be controlled as required by this section. In rooms larger than 200 square feet (19 m²), a controlled receptacle shall be located within 72 inches (1.8 m) of each uncontrolled receptacle. Controlled receptacles shall be visibly differentiated from standard receptacles and shall be controlled by one of the following automatic control devices:

4.1. An occupant sensor that turns receptacle power off when no occupants have been detected for a maximum of 20 minutes.

5.2. A time-of-day operated control device that turns receptacle power off at specific programmed times and can be programmed separately for each day of the week. The control device shall be configured to provide an independent schedule for each portion of the building not to exceed 5,000 square feet (465 m²) and not to exceed one full floor. The device shall be capable of being overridden for periods of up to two hours by a timer ~~accessible in a location with access~~ to occupants. Any individual override switch shall control the controlled receptacles for a maximum area of 5,000 square feet (465 m²). Override switches for controlled receptacles are permitted to control the lighting within the same area.

Exception: Receptacles designated for specific equipment requiring 24-hour operation, for building maintenance functions, or for specific safety or security equipment are not required to be controlled by an automatic control device and are not required to be located within 72 inches of a controlled receptacle.

C405.11 ~~Reserved~~ Voltage drop in feeders and branch circuits. ~~The total voltage drop across the combination of feeders~~

and branch circuits shall not exceed five percent.

C405.12 Reserved.

C405.13 ~~C405.12 Commissioning. Electrical power and lighting systems commissioning and completion requirements.~~ Electrical power Controlled receptacles and lighting systems shall be commissioned ~~and completed~~ in accordance with Section C408.

Commented [BK(262)]
C147-2018

SECTION C406
~~ADDITIONAL EFFICIENCY PACKAGE OPTIONS~~

C406.1 ~~Requirements~~ **Additional energy efficiency credit requirements.** Buildings shall comply with no less than two of the following: New buildings and changes in space conditioning, change of occupancy and building additions in accordance with Chapter 5 shall comply with sufficient packages from Table C406.1 so as to achieve a minimum number of six credits. Mixed use buildings shall have a conditioned space area weighted average number of credits by building occupancy of at least six credits.

Commented [BK(263)]
O126-2018

1. ~~More efficient HVAC performance in accordance with Section C406.2.~~
2. ~~Reduced lighting power in accordance with Section C406.3.~~
3. ~~Enhanced lighting controls in accordance with Section C406.4.~~
4. ~~On-site supply of renewable energy in accordance with Section C406.5.~~
5. ~~Provision of a dedicated outdoor air system for certain HVAC equipment in accordance with Section C406.6.~~
6. ~~High efficiency service water heating in accordance with Section C406.7.~~
7. ~~Enhanced envelope performance in accordance with Section C406.8.~~
8. ~~Reduced air infiltration in accordance with Section C406.9.~~

Commented [BK(264)]
O125-2018

Exceptions:

1. Low energy spaces in accordance with Section C402.1.1.1 and equipment buildings in accordance with Section C402.1.2 shall comply with sufficient packages from Table C406.1 so as to achieve a minimum number of three credits from Sections C406.2 through C406.12, where applicable.
2. Building additions that have less than 1,000 square feet of conditioned floor area shall comply with sufficient packages from Table C406.1 so as to achieve a minimum number of three credits from Sections C406.2 through C406.12, where applicable.

Commented [BK(265)]
O126-2018
correlated with
language from 125

Commented [BK(266)]
O125-2018

TABLE C406.1
EFFICIENCY PACKAGE CREDITS

Code Section	Commercial Building Occupancy					
	Group R-1	Group R-2	Group B	Group E	Group M	All Other
	Additional Efficiency Credits					
1. More efficient HVAC performance in accordance with Section C406.2	2.0	3.0	3.0	2.0	1.0	2.0
2. Reduced lighting power: Option 1 in accordance with Section C406.3.1	1.0	1.0	2.0	2.0	3.0	2.0
3. Reduced lighting power: Option 2 in accordance with Section C406.3.2 ^a	2.0	3.0	4.0	4.0	6.0	4.0
4. Enhanced lighting controls in accordance with Section C406.4	NA	NA	1.0	1.0	1.0	1.0
5. On-site supply of renewable energy in accordance with C406.5	3.0	3.0	3.0	3.0	3.0	3.0

6. Dedicated outdoor air system in accordance with Section C406.6 ^b	4.0	4.0	4.0	4.0	4.0	4.0
7. High performance dedicated outdoor air system in accordance with Section C406.7						
8. High-efficiency service water heating in accordance with Sections C406.8.1 and C406.8.2	7.0	8.0	NA	NA	NA	8.0
9. High performance service water heating in multi-family buildings in accordance with Section C406.9	NA		NA	NA	NA	NA
10. Enhanced envelope performance in accordance with Section C406.10	3.0	6.0	3.0	3.0	3.0	4.0
11. Reduced air infiltration in accordance with Section C406.11	1.0	2.0	1.0	1.0	1.0	1.0
12. Enhanced commercial kitchen equipment in accordance with Section C406.12	5.0	NA	NA	NA	5.0	5.0 (Group A-2 only)

Commented [BK(267)]
0128-2018

Commented [BK(268)]
0130-2018

Commented [BK(269)]
0127-2018

a. Projects using this option may not use Item 2.

b. This option is not available to buildings subject to the prescriptive requirements of Section C403.3.5.

C406.1.1 Tenant spaces. ~~Tenant spaces~~ Initial tenant improvement shall comply with sufficient packages from Table C406.1 so as to achieve a minimum number of three credits from Section C406.2, C406.3, C406.4, C406.6, ~~or~~ C406.7, C406.8 or C406.10, where applicable. In buildings with multiple tenant spaces, each tenant space is permitted to comply individually. Where an entire building complies with Section C406.5, ~~C406.8~~ C406.10 or ~~C406.9~~ C406.11, tenant spaces within the building shall be deemed to comply with this section.

Commented [BK(270)]
0125-2018

Exception: Previously occupied tenant spaces in existing buildings that comply with this code in accordance with Section C501.

Commented [BK(271)]
0126-2018

C406.2 More efficient HVAC equipment and fan performance. No less than 90 percent of the total HVAC capacity serving the total conditioned floor area of the entire building, building addition, shell and core area in accordance with Section C406.1.1 or tenant space in accordance with Section C406.1.2. For systems required to comply with Section C403.1.1, HVAC total system performance ratio, exceed the minimum requirement by 10 percent. Buildings Other HVAC systems serving the conditioned floor area of the whole building, building addition or tenant space shall comply with Sections C406.2.1 through C406.2.3.

Commented [BK(272)]
0133-2018

Commented [BK(273)]
M050-2018

Commented [BK(274)]
0126-2018

Exception: In low energy spaces complying with Section C402.1.1 and semi-heated spaces complying with Section C402.1.1.2, no less than 90 percent of the installed heating capacity is provided by electric infrared or gas-fired radiant heating equipment for localized heating applications. Stand-alone supply, return and exhaust fans shall comply with Section C406.2.3.

Commented [BK(275)]
0133-2018

C406.2.1 HVAC system selection. No less than 90 percent of the total HVAC capacity serving the building Equipment installed shall be provided by equipment that is types that are listed in Tables C403.2.3(1) through C403.2.3(9) or a combination thereof. Electric resistance heating does not meet this requirement.

Commented [BK(276)]
0126-2018

Commented [BK(277)]
0133-2018

Exception: Allowed equipment not listed in Tables C403.2.3(1) through C403.2.3(9):

1. Air-to-water heat pumps.

2. ~~or~~ Heat recovery chillers ~~are also permitted to be utilized for Option C406.2.~~

Commented [BK(278)]
0133-2018

C406.2.2 Minimum equipment efficiency. Equipment shall exceed the minimum efficiency requirements listed in Tables C403.2.3(1) through C403.2.3(9) by 15 percent, in addition to the requirements of Section C403. Where multiple performance requirements are provided, the equipment shall exceed all requirements by 15 percent.

Exceptions:

1. Equipment that is larger than the maximum capacity range indicated in Tables C403.2.3(1) through C403.2.3(9) shall utilize the values listed for the largest capacity equipment for the associated equipment type shown in the table.
2. ~~Equipment complying with the exception to Section C406.2.1 is not required to comply with the minimum equipment efficiency requirement.~~
3. ~~Compliance may be demonstrated by calculating a total weighted average percentage for all heating and cooling equipment combined. All equipment shall have efficiency that is no less than 5% better than the minimum required efficiency in Table C403.2.3(1) through C403.2.3(9), and the resulting weighted average percentage for all equipment performance requirements shall exceed 15 percent. Calculation shall include heating and cooling capacities for all equipment, percentage better or worse than minimum required efficiency per Tables C403.2.3(1) through C403.2.3(9) for to each performance requirement (SEER, EER/IEER, COP, HSPF, E_r, E_c, and AFUE), and the total weighted average efficiency percentage.~~

Commented [BK(279)]
0133-2018

C406.2.3 Minimum fan efficiency. Stand-alone supply, return and exhaust fans designed for operating with motors over 750 watts (1 hp) shall have an ~~energy-fan~~ efficiency ~~classification-grade~~ of not less than FEG 71 as defined in AMCA 205. The total efficiency of the fan at the design point of operation shall be within 10 percentage points of either the maximum total efficiency of the fan or the static efficiency of the fan.

C406.3 Reduced lighting power. ~~Buildings-Interior lighting with the whole building, building addition or tenant space shall comply with Sections C406.3.1 and, where applicable, or C406.3.2. Dwelling units and sleeping units within the building shall comply with Section C406.3.3.~~

Commented [BK(280)]
0126-2018

Commented [BK(281)]
0125-2018

Commented [BK(282)]
0125-2018

C406.3.1 Reduced lighting power-density option 1. The total connected interior lighting power ~~(watts) of the building~~ calculated in accordance with Section C405.4.1 shall be ~~75-90~~ percent or less of the lighting power values specified in Table C405.4.2(1) times the floor area for the building types, or by using ~~75-90~~ percent of the total interior lighting power allowance calculated ~~by the Space-by-Space Method in in accordance with~~ Section C405.4.2.

C406.3.2 Reduced lighting power option 2. The total connected interior lighting power calculated in accordance with Section C405.4.1 shall be 80 percent or less of the lighting power values specified in Table C405.4.2(1) times the floor area for the building types, or by using 80 percent of the total interior lighting power allowance calculated in accordance with Section C405.4.2.

Commented [BK(283)]
0125-2018

~~C406.3.2~~ **C406.3.3 Lamp fraction.** Not less than 95 percent of the ~~interior lighting power (watts) from lamps in~~ permanently installed light fixtures in dwelling units and sleeping units shall be provided by high efficacy lamps with a minimum efficacy of ~~60-65~~ lumens per watt.

Commented [BK(284)]
0135-2018

Commented [BK(285)]
0125-2018

C406.4 Enhanced digital lighting controls. ~~Interior lighting shall be located, scheduled and operated in accordance with Section C405.2 and~~ No less than 90 percent of the total installed interior lighting power within the whole building, building addition or tenant space shall be configured with the following enhanced control functions comply with Section C406.4.1.

C406.4.1 Lighting controls function. Interior lighting shall be located, scheduled and operated in accordance with Section C405.2, and shall be configured with the following enhanced control functions:

Commented [BK(286)]
0126-2018

1. Luminaires shall be configured for continuous dimming.
2. Each luminaire shall be individually addressed.

Exceptions to Item 2:

Commented [BK(287)]
0125-2018

- ~~e.1.~~ Multiple luminaires mounted on no more than 12 linear feet of a single lighting track and addressed as a single luminaire.
- ~~d.2.~~ Multiple linear luminaires that are ganged together to create the appearance of a single longer fixture and addressed as a single luminaire, where the total length of the combined luminaires is not more than 12 feet.
- ~~e.3.~~ Not more than eight luminaires within a *daylight zone* are permitted to be controlled by a single *daylight responsive control*.
- ~~f.4.~~ Luminaires shall be controlled by a digital control system configured with the following capabilities:
 - ~~a.4.1.~~ Scheduling and illumination levels of individual luminaires and groups of luminaires are capable of being reconfigured through the system.
 - ~~b.4.2.~~ Load shedding.
 - ~~e.4.3.~~ In open and enclosed offices, the illumination level of overhead general illumination luminaires are configured to be individually adjusted by occupants.

~~4.4.4.~~ Occupancy sensors and daylight responsive controls are capable of being reconfigured through the system.

~~g.5.~~ Construction documents shall include submittal of a Sequence of Operations, including a specification outlining each of the functions required by this section.

C406.5 On-site renewable energy. Buildings shall be provided with on-site renewable energy systems with an annual production per square foot of ~~conditioned floor area of the building of not no~~ less than the value specified in Table C406.5 ~~based on the total conditioned floor area of the whole building.~~ ~~The on-site renewable used in this option shall be separate from on-site renewables used as part of Section C406.7 or used to qualify for any exception in code.~~

Commented [BK(288)]
0126-2018

Commented [BK(289)]
G004-2018

**TABLE C406.5
ON-SITE RENEWABLE ENERGY
SYSTEM RATING
(PER SQUARE FOOT)**

Building Area Type	kBTU per year	kWh per year
Assembly	1.8	0.53
Dining	10.7	3.14
Hospital	3.6	1.06
Hotel/Motel	2.0	0.59
Multi-family residential	0.50	0.15
Office	0.82	0.24
Other	2.02	0.59
Retail	1.31	0.38
School/University	1.17	0.34
Supermarket	5.0	1.47
Warehouse	0.43	0.13

C406.6 Dedicated outdoor air system (DOAS). ~~Not less than 90 percent of the building-total conditioned floor area of the whole building, building addition or tenant space,~~ excluding floor area of unoccupied spaces that do not require ventilation per the *International Mechanical Code*, shall be served by DOAS installed in accordance with Section ~~C403.6~~~~C403.3.5~~. This option is ~~not~~ available to ~~both~~ buildings subject to ~~and not subject to~~ the prescriptive requirements of Section ~~C403.6~~~~C403.3.5~~.

Commented [BK(290)]
0126-2018

Commented [BK(291)]
0125-2018

C406.7 High performance dedicated outdoor air system (DOAS). Buildings which include DOAS complying with Section C403.3.5 or C406.6 shall also provide minimum sensible effectiveness of heat recovery of 80 percent and DOAS total combined fan power less than 0.5 W/cfm of outdoor air. For the purposes of this section, total combined fan power includes all supply, exhaust, recirculation and other fans utilized for the purpose of ventilation.

Commented [BK(292)]
0130-2018

C406.7C406.8 Reduced energy use in service water heating. Buildings ~~with service hot water heating equipment that serves the whole building, building addition or tenant space~~ shall comply with Sections ~~C406.7.1 and C406.7.2~~~~C406.8.1 and C406.8.2~~.

Commented [BK(293)]
0126-2018

~~C406.7.1~~C406.8.1 Building type. Not less than 90 percent of the ~~building~~ conditioned floor area shall be of the following types:

Commented [BK(294)]
0125-2018

~~a.1.~~ Group R-1: Boarding houses, hotels or motels.

~~b.2.~~ Group I-2: Hospitals, psychiatric hospitals and nursing homes.

~~e.3.~~ Group A-2: Restaurants and banquet halls or buildings containing food preparation areas.

~~d.4.~~ Group F: Laundries.

~~e.5.~~ Group R-2: ~~Buildings with residential occupancies.~~

~~f.6.~~ Group A-3: Health clubs and spas.

~~g.7.~~ Buildings with a service hot water load of 10 percent or more of total building energy loads, as shown with an energy analysis as described in Section C407 ~~or as shown through alternate service hot water load calculations showing a minimum service water energy use of 15 k/Btu per square foot per year, as approved by the building official.~~

Commented [BK(295)]
0139-2018

Commented [BK(296)]
0126-2018

Commented [BK(297)]
G004-2018

~~C406.7.2~~C406.8.2 Load fraction. Not less than 60 percent of the annual ~~building~~ service hot water heating energy use, or not less than 100 percent of the annual ~~building~~ service hot water heating energy use in buildings ~~with water-cooled systems~~ subject to the requirements of Section ~~C403.5.4~~~~C403.9.5~~ ~~or qualifying for one of its exceptions~~, shall be

provided by one or more of the following:

1. Service hot water system delivering heating requirements using heat pump technology with a minimum COP of 3.0. For air-source equipment, the COP rating will be reported at the design leaving heat pump water temperature with an entering air temperature of 60°F (15.6°C) or lower. For water-source equipment, the COP rating will be reported at the design leaving load water temperature with an entering water temperature of 74°F (23.3°C) or lower.
2. Waste heat recovery from service hot water, heat recovery chillers, building equipment, process equipment, ~~a combined heat and power system~~, or other *approved* system. Qualifying heat recovery must above and beyond heat recovery required by other sections of this code.
3. ~~Solar~~ On site renewable energy water-heating systems.

Commented [BK(298)]
0139-2018

Commented [BK(299)]
G004-2018

C406.9 High performance service water heating in multifamily buildings. For buildings with not less than 90 percent of the conditioned floor area being Group R-2 occupancy, not less than 90 percent of the annual building service hot water energy use shall be provided by a heat pump system with a minimum COP of 3.0. This efficiency package is allowed be taken in addition to Section C406.8.2.

Commented [BK(300)]
0130-2018

C406.8C406.10 Enhanced envelope performance. The ~~Proposed~~ Total Envelope UA of the building thermal envelope of the whole building or building addition shall be 15 percent lower than the ~~maximum~~ Allowable Total Envelope UA for an ~~area a building~~ of identical configuration and fenestration area in accordance with Section C402.1.5 and Equation 4-2, ~~where UA equals the sum of the U-values of each distinct envelope assembly multiplied by the area in square feet of that assembly.~~

Commented [BK(301)]
nv027-2018

Commented [BK(302)]
0126-2018

Commented [BK(303)]
nv027-2018

C406.9C406.11 Reduced air infiltration. Measured air infiltration of the total conditioned floor area of the whole building or fully isolated building addition shall comply with Section C406.11.1.

Commented [BK(304)]
0126-2018

Commented [BK(305)]
nv046-2018

C406.11.1 Air leakage testing and verification. Air infiltration shall be verified by whole building pressurization testing conducted in accordance with ASTM E779 or ASTM E1827 by an independent third party. The measured air leakage rate of the *building envelope* shall not exceed ~~0.25~~ 0.17 cfm/ft² (2.0 L/s•m²) under a pressure differential of 0.3 in. water (75 Pa), with the calculated surface area being the sum of the above and below grade building envelope. A report that includes the tested surface area, floor area, air by volume, stories above grade, and leakage rates shall be submitted to the *code official* and the building owner.

Exception: Where the *conditioned floor area* of the building is not less than 250,000 ft² (25,000 m²), air leakage testing shall be permitted to be conducted on representative above grade sections of the building provided the conditioned floor area of tested areas is no less than 25 percent of the conditioned floor area of the building and are tested in accordance with this section.

C406.12 Enhanced commercial kitchen equipment. For buildings and spaces designated as Group A-2, or facilities whose primary business type involves the use of a commercial kitchen with at least one gas or electric fryer, all fryers, dishwashers, steam cookers and ovens shall comply with all of the following:

1. Achieve the ENERGY STAR label in accordance with the specificaitons current as of January 1, 2018.
2. Be installed prior to the issuance of the Certificate of Occupancy.
3. Have the ENERGY STAR qualified model number listed on the construction documents submitted for permitting.

Commented [BK(306)]
0127-2018

SECTION C407 TOTAL BUILDING PERFORMANCE

C407.1 Scope. This section establishes criteria for compliance using total building performance. All systems and loads shall be included in determining the total building performance including, but not limited to: Heating systems, cooling systems, service water heating, fan systems, lighting power, receptacle loads and process loads.

Exception: Energy used to recharge or refuel vehicles that are used for on-road and off-site transportation purposes.

C407.2 Mandatory requirements. Compliance with this section requires ~~that the criteria of Sections C402.5, C403.2, C404 and C405 be met~~ compliance with those sections shown in Table C407.2.

The building permit application for projects utilizing this method shall include in one submittal all building and mechanical drawings and all information necessary to verify that the building envelope and mechanical design for the project corresponds with the annual energy analysis. If credit is proposed to be taken for lighting energy savings, then an electrical permit application shall also be submitted and approved prior to the issuance of the building permit. If credit is proposed to be taken for energy savings from other components, then the corresponding permit application (e.g., plumbing, boiler, etc.) shall also be submitted and approved prior to the building permit application. Otherwise, components of the project that would not be approved as part of a building permit application shall be modeled the same in both the proposed

building and the *standard reference design* and shall comply with the requirements of this code.

TABLE C407.2
MANDATORY COMPLIANCE MEASURES FOR TOTAL BUILDING PERFORMANCE METHOD

<u>Section</u>	<u>Title</u>	<u>Comments</u>
<u>Envelope</u>		
<u>C402.5</u>	<u>Air Leakage</u>	
<u>Mechanical</u>		
<u>C403.1.2</u>	<u>Calculation of heating and cooling loads</u>	
<u>C403.1.3</u>	<u>Data centers</u>	
<u>C403.2</u>	<u>System design</u>	
<u>C403.3.1</u>	<u>Equipment and system sizing</u>	
<u>C403.3.2</u>	<u>HVAC equipment performance requirements</u>	
<u>C403.3.6</u>	<u>Ventilation for Group R occupancy</u>	
<u>C403.4</u>	<u>HVAC system controls</u>	
<u>C403.4.1</u>	<u>Thermostatic controls</u>	<u>Except for C403.4.1.4</u>
<u>C403.4.2</u>	<u>Off-hour controls</u>	<u>Except for Group R</u>
<u>C403.4.7</u>	<u>Combustion heating equipment controls</u>	
<u>C403.4.8</u>	<u>Group R-1 hotel/motel guestrooms</u>	<u>See Section C403.7.6</u>
<u>C403.4.9</u>	<u>Group R-2 and R-3 dwelling units</u>	
<u>C403.4.10</u>	<u>Group R-2 sleeping units</u>	
<u>C403.4.11</u>	<u>Direct digital control systems</u>	
<u>C403.5.5</u>	<u>Economizer fault detection and diagnostics (FDD)</u>	
<u>C403.7</u>	<u>Ventilation and exhaust systems</u>	<u>Except for C403.7.6</u>
<u>C403.8</u>	<u>Fan and fan controls</u>	
<u>C403.9.1.1</u>	<u>Variable flow controls</u>	<u>For cooling tower fans > 7.5 hp</u>
<u>C403.9.1.2</u>	<u>Limitation on centrifugal fan cooling towers</u>	<u>For open cooling towers</u>
<u>C403.10</u>	<u>Construction of HVAC elements</u>	
<u>C403.11</u>	<u>Mechanical systems located outside of the building thermal envelope</u>	
<u>Service Water Heating</u>		
<u>C404</u>	<u>Service Water Heating</u>	
<u>Lighting and Electrical</u>		
<u>C405.1</u>	<u>General</u>	
<u>C405.2</u>	<u>Lighting controls</u>	
<u>C405.3</u>	<u>Exit signs</u>	
<u>C405.4</u>	<u>Interior lighting power</u>	
<u>C405.5</u>	<u>Exterior building lighting power</u>	
<u>C405.6</u>	<u>Electrical transformers</u>	
<u>C405.7</u>	<u>Dwelling unit energy consumption</u>	
<u>C405.8</u>	<u>Electric motor efficiency</u>	
<u>C405.9</u>	<u>Vertical and horizontal transportation</u>	
<u>C405.10</u>	<u>Controlled receptacles</u>	
<u>C405.11</u>	<u>Voltage drop in feeders</u>	
<u>Other Requirements</u>		
<u>C407</u>	<u>Total Building Performance</u>	

Commented [BK(307)]
M051-2018

Commented [BK(308)]
nv046-2018

<u>C408</u>	<u>System commissioning</u>	
<u>C409</u>	<u>Energy metering</u>	
<u>C410</u>	<u>Refrigeration requirements</u>	

C407.3 Performance-based compliance. Compliance based on total building performance requires that a proposed building (*proposed design*) be shown to have an annual energy consumption based on site energy expressed in Btu and Btu per square foot of conditioned floor area that complies with one of the following three options: Compliance with this section requires compliance with ASHRAE Standard 90.1 Appendix G, Performance Rating Method, in accordance with Standard 90.1 Section 4.2.1 with the following modifications.

1. Is less than or equal to 87 percent of the annual energy consumption of the *standard reference design*.
2. Is less than or equal to 90 percent of the annual energy consumption of the *standard reference design* and the project complies with one additional energy efficiency package option in Section C406. The standard reference design shall include the selected Section C406 additional efficiency package option unless the option selected is DOAS per Section C406.6. For office, retail, education, libraries and fire stations that comply with the DOAS requirements in Section C403.6 with or without exceptions, the standard reference design shall select the HVAC system per Table C407.5.1(2). Other buildings occupancy types that comply with the DOAS requirements in Section C403.6 shall select the standard reference design for the HVAC system from Table C407.5.1(3).

Is less than or equal to 93 percent of the annual energy consumption of the standard reference design and the project complies with two additional efficiency package options in Section C406. The standard reference design shall include the selected Section C406 additional efficiency package option unless the option selected is DOAS per Section C406.6. For office, retail, education, libraries and fire stations that comply with the DOAS requirements in Section C403.6 with or without exceptions, the standard reference design shall select the HVAC system per Table C407.5.1(2). Other buildings occupancy types that comply with the DOAS requirements in Section C403.6 shall select the standard reference design for the HVAC system from Table C407.5.1(3).

1. The mandatory requirements of Section G1.2.1a of Standard 90.1 are not required to be met.
2. The reduction in annual carbon emissions of the proposed building design associated with on-site renewable energy shall not be more than 3 percent of the total carbon emissions of the baseline building design.
3. References to energy cost in Section 4.2.1.1 and Appendix G shall be replaced by carbon emissions calculated by multiplying site energy consumption by the carbon emission factor from Table C407.3(1).
- 3.4. The building performance factors in Table C4.2.1.1 shall be replaced with those in Table C407.3(2).

Commented [BK(309)]
P144-2018

TABLE C407.3(1)
CARBON EMISSIONS FACTORS

<u>Type</u>	<u>CO2e (lb/unit)</u>	<u>Unit</u>
<u>Electricity</u>	<u>0.55</u>	<u>kWh</u>
<u>Natural Gas</u>	<u>11.7</u>	<u>Therm</u>
<u>Oil</u>	<u>19.2</u>	<u>Gallon</u>
<u>Propane</u>	<u>10.5</u>	<u>Gallon</u>
<u>Other^a</u>	<u>195.00</u>	<u>mmBtu</u>
<u>On-site renewable energy</u>	<u>0.00</u>	

- a. District energy systems may use alternative emission factors supported by calculations approved by the *code official*.

TABLE C407.3(2)
BUILDING PERFORMANCE FACTORS (BPF) TO BE USED
FOR COMPLIANCE WITH SECTION C407.3

<u>Building Area Type</u>	<u>Building Performance Factor</u>
<u>Multifamily</u>	<u>0.56</u>

Commented [BK(310)]
P141-2018

<u>Healthcare/hospital</u>	<u>0.54</u>
<u>Hotel/motel</u>	<u>0.64</u>
<u>Office</u>	<u>0.54</u>
<u>Restaurant</u>	<u>0.73</u>
<u>Retail</u>	<u>0.46</u>
<u>School</u>	<u>0.33</u>
<u>Warehouse</u>	<u>0.49</u>
<u>All Others</u>	<u>0.54</u>

C407.3.1 Limits on non-mandatory measures. The proposed total envelope UA of the proposed building shall be no more than 20 percent higher than the allowed total envelope UA as defined in Section C402.1.5.

Commented [BK(311)]
P143-2018

C407.4 Documentation. Documentation verifying that the methods and accuracy of compliance software tools conform to the provisions of this section shall be provided to the *code official*.

C407.4.1 Compliance report. Building permit submittals shall include a report that documents that the *proposed design* has annual energy consumption less than or equal to the annual energy consumption of the *standard reference design*. The compliance documentation shall include the following information:

1. Address of the building;
2. An inspection checklist documenting the building component characteristics of the *proposed design* as listed in Table C407.5.1(1). The inspection checklist shall show the estimated annual energy consumption for both the *standard reference design* and the *proposed design*;
3. Name of individual completing the compliance report; and
4. Name and version of the compliance software tool.

C407.4.2 Additional documentation. The *code official* shall be permitted to require the following documents:

1. Documentation of the building component characteristics of the *standard reference design*;
2. Thermal zoning diagrams consisting of floor plans showing the thermal zoning scheme for *standard reference design* and *proposed design*;
3. Input and output report(s) from the energy analysis simulation program containing the complete input and output files, as applicable. The output file shall include energy use totals and energy use by energy source and end use served, total hours that space conditioning loads are not met and any errors or warning messages generated by the simulation tool as applicable;
4. An explanation of any error or warning messages appearing in the simulation tool output; and
5. A certification signed by the builder providing the building component characteristics of the *proposed design* as given in Table C407.5.1(1).

5.6. Documentation of the reduction in energy use associated with on-site renewable energy.

C407.5 Calculation procedure. Except as specified by this section, the *standard reference design* and *proposed design* shall be configured and analyzed using identical methods and techniques.

C407.5.1 Building specifications. The *standard reference design* and *proposed design* shall be configured and analyzed as specified by Table C407.5.1(1). Table C407.5.1(1) shall include by reference all notes contained in Table C402.1.4.

C407.5.2 Thermal blocks. The *standard reference design* and *proposed design* shall be analyzed using identical thermal blocks as specified in Section C407.5.2.1, C407.5.2.2 or C407.5.2.3.

C407.5.2.1 HVAC zones designed. Where HVAC *zones* are defined on HVAC design drawings, each HVAC *zone* shall be modeled as a separate thermal block.

Exception: Different HVAC *zones* shall be allowed to be combined to create a single thermal block or identical thermal blocks to which multipliers are applied provided:

1. The space use classification is the same throughout the thermal block.
2. All HVAC *zones* in the thermal block that are adjacent to glazed exterior walls face the same orientation or their orientations are within 45 degrees (0.79 rad) of each other.
3. All of the *zones* are served by the same HVAC system or by the same kind of HVAC system.

C407.5.2.2 HVAC zones not designed. Where HVAC zones have not yet been designed, thermal blocks shall be defined based on similar internal load densities, occupancy, lighting, thermal and temperature schedules, and in combination with the following guidelines:

- a.1. Separate thermal blocks shall be assumed for interior and perimeter spaces. Interior spaces shall be those located more than 15 feet (4572 mm) from an exterior wall. Perimeter spaces shall be those located closer than 15 feet (4572 mm) from an exterior wall.
- b.2. Separate thermal blocks shall be assumed for spaces adjacent to glazed exterior walls. A separate zone shall be provided for each orientation, except orientations that differ by no more than 45 degrees (0.79 rad) shall be permitted to be considered to be the same orientation. Each zone shall include floor area that is 15 feet (4572 mm) or less from a glazed perimeter wall, except that floor area within 15 feet (4572 mm) of glazed perimeter walls having more than one orientation shall be divided proportionately between zones.
- c.3. Separate thermal blocks shall be assumed for spaces having floors that are in contact with the ground or exposed to ambient conditions from zones that do not share these features.
- d.4. Separate thermal blocks shall be assumed for spaces having exterior ceiling or roof assemblies from zones that do not share these features.

C407.5.2.3 Multifamily residential Group R-2 occupancy buildings. Residential Group R-2 occupancy spaces shall be modeled using one thermal block per space except that those facing the same orientations are permitted to be combined into one thermal block. Corner units and units with roof or floor loads shall only be combined with units sharing these features.

C407.5.3 Equipment efficiencies. All HVAC equipment in the standard reference design shall be modeled at the minimum efficiency levels, both part load and full load, in accordance with Section C403.2.3. Chillers shall use Path A efficiencies as shown in Table C403.2.3(7). Where efficiency ratings include supply fan energy, the efficiency rating shall be adjusted to remove the supply fan energy. For Baseline Systems HVAC Systems 3, 4, 6, 8, 9, 10 and 11, calculate the minimum COP_{nfc} and COP_{nfh} using the equation for the applicable performance rating as indicated in Tables C403.2.3(1) through C403.2.3(3). Where a full and part load efficiency rating is provided in Tables C403.2.3(1) through C403.2.3(3), use Equation 4-12.

(Equation 4-12)

$$\text{COP}_{\text{nfc}} = 7.84 \times 10^{-8} \times \text{EER} \times Q + 0.338 \times \text{EER}$$

$$\text{COP}_{\text{nfc}} = -0.0076 \times \text{SEER}^2 + 0.3796 \times \text{SEER}$$

$$\text{COP}_{\text{nfh}} = 1.48 \times 10^{-7} \times \text{COP}_{47} \times Q + 1.062 \times \text{COP}_{47}$$

—(applies to heat pump heating efficiency only)

$$\text{COP}_{\text{nfh}} = -0.0296 \times \text{HSPF}^2 + 0.7134 \times \text{HSPF}$$

Where:

COP_{nfc} = The packaged HVAC equipment cooling energy efficiency

COP_{nfh} = The packaged HVAC equipment heating energy efficiency

Q = The AHRI rated cooling capacity in Btu/h.

EER, SEER, COP and HSPF shall be at AHRI test conditions. Fan energy shall be modeled separately according to Table C407.5.1(1).

TABLE C407.5.1(1)
SPECIFICATIONS FOR THE STANDARD REFERENCE AND PROPOSED DESIGNS

Building Component Characteristics	Standard Reference Design	Proposed Design
Space-use classification	Same as proposed	The space use classification shall be chosen in accordance with Table C405.4.2 for all areas of the building covered by this permit. Where the space use classification for a building is not known, the building shall be categorized as an office building.
Roofs	Type: Insulation entirely above deck Gross area: Same as proposed U factor: From Table C402.1.4 Solar absorptance: 0.75 Emittance: 0.90	As proposed As proposed As proposed As proposed As proposed
Walls, above-grade	Type: Mass wall if proposed wall is mass; otherwise steel-framed wall Gross area: Same as proposed U factor: From Table C402.1.4 Solar absorptance: 0.75 Emittance: 0.90	As proposed As proposed As proposed As proposed As proposed
Walls, below-grade	Type: Mass wall Gross area: Same as proposed U Factor: From Table C402.1.4 with insulation layer on interior side of walls	As proposed As proposed As proposed
Floors, above-grade	Type: Joist/framed floor Gross area: Same as proposed U factor: From Table C402.1.4	As proposed As proposed As proposed
Floors, slab-on-grade	Type: Unheated F factor: From Table C402.1.4	As proposed As proposed
Opaque Doors	Type: Swinging Area: Same as proposed U factor: From Table C402.1.4	As proposed As proposed As proposed
Vertical Fenestration Other than opaque doors	Area 1. The proposed vertical fenestration area; where the proposed vertical fenestration area is less than 30 percent of above-grade wall area. 2. 30 percent of above-grade wall area; where the proposed vertical fenestration area is 30 percent or more of the above-grade wall area. U factor: From Table C402.4 for the same framing material as proposed SHGC: From Table C402.4 except that for climates with no requirement (NR) SHGC = 0.40 shall be used External shading and PF: None	As proposed As proposed As proposed As proposed
Skylights	Area 1. The proposed skylight area; where the proposed skylight area is less than 3 percent of gross area of roof assembly that permitted by Section C402.1.	As proposed

	<p>2. 3 percent of gross area of roof assembly The area permitted by Section C402.1; where the proposed skylight area is 3 percent or more of gross area of roof assembly exceeds that permitted by Section C402.1.</p> <p>U factor: From Table C402.4</p> <p>SHGC: From Table C402.4 except that for climates with no requirement (NR) SHGC = 0.40 shall be used</p>	<p>As proposed</p> <p>As proposed</p>
Air Leakage	<p>For infiltration, the air leakage rate as determined below shall be modeled at 100% when the building fan system is off, and at 25% when the building fan system is on, unless otherwise approved by the building official for unusually pressurized buildings. Per PNNL Report 18898, <i>Infiltration Modeling Guidelines for Commercial Building Energy Analysis</i>, the building air leakage rates as determined in accordance with Section C402.5.1.2 at 0.30 in. w.g. (75 Pa) shall be converted for modeling in annual energy analysis programs by being multiplied by 0.112 unless other multipliers are approved by the building official (e.g., a tested air leakage of 0.40 cfm/ft² of total building envelope area at 0.30 in. w.g. (75 Pa) would be calculated at 0.045 cfm/ft² of building envelope area). The calculated infiltration rate shall be normalized to the input required by the modeling software.</p>	<p>The Proposed Design air leakage shall be the same as the Standard Design.</p>
Lighting, interior	<p>The interior lighting power shall be determined in accordance with Table C405.4.2. As proposed when the occupancy of the space is not known.</p> <p>Automatic lighting controls (e.g., programmable controls or automatic controls for daylight utilization) shall be modeled in the standard reference design as required by Section C405.</p>	<p>As proposed; where the occupancy of the space is not known, the lighting power density shall be based on the space classification as offices in Table C405.4.2(1).</p>
Lighting, exterior	<p>The lighting power shall be determined in accordance with Table C405.5.23(2). Areas and dimensions of tradable and nontradable surfaces shall be the same as proposed.</p>	<p>As proposed</p>
Internal gains	<p>Same as proposed</p>	<p>Receptacle, motor and process loads shall be modeled and estimated based on the space use classification. All end use load components within and associated with the building shall be modeled to include, but not be limited to, the following: Exhaust fans, parking garage ventilation fans, exterior building lighting, swimming pool heaters and pumps, elevators, escalators, refrigeration equipment and cooking equipment.</p>

Schedules	<p>Same as proposed</p> <p>Exception: Thermostat settings and schedules for HVAC systems that utilize radiant heating, radiant cooling and elevated air speed, provided that equivalent levels of occupant thermal comfort are demonstrated by means of equal Standard Effective Temperature and calculated in Normative Appendix B of ASHRAE 55.</p>	<p>Operating schedules shall include hourly profiles for daily operation and shall account for variations between weekdays, weekends, holidays and any seasonal operation. Schedules shall model the time-dependent variations in occupancy, illumination, receptacle loads, thermostat settings, mechanical ventilation, HVAC equipment availability, service hot water usage and any process loads. The schedules shall be typical of the proposed building type as determined by the designer and approved by the jurisdiction.</p>
Outdoor airflow rates	<p>Same as proposed, or no higher than those allowed by Section C403.2.6 (without exception 1), whichever is less.</p> <p>Demand Control Ventilation: Shall be modeled as required by Section C403.6 including reduction to the minimum ventilation rate when unoccupied.</p>	<p>As proposed, in accordance with Section C403.2.6.</p> <p>As proposed</p>
Heating systems	<p>Fuel type: Same as proposed design</p> <p>Equipment type^a: From Tables C407.5.1(2), C407.5.1(3) and C407.5.1(4)</p> <p>Efficiency: From Tables C403.2.3(2), C403.2.3(3), C403.2.3(4) and C403.2.3(5)</p> <p>Preheat coils: For HVAC system numbers 1 through 4, a preheat coil shall be modeled controlled to a fixed setpoint 20°F less than the design room heating temperature setpoint.</p> <p>Capacity^b: Sized proportionally to the capacities in the proposed design based on sizing runs, i.e., the ratio between the capacities used in the annual simulations and the capacities determined by the sizing runs shall be the same for both the proposed design and <i>standard reference design</i>, and shall be established such that no smaller number of unmet heating load hours and no larger heating capacity safety factors are provided than in the proposed design.</p> <p>Weather conditions used in sizing runs to determine <i>standard reference design</i> equipment capacities may be based either on hourly historical weather files containing typical peak conditions or on design days developed using 99.6% heating design temperatures and 1% dry bulb and 1% wet bulb cooling design temperatures.</p>	<p>As proposed</p> <p>As proposed</p> <p>As proposed</p> <p>As proposed</p>
Cooling systems	<p>Fuel type: Same as proposed design</p> <p>Equipment type^a: From Tables C407.5.1(2), C407.5.1(3) and C407.5.1(4)</p> <p>Efficiency: From Tables C403.2.3(1), C403.2.3(2) and C403.2.3(3). Chillers shall use Path A efficiency.</p> <p>Capacity^b: Sized proportionally to the capacities in the proposed design based on sizing runs, i.e., the ratio between the capacities used in the annual simulations and the capacities determined by the sizing runs shall be the same for both the proposed design and <i>standard reference design</i>, and shall be established such that no smaller number of unmet cooling load hours and no larger cooling capacity safety factors are provided than in the proposed design.</p>	<p>As proposed</p> <p>As proposed</p> <p>As proposed</p> <p>As proposed</p>

	Economizer⁴. Same as proposed, in accordance with Section C403.5. The high limit shutoff shall be a dry-bulb switch with a setpoint as determined by Table C403.5.3.3.	As proposed
Energy recovery	Standard reference design systems shall be modeled where required in Section C403.5.	As proposed
Fan systems	<p>Airflow rate: System design supply airflow rates for the standard reference design shall be based on a supply air to room air temperature difference of 20°F or the required ventilation air or makeup air, whichever is greater. If return or relief fans are specified in the proposed design, the standard reference design shall also be modeled with fans serving the same functions and sized for the standard reference design system supply fan air quantity less the minimum outdoor air, or 90% of the supply fan air quantity, whichever is larger.</p> <p>Motor brake horsepower: System fan electrical power for supply, return, exhaust, and relief (excluding power to fan-powered VAV boxes) shall be calculated using the following formulas:</p> <p>For systems 5, 7, 8 and 10 in Table C407.5.1(4), $P_{fan} = CFM_s \times 0.3$</p> <p>For all other systems, including DOAS, $P_{fan} = bhp \times 746 / \text{Fan Motor Efficiency}$</p> <p>Where:</p> <p>P_{fan} = Electric power to fan motor (watts)</p> <p>bhp = Brake horsepower of standard reference design fan motor from Table C403.2.12.1(1) — Option 2</p> <p>Fan motor = The efficiency from Tables C405.8(1) through C405.8(4) for the efficiency next motor size greater than the bhp using the enclosed motor at 1800 rpm</p> <p>CFM_s = The standard reference design system maximum design supply fan airflow rate in cfm</p> <p>DOAS fan power shall be calculated separately from the brake horsepower allowance.</p>	<p>As proposed</p> <p>As proposed</p>
On-site renewable energy	No on-site renewable energy shall be modeled in the standard reference design.	As proposed.
Shading from adjacent structures/terrain	Same as proposed.	For the standard reference design and the proposed building, shading by permanent structures and terrain shall be taken into account for computing energy consumption whether or not these features are located on the building site. A permanent fixture is one that is likely to remain for the life of the proposed design.
Service water heating	<p>Fuel type: Same as proposed</p> <p>Efficiency: From Table C404.2 and per Section C404.2.1</p> <p>Capacity: Same as proposed</p>	<p>As proposed</p> <p>As proposed</p>

	<p>Demand: Same as proposed</p> <p>Where no service water hot water system exists or is specified in the proposed design, no service hot water heating shall be modeled.</p> <p>Drain water heat recovery: Not required.</p>	<p>Service hot water energy consumption shall be calculated explicitly based upon the volume of service hot water required and the entering makeup water and the leaving service hot water temperatures. Entering water temperatures shall be estimated based upon the location. Leaving temperatures shall be based upon the end use requirements.</p> <p>Service water loads and usage shall be the same for both the <i>standard reference design</i> and the proposed design and shall be documented by the calculation procedures recommended by the manufacturer's specifications or generally accepted engineering methods.</p> <p>As proposed</p> <p>As proposed. Drain water heat recovery modeling shall take into account manufacturer's rated efficiencies per C404.9, quantity of connected drains, the proportional flow rates between the waste stream and the preheated stream.</p> <p>Reductions in service water heating energy use for drain water heat recovery shall be demonstrated by calculations.</p>
--	--	--

- a. ~~Where no heating system exists or has been specified, the heating system shall be modeled as fossil fuel. The system characteristics shall be identical in both the standard reference design and proposed design.~~
- b. ~~The ratio between the capacities used in the annual simulations and the capacities determined by sizing runs shall be the same for both the standard reference design and proposed design.~~
- c. ~~Where no cooling system exists or no cooling system has been specified, the cooling system shall be modeled as an air-cooled single-zone system, one unit per thermal zone. The system characteristics shall be identical in both the standard reference design and proposed design.~~
- d. ~~If an economizer is required in accordance with Section C403.5 and where no economizer exists or is specified in the proposed design, then an air economizer shall be provided in the standard reference design in accordance with Section C403.3~~C403.5.

TABLE C407.5.1(2)
HVAC SYSTEMS MAP FOR BUILDINGS GOVERNED BY SECTION C403.6^d

CONDENSER- COOLING SOURCE ^a	HEATING SYSTEM- CLASSIFICATION ^b	STANDARD REFERENCE DESIGN HVC SYSTEM TYPE ^c	
		Single-zone Residential System	All Other
Water/ground	Electric resistance	System 5	System 5
	Heat pump	System 6	System 6
	Fossil fuel	System 7	System 7
Air/none	Electric resistance	System 8	System 9
	Heat pump	System 8	System 9
	Fossil fuel	System 10	System 11

- 1.a.** Select "water/ground" if the proposed design system condenser is water or evaporatively cooled; select "air/none" if the condenser is air cooled. Closed circuit dry coolers shall be considered air cooled. Systems utilizing district cooling shall be treated as if the condenser water type were "water." If no mechanical cooling is specified or the mechanical cooling system in the proposed design does not require heat rejection, the system shall be treated as if the condenser water type were "Air." For proposed designs with ground-source or groundwater-source heat pumps, the standard reference design HVAC system shall be water-source heat pump (System 6).
- 2.b.** Systems utilizing district heating (steam or hot water) or district cooling and systems with no heating capability shall be treated as if the heating system type were "fossil fuel" for the purpose of Standard Reference Design HVAC system selection. Otherwise, select the path that corresponds to the proposed design heat source: Electric resistance, heat pump (including air source and water source), or fuel fired. For systems with mixed fuel heating sources, the system or systems that use the secondary heating source type (the one with the smallest total installed output capacity for the spaces served by the system) shall be modeled identically in the standard reference design and the primary heating source type shall be used to determine standard reference design HVAC system type.
- 3.** Select the standard reference design HVAC system category: The system under "single-zone residential system" shall be selected if the HVAC system in the proposed design is a single-zone system and serves a residential space. The system under "all other" shall be selected for all other cases.
- 4.c.** This table covers those building types required by Section C403.6 to install Dedicated Outdoor Air Systems: office, retail, education, libraries and fire stations.

TABLE C407.5.1(3)
HVAC SYSTEMS MAP

CONDENSER- COOLING- SOURCE ^a	HEATING SYSTEM- CLASSIFICATION ^b	STANDARD REFERENCE DESIGN HVC SYSTEM TYPE ^c		
		Single-zone Residential System	Single-zone- Nonresidential System	All Other
Water/ground	Electric resistance	System 5	System 5	System 1
	Heat pump	System 6	System 6	System 6
	Fossil fuel	System 7	System 7	System 2
Air/none	Electric resistance	System 8	System 9	System 3
	Heat pump	System 8	System 9	System 3
	Fossil fuel	System 10	System 11	System 4

- a.** Select "water/ground" if the proposed design system condenser is water or evaporatively cooled; select "air/none" if the condenser is air cooled. Closed circuit dry coolers shall be considered air cooled. Systems utilizing district cooling shall be treated as if the condenser water type were "water." If no mechanical cooling is specified or the mechanical cooling system in the proposed design does not require heat rejection, the system shall be treated as if the condenser water type were "Air." For proposed designs with ground-source or groundwater-source heat pumps, the standard reference design HVAC system shall be water-source heat pump (System 6).
- b.** Select the path that corresponds to the proposed design heat source: electric resistance, heat pump (including air source and water source), or fuel fired. Systems utilizing district heating (steam or hot water) and systems with no heating capability shall be treated as if the heating system type were "fossil fuel." For systems with mixed fuel heating sources, the system or systems that use the secondary heating source type (the one with the smallest total installed output capacity for the spaces served by the system) shall be modeled identically in the standard reference design and the primary heating source type shall be used to determine standard reference design HVAC system type.
- c.** Select the standard reference design HVAC system category: The system under "single-zone residential system" shall be selected if the HVAC system in the proposed design is a single-zone system and serves a residential space Group R occupancy. The system under "single-zone nonresidential system" shall be selected if the HVAC system in the proposed design is a single-zone system and serves other than residential spaces. The system under "all other" shall be selected for all other cases.

TABLE C407.5.1(4)
SPECIFICATIONS FOR THE STANDARD REFERENCE DESIGN HVAC SYSTEM DESCRIPTIONS

SYSTEM NO.	SYSTEM TYPE	FAN CONTROL	COOLING TYPE	HEATING TYPE
1	Variable air volume with parallel fan-powered boxes ^a –	VAV ^d	Chilled water ^e	Electric resistance
2	Variable air volume with reheat ^b –	VAV ^d	Chilled water ^e	Hot water fossil fuel boiler ^f
3	Packaged variable air volume with parallel fan-powered boxes ^a –	VAV ^d	Direct expansion ^e	Electric resistance
4	Packaged variable air volume with reheat ^b –	VAV ^d	Direct expansion ^e	Hot water fossil fuel boiler ^f
5	Two pipe fan coil–	Constant volume ^{i+j}	Chilled water ^e	Electric resistance
6	Water source heat pump–	Constant volume ^{i+j}	Direct expansion ^e	Electric heat pump and boiler ^g
7 ^k	Four pipe fan coil–	Constant volume ^{i+j}	Chilled water ^e	Hot water fossil fuel boiler ^f
8 ^k	Packaged terminal heat pump–	Constant volume ^{i+j}	Direct expansion ^e	Electric heat pump ^h
9 ^k	Packaged rooftop heat pump–	Constant volume ^{i+j}	Direct expansion ^e	Electric heat pump ^h
10 ^k	Packaged terminal air conditioner–	Constant volume ^{i+j}	Direct expansion	Hot water fossil fuel boiler ^f
11 ^k	Packaged rooftop air conditioner–	Constant volume ^{i+j}	Direct expansion	Fossil fuel furnace

For SI: 1 foot = 304.8 mm, 1 cfm/ft² = 0.0004719, 1 Btu/h = 0.293 W, °C = [(°F) - 32]/1.8.

- 1.a. VAV with parallel boxes:** Fans in parallel VAV fan-powered boxes shall be sized for 50 percent of the peak design flow rate and shall be modeled with 0.35 W/cfm fan power. Minimum volume setpoints for fan-powered boxes shall be equal to the minimum rate for the space required for ventilation consistent with Section C403.4.4C403.6.1. Exception 4. Supply air temperature shall be reset based on zone demand. Design airflow rates shall be sized for the maximum reset supply air temperature. The air temperature for cooling shall be reset higher by 5°F under the minimum cooling load conditions.
- 2.b. VAV with reheat:** Minimum volume setpoints for VAV reheat boxes shall be 0.4 cfm/ft² of floor area. Supply air temperature shall be reset based on zone demand. Design airflow rates shall be sized for the maximum reset supply air temperature. The air temperature for cooling shall be reset higher by 5°F under the minimum cooling conditions.
- 3.e. Direct expansion:** The fuel type for the cooling system shall match that of the cooling system in the proposed design.
- 4.d. VAV:** When the proposed design system has a supply, return or relief fan motor horsepower (hp) requiring variable flow controls as required by Section C403.2.11.5C403.8.5.1, the corresponding fan in the VAV system of the standard reference design shall be modeled assuming a variable speed drive. For smaller fans, a forward-curved centrifugal fan with inlet vanes shall be modeled. If the proposed design's system has a direct digital control system at the zone level, static pressure setpoint reset based on zone requirements in accordance with Section C403.4.1C403.6.8 shall be modeled.
- 5.e. Chilled water:** For systems using purchased chilled water, the chillers are not explicitly modeled. Otherwise, the standard reference design's chiller plant shall be modeled with chillers having the number as indicated in Table C407.5.1(5) as a function of standard reference building chiller plant load and type as indicated in Table C407.5.1(6) as a function of individual chiller load. Where chiller fuel source is mixed, the system in the standard reference design shall have chillers with the same fuel types and with capacities having the same proportional capacity as the proposed design's chillers for each fuel type. Chilled water supply temperature shall be modeled at 44°F design supply temperature and 56°F return temperature. Piping losses shall not be modeled in either building model. Chilled water supply water temperature shall be reset in accordance with Section C403.4.2.4. Pump system power for each pumping system shall be the same as the proposed design; if the proposed design has no chilled water pumps, the standard reference design pump power shall be 22 W/gpm (equal to a pump operating against a 75-foot head, 65 percent combined impeller and motor efficiency). The chilled water system shall be modeled as primary only variable flow with flow maintained at the design rate through each chiller using a bypass. Chilled water pumps shall be modeled as riding the pump curve or with variable speed drives when required in Section C403.4.2.4. The heat rejection device shall be an axial fan cooling tower with variable speed fans if required in Section C403.4.3C403.9. Condenser water design supply temperature shall be 85°F or 10°F approach to design wet bulb temperature, whichever is lower, with a design temperature rise of 10°F. The tower shall be controlled to maintain a 70°F leaving water temperature where weather permits, floating up to leaving water temperature at design conditions. Pump system power for each pumping system shall be the same as the proposed design; if the proposed design has no condenser water pumps, the standard reference design pump power shall be 19 W/gpm (equal to a pump operating against a 60-foot head, 60 percent combined impeller and motor efficiency). Each chiller shall be modeled with separate condenser water and chilled water pumps interlocked to operate with the associated chiller.
- 6.f. Fossil fuel boiler:** For systems using purchased hot water or steam, the boilers are not explicitly modeled. Otherwise, the boiler plant shall use the same fuel as the proposed design and shall be natural draft. The standard reference design boiler plant shall be modeled with a single boiler if the standard reference design plant load is 600,000 Btu/h and less and with two equally sized boilers for plant capacities exceeding 600,000 Btu/h. Boilers shall be staged as required by the load. Hot water supply temperature shall be modeled at 180°F design supply temperature and 130°F return temperature. Piping losses shall not be modeled in either building model. Hot water supply water temperature shall be reset in accordance with Section C403.4.2.4. Pump system power for each pumping system shall be the same as the proposed design; if the proposed design has no hot water pumps, the standard reference design pump power shall be 19 W/gpm (equal to a pump operating against a 60-foot head, 60 percent combined impeller and motor efficiency). The hot water system shall be modeled as primary only with continuous variable flow. Hot water pumps shall be modeled as riding the pump curve or with variable speed drives when required by Section C403.4.2.4.

- 7.g. Electric heat pump and boiler:** Water-source heat pumps shall be connected to a common heat pump water loop controlled to maintain a heating setpoint of 60°F and a cooling setpoint of 90°F. Heat rejection from the loop shall be provided by an axial fan closed-circuit evaporative fluid cooler with variable speed fans if required in Section ~~C403.4.2.1~~~~C403.4.3.1~~ or ~~C403.2.13~~~~C403.2.3~~. Heat addition to the loop shall be provided by a boiler that uses the same fuel as the proposed design and shall be natural draft. If no boilers exist in the proposed design, the standard reference building boilers shall be fossil fuel. The standard reference design boiler plant shall be modeled with a single boiler if the standard reference design plant load is 600,000 Btu/h or less and with two equally sized boilers for plant capacities exceeding 600,000 Btu/h. Boilers shall be staged as required by the load. Piping losses shall not be modeled in either building model. Pump system power shall be the same as the proposed design; if the proposed design has no pumps, the standard reference design pump power shall be 22 W/gpm, which is equal to a pump operating against a 75-foot head, with a 65-percent combined impeller and motor efficiency. Loop flow shall be variable with flow shutoff at each heat pump when its compressor cycles off as required by Section ~~C403.4.2.3~~~~C403.4.3~~. Loop pumps shall be modeled as riding the pump curve or with variable speed drives when required by Section ~~C403.4.2.4~~.
- 8.h. Electric heat pump:** Electric air-source heat pumps shall be modeled with electric auxiliary heat and an outdoor air thermostat. The system shall be controlled to energize auxiliary heat only when outdoor air temperature is less than 40°F. The air-source heat pump shall be modeled to continue to operate while auxiliary heat is energized. The air-source heat pump shall be modeled to operate down to a minimum outdoor air temperature of 35°F for System No. 8 or 0°F for System No. 9. If the Proposed Design utilizes the same system type as the Standard Design (PTHP or PSZ-HP), the Proposed Design shall be modeled with the same minimum outdoor air temperature for heat pump operation as the Standard Design. For temperatures below the stated minimum outdoor air temperatures, the electric auxiliary heat shall be controlled to provide the full heating load.
- 9.i. Constant volume:** For building types governed by Section ~~C403.6~~~~C403.3.5~~, fans shall be controlled to cycle with load, i.e., fan operation cycled on calls for heating and cooling. If the fan is modeled as cycling and the fan energy is included in the energy efficiency rating of the equipment, fan energy shall not be modeled explicitly. For all other buildings, fans shall be controlled in the same manner as in the proposed design, i.e., fan operation whenever the space is occupied or fan operation cycled on calls for heating and cooling. If the fan is modeled as cycling and the fan energy is included in the energy efficiency rating of the equipment, fan energy shall not be modeled explicitly.
- 10.j. Fan speed control:** Fans shall operate as one or two speed as required by Section ~~C403.2.11.5~~~~C403.8.5.1~~, regardless of the fan speed control used in the proposed building.
- 11.k. Outside air:** For building types governed by Section ~~C403.6~~~~C403.3.5~~, outside air shall be supplied by a separate dedicated outside air system (DOAS) operating in parallel with terminal equipment. The terminal equipment fan system cycle calls for heating and cooling. DOAS shall include an Energy Recovery Ventilation System with a minimum effectiveness in accordance with Section ~~C403.5~~~~C403.7.7.1~~.

**TABLE C407.5.1(5)
NUMBER OF CHILLERS**

TOTAL CHILLER PLANT CAPACITY	NUMBER OF CHILLERS
≤ 300 tons	1
> 300 tons, ≤ 600 tons	2, sized equally
≥ 600 tons	2 minimum, with chillers added so that no chiller is larger than 800 tons, all sized equally

For SI: 1 ton = 3517 W.

**TABLE C407.5.1(6)
WATER CHILLER TYPES**

INDIVIDUAL CHILLER PLANT CAPACITY	ELECTRIC CHILLER TYPE	FOSSIL FUEL CHILLER TYPE
≤ 100 tons	Water-cooled Reciprocating	Single-effect absorption, direct fired
> 100 tons, ≤ 300 tons	Water-cooled Screw	Double-effect absorption, direct fired
≥ 300 tons	Water-cooled Centrifugal	Double-effect absorption, direct fired

For SI: 1 ton = 3517 W.

C407.6 Calculation software tools. Calculation procedures used to comply with this section shall be software tools capable of calculating the annual energy consumption of all building elements that differ between the *standard reference design* and the *proposed design* and shall include the following capabilities:

1. Building operation for a full calendar year (8,760 hours).
2. Climate data for a full calendar year (8,760 hours) and shall reflect *approved* coincident hourly data for temperature, solar radiation, humidity and wind speed for the building location.
3. Ten or more thermal zones.
4. Thermal mass effects.
5. Hourly variations in occupancy, illumination, receptacle loads, thermostat settings, mechanical ventilation, HVAC equipment availability, service hot water usage and any process loads.
6. Part load performance curves for mechanical equipment.
7. Capacity and efficiency correction curves for mechanical heating and cooling equipment.
8. Printed *code official* inspection checklist listing each of the *proposed design* component characteristics from Table C407.5.1(1) determined by the analysis to provide compliance, along with their respective performance ratings (e.g., *R* value, *U* factor, SHGC, HSPF, AFUE, SEER, EF, etc.).
9. Air side economizers with integrated control.
10. *Standard reference design* characteristics specified in Table C407.5.1(1).

C407.6.1 Specific approval. Performance analysis tools meeting the applicable subsections of Section C407 and tested according to ASHRAE Standard 140 shall be permitted to be *approved*. Tools are permitted to be *approved* based on meeting a specified threshold for a jurisdiction. The *code official* shall be permitted to approve tools for a specified application or limited scope.

C407.6.2 Input values. Where calculations require input values not specified by Sections C402, C403, C404 and C405, those input values shall be taken from an *approved* source.

C407.6.3 Exceptional calculation methods. Where the *simulation program* does not model a design, material, or device of the *proposed design*, an Exceptional Calculation Method shall be used where *approved* by the *code official*. Where there are multiple designs, materials, or devices that the *simulation program* does not model, each shall be calculated separately and Exceptional Savings determined for each. The total Exceptional Savings shall not constitute more than half of the difference between the *baseline building performance* and the *proposed building performance*. Applications for approval of an exceptional method shall include:

1. Step by step documentation of the Exceptional Calculation Method performed detailed enough to reproduce the results.
2. Copies of all spreadsheets used to perform the calculations.
3. A sensitivity analysis of energy consumption when each of the input parameters is varied from half to double the value assumed.
4. The calculations shall be performed on a time step basis consistent with the *simulation program* used.
5. The *Performance Rating* calculated with and without the Exceptional Calculation Method.

SECTION C408 SYSTEM COMMISSIONING

C408.1 General. A building commissioning process led by a *certified commissioning professional* and functional testing requirements shall be completed for mechanical systems in Section C403; service water heating systems in Section C404; electrical power controlled receptacle and lighting systems control systems in Section C405; equipment, appliance and systems installed to comply with Section C406 or C407; and energy metering in Section C409; and refrigeration systems in Section C410.

Exception: Buildings, or portions thereof, which are exempt from Sections C408.2 through C408.6 may be excluded from the commissioning process.

1. Mechanical systems are exempt from the commissioning process where the building's total mechanical equipment capacity is less than 240,000 Btu/h cooling capacity and less than 300,000 Btu/h heating capacity.
2. Service water heating systems are exempt from the commissioning process in buildings where the largest service water heating system capacity is less than 200,000 Btu/h and where there are no pools or permanent spas.

Commented [BK(312)]:
C148-2018

Commented [BK(313)]:
C150-2018

3. Lighting control systems are exempt from the commissioning process in buildings where both the total installed lighting load is less than 20 kW and the lighting load controlled by occupancy sensors or automatic daylighting controls is less than 10 kW.
4. Refrigeration systems are exempt from the commissioning process if they are limited to self-contained units.

Commented [BK(314)]
C148-2018

C408.1.1 Commissioning in construction documents. Construction documents ~~notes~~ shall clearly indicate provisions for commissioning ~~process and completion requirements in accordance with this section and are permitted to refer to specifications for further requirements.~~ The construction documents shall minimally include the following:

1. A narrative description of the activities that will be accomplished during the commissioning process. At a minimum, the commissioning process is required to include:
 - 1.1. Development and execution of the commissioning plan, including all subsections of Section C408.1.2;
 - 1.2. The *certified commissioning professional's* review of the building documentation and close out submittals in accordance with Section C103.6; and
 - 1.3. The commissioning report in accordance with Section C408.1.3.
2. Name and company for the *certified commissioning professional*.
3. A listing of the specific equipment, appliances or systems to be tested.

Commented [BK(315)]
C1248-2018

C408.1.2 Commissioning plan. A *commissioning plan* shall be developed by the project's *certified commissioning professional* and shall outline the organization, schedule, allocation of resources, and documentation requirements of the commissioning process. ~~Items 1 through 4 shall be included with the construction documents, and items 5 through 8 shall be submitted prior to the first mechanical inspection. For projects where no mechanical inspection is required, items 5 through 8 shall be submitted prior to the first electrical inspection.~~ The plan shall also include the following:

- 13.1. A narrative description of the activities that will be accomplished during each phase of commissioning, including the personnel intended to accomplish each of the activities, systems testing and balancing, functional performance testing, and verification of the building documentation requirements in Section C103.6.
- 14.2. Roles and responsibilities of the commissioning team, including the name and statement of qualifications of the *certified commissioning professional*.
15. ~~A schedule of activities including systems testing and balancing, functional performance testing, and verification of the building documentation requirements in Section C103.6.~~
16. ~~Where the *certified commissioning professional* is an employee of one of the registered design professionals of record or an employee or subcontractor of the project contractor, an In-House Commissioning Disclosure and Conflict Management Plan shall be submitted with the commissioning plan. This plan shall disclose the *certified commissioning professional's* contractual relationship with other team members and provide a conflict management plan demonstrating that the *certified commissioning professional* is free to identify any issues discovered and report directly to the owner.~~
- 17.3. A listing of the specific equipment, appliances or systems to be tested and a description of the tests to be performed.
18. ~~Functions to be tested.~~
19. ~~Conditions under which the test will be performed.~~
20. ~~Measurable criteria for performance.~~

Commented [BK(316)]
C148-2018

C408.1.2.1 In-House Commissioning Disclosure and Conflict Management Plan. Where the *certified commissioning professional's* contract or employment is other than directly with the building owner, an In-House Commissioning Disclosure and Conflict Management Plan shall be a part of the commissioning process. A copy shall be included in the commissioning plan. This plan shall disclose the *certified commissioning professional's* contractual relationship with other team members and provide a conflict management plan demonstrating that the *certified commissioning professional* is free to identify any issues discovered and report directly to the owner.

Commented [BK(317)]
C148-2018

C408.1.2.2 Functional performance testing. Functional performance testing shall be conducted for mechanical systems in Sections C403; service water heating systems in Section C404; controlled receptacles and lighting control systems in Section C405; equipment, appliances, systems installed to comply with Section C406 or C407; energy metering in Section C409; and refrigeration systems in Section C410. Written procedures which clearly describe the individual systematic test procedures, the expected system response or acceptance criteria for each procedure, the actual response or findings, and any pertinent discussion shall be followed. This testing shall include control systems which will be tested to document that control devices, components, equipment, and systems are calibrated and adjusted to operate in accordance with approved construction documents. Testing shall affirm the conditions required within Sections C408.2 through C408.7 under System Testing.

Commented [BK(318)]
C148-2018

C408.1.2.3 Functional performance testing - sampling. For projects with seven or fewer similar systems, each

system shall be tested. For projects with more than seven systems, testing shall be done for each unique combination of controls type. Where multiples of each unique combination of control types exist, no fewer than 20 percent of each combination shall be tested unless the *code official* or design professional requires a higher percentage to be tested. Where 30 percent or more of the tested system fail, all remaining identical combinations shall be tested.

C408.1.2.4 Deficiencies. Deficiencies found during testing shall be resolved including corrections and retesting.

C408.1.3 Final-Commissioning report. A ~~final~~-commissioning report shall be completed and certified by the *certified commissioning professional* and delivered to the building owner or owner's authorized agent. The report shall be organized with mechanical, service water heating, controlled receptacle and lighting control systems, service water-heating and energy metering, and refrigeration findings in separate sections to allow independent review. The report shall record the activities and results of the commissioning process and be developed from the final commissioning plan with all of its attached appendices. The report shall include:

1. Results of functional performance tests.
2. Disposition of deficiencies found during testing, including details of corrective measures used or proposed.
3. Functional performance test procedures used during the commissioning process including measurable criteria for test acceptance, provided herein for repeatability.
4. Commissioning plan.
- 3.5. Testing, Adjusting and Balancing Report.

Exception: Deferred tests which cannot be performed at the time of report preparation due to climatic conditions.

C408.1.4 Commissioning process completion requirements. Prior to the final mechanical, plumbing and electrical inspections or obtaining a certificate of occupancy, the *certified commissioning professional* ~~or approved agency~~ shall provide evidence of systems building commissioning and completion in accordance with the provisions of this section.

~~Copies of all documentation shall be given to the owner and made available to the code official upon request in accordance with Section C408.1.4.3~~

C408.1.4.1 Commissioning progress preliminary report for code compliance. A preliminary report of ~~commissioning test procedures and results shall be completed and certified by the certified commissioning professional or approved agency~~ and provided to the building owner or owner's authorized agent. The report shall be organized with mechanical, lighting, service water heating and metering findings in separate sections to allow independent review. The report shall be identified as "Preliminary Commissioning Report," ~~shall include the completed Commissioning Compliance Checklist, Figure C408.1.4.2, and shall identify:~~

- 2.1. Itemization of deficiencies found during testing required by this code that have not been corrected at the time of report preparation.
- 3.2. Deferred tests that cannot be performed at the time of report preparation because of climatic conditions, with anticipated date of completion.
3. Climatic conditions required for performance of the deferred tests.
4. Results of functional performance tests.
- 4.5. Functional performance test procedures used during commissioning process, including measurable criteria for test acceptance.
- 5.6. Status of the project's record documents, manuals and systems operation training with respect to requirements in Section C103.6.

C408.1.4.2 C408.1.4.1 Acceptance of report Commissioning compliance. Buildings, or portions thereof, shall not be considered acceptable for a final inspection pursuant to Section C104.2.6 until the *code official* has received a letter of transmittal from the building owner or owner's representative acknowledging that the building owner or owner's authorized agent has received the ~~Preliminary~~ Commissioning Report. Completion of ~~the~~ Commissioning Compliance Checklist (Figure C408.1.4.2) is deemed to satisfy this requirement. Phased acceptance of the Commissioning Compliance Checklist for portions of the work specific to the trade that is being inspected is permissible where accepted by the code official and where the certified commissioning professional remains responsible for completion of the commissioning process. If there are unresolved deficiencies when the final inspection is scheduled, the Commissioning Report shall be submitted and shall describe the unresolved deficiencies.

Commented [BK(319)]
C148-2018

Commented [BK(320)]
C148-2018

Commented [BK(321)]
C149-2018

Commented [BK(322)]
C149-2018

Commented [BK(323)]
C151-2018

Commented [BK(324)]
C149-2018

**FIGURE C408.1.4.2-C408.1.4.1
COMMISSIONING COMPLIANCE CHECKLIST**

Project Information	Project Name: _____	
	Project Address: _____	
	Certified Commissioning Professional: _____	
	Certifying Body: _____	

Commissioning Plan (Section C408.1.2)	<input checked="" type="checkbox"/> Commissioning Plan was used during construction and included items below– <ul style="list-style-type: none"> • A narrative description of activities and the personnel intended to accomplish each one • Measurable criteria for performance • Functions to be tested
---	--

Commissioned Systems (Sections C408.2, C408.3, C408.4 and C408.6)	<input checked="" type="checkbox"/> Mechanical Systems were included in the commissioning process (Section C408.2) Building mechanical systems have been tested to demonstrate the installation and operation of components, systems and system-to-system interfacing relationships in accordance with approved plans and specifications <input checked="" type="checkbox"/> There are unresolved deficiencies with the mechanical systems. These are described in the Preliminary Commissioning Report submitted to the Owner. The following items are not in compliance with energy code: _____
	<input checked="" type="checkbox"/> Service Water Heating Systems were included in the commissioning process (Section C408.3) Service water heating systems have been tested to demonstrate that control devices, components, equipment, and systems are calibrated, adjusted and operate in accordance with approved plans and specifications <input checked="" type="checkbox"/> There are unresolved deficiencies with the service water heating systems. These are described in the Preliminary Commissioning Report submitted to the Owner. The following items are not in compliance with energy code: _____
	<input checked="" type="checkbox"/> Electrical Power or Lighting Systems were included in the commissioning process (Section C408.4) Electrical power and automatic lighting controls have been tested to demonstrate the installation and operation of components, systems, and system-to-system interfacing relationships in accordance with approved plans and specifications <input checked="" type="checkbox"/> There are unresolved deficiencies with the electrical power and/or automatic lighting controls. These are described in the Preliminary Commissioning Report submitted to the Owner. The following items are not in compliance with energy code: _____
	<input checked="" type="checkbox"/> Additional systems included in the commissioning process (Section C408.5) If additional items were included, list them here: _____ <input checked="" type="checkbox"/> There are unresolved deficiencies with systems required by C406 or C407. These are described in the Preliminary Commissioning Report submitted to the Owner. The following items are not in compliance with energy code: _____
	<input checked="" type="checkbox"/> Metering System Functional Testing has been completed (Section C408.6) Energy source meters, energy end-use meters, the energy metering data acquisition system and required display are calibrated, adjusted and operate to minimally meet code requirements. <input checked="" type="checkbox"/> There are unresolved deficiencies with the metering system. These are described in the Preliminary Commissioning Report submitted to the Owner. The following items are not in compliance with energy code: _____

Supporting Documents (Section C403.6)	<input checked="" type="checkbox"/> Manuals, record documents and training have been completed or are scheduled 1. System documentation has been provided to the owner or scheduled date: _____ 2. Record documents have been submitted to owner or scheduled date: _____ 3. Training has been completed or scheduled date: _____
---	--

Preliminary Commissioning Report (Section C408.1.4.1)	<input checked="" type="checkbox"/> Preliminary Commissioning Report submitted to Owner and includes items below– <ul style="list-style-type: none"> <input checked="" type="checkbox"/> Itemization of deficiencies found during testing that are part of the energy code and that have not been corrected at the time of report preparation. <input checked="" type="checkbox"/> Deferred tests that cannot be performed at the time of report preparation with anticipated date of completion. <input checked="" type="checkbox"/> Status of the project's record documents, manuals, and systems operation training with respect to requirements in Section 403.6.
---	--

Certification	<input checked="" type="checkbox"/> I hereby certify that all requirements for Commissioning have been completed in accordance with the Washington State Energy Code, including all items above. <div style="display: flex; justify-content: space-between; border-top: 1px solid black; margin-top: 10px;"> Building Owner or Owner's Representative _____ Date _____ </div>
----------------------	--

Project Information	Project Name:	
	Project Address:	
	Certified Commissioning Professional:	
	Type of ISO Certification and Number:	
Supporting Documents	<input type="checkbox"/> Manuals, record documents and training have been completed or are scheduled (Section C103.6) <ul style="list-style-type: none"> • Building operations and maintenance information (C103.6.2) have been submitted to the owner or scheduled date: _____ • Manuals (C103.6.2.1) have been submitted to the owner or scheduled date: _____ • Compliance documentation (C103.6.3) has been provided to the owner or scheduled date: _____ • System operation training (C103.6.4) has been provided to the owner or scheduled date: _____ 	
Commissioning Plan	<input type="checkbox"/> Commissioning Plan was used during construction (Section C408.1.2)	
Commissioning Report	<input type="checkbox"/> The Commissioning Report has been submitted (Section C408.1.3)	
Commissioned Systems	<input type="checkbox"/> Mechanical Systems were included in the commissioning process (Section C408.2) <input type="checkbox"/> Testing, adjusting and balancing is complete (Section C408.2.2) <input type="checkbox"/> There are unresolved deficiencies with the mechanical systems. These are described in the attached Commissioning Report submitted to the Owner.	
	<input type="checkbox"/> Service Water Heating Systems were included in the commissioning process (Section C408.3) <input type="checkbox"/> There are unresolved deficiencies with the service water heating systems. These are described in the attached Commissioning Report submitted to the Owner.	
	<input type="checkbox"/> Controlled receptacles and lighting control systems were included in the commissioning process (Section C408.4) <input type="checkbox"/> There are unresolved deficiencies with the electrical power and/or automatic lighting controls. These are described in the attached Commissioning Report submitted to the Owner.	
	<input type="checkbox"/> Additional systems were included in the commissioning process (Section C408.5) <input type="checkbox"/> There are unresolved deficiencies with systems required by C406 or C407. These are described in the attached Commissioning Report submitted to the Owner.	
	<input type="checkbox"/> Metering systems were included in the commissioning process (Section C408.6) <input type="checkbox"/> There are unresolved deficiencies with the metering system. These are described in the attached Commissioning Report submitted to the Owner.	
	<input type="checkbox"/> Refrigeration systems were included in the commissioning process (Section C408.7) <input type="checkbox"/> There are unresolved deficiencies with systems required by Section C410. These are described in the attached Commissioning Report submitted to the Owner.	
	<input type="checkbox"/> I hereby certify that requirements for Section C408 System Commissioning have been completed in accordance with the Washington State Energy Code, including all items above. <div style="display: flex; justify-content: space-between;"> <div>_____</div> <div>_____</div> </div> <div style="display: flex; justify-content: space-between;"> <div>Certified Commissioning Professional</div> <div>Date</div> </div>	
	<input type="checkbox"/> I hereby certify that requirements for Section C408 System Commissioning have been completed in accordance with the Washington State Energy Code, including all items above. <div style="display: flex; justify-content: space-between;"> <div>_____</div> <div>_____</div> </div> <div style="display: flex; justify-content: space-between;"> <div>Building Owner or Owner's Representative</div> <div>Date</div> </div>	

Commented [BK(325)]
C149-2018

C408.1.4.3 Copy of report. The *code official* shall be permitted to require that a copy of the Preliminary Commissioning Report be made available for review by the *code official*.

C408.2 Mechanical systems commissioning. Mechanical equipment and controls subject to Section C403 shall be included in the commissioning process required by Section C408.1. The commissioning process shall minimally include all energy code requirements for which the code states that equipment or controls shall "be capable of" or "configured to" perform specific functions.

Exception: Mechanical systems are exempt from the commissioning process where the ~~building's installed total~~ mechanical equipment capacity is less than 240,000 Btu/h cooling capacity and less than 300,000 Btu/h heating capacity.

Commented [BK(326)]
C150-2018

C408.2.1 Reserved.

C408.2.2 Systems adjusting and balancing. HVAC systems shall be balanced in accordance with generally accepted engineering standards. Air and water flow rates shall be measured and adjusted to deliver final flow rates within the tolerances provided in the project specifications. Test and balance activities shall include air system and hydronic system balancing.

C408.2.2.1 Air systems balancing. Each supply air outlet and *zone* terminal device shall be equipped with means for air balancing in accordance with the requirements of Chapter 6 of the *International Mechanical Code*. Discharge dampers used for air system balancing are prohibited on constant volume fans and variable volume fans with motors 10 hp (18.6 kW) and larger. Air systems shall be balanced in a manner to first minimize throttling losses then, for fans with system power of greater than 1 hp (0.74 kW), fan speed shall be adjusted to meet design flow conditions.

Exception: Fans with fan motors of 1 hp (0.74 kW) or less.

C408.2.2.2 Hydronic systems balancing. Individual hydronic heating and cooling coils shall be equipped with means for balancing and measuring flow. Hydronic systems shall be proportionately balanced in a manner to first minimize throttling losses, then the pump impeller shall be trimmed or pump speed shall be adjusted to meet design flow conditions. Each hydronic system shall have either the capability to measure pressure across the pump, or test ports at each side of each pump.

Exception: The following equipment is not required to be equipped with means for balancing or measuring flow:

1. Pumps with pump motors of 5 hp (3.7 kW) or less.
2. Where throttling results in no greater than five percent of the nameplate horsepower draw above that required if the impeller were trimmed.

~~C408.2.3 Functional performance testing. Functional performance testing specified in Sections C408.2.3.1 through C408.2.3.3 shall be conducted. Written procedures which clearly describe the individual systematic test procedures, the expected systems' response or acceptance criteria for each procedure, the actual response or findings, and any pertinent discussion shall be followed. Testing shall affirm operation during actual or simulated winter and summer design conditions and during full outside air conditions.~~

Commented [BK(327)]
C148-2018

~~C408.2.3.1 EquipmentSystem testing. Equipment~~ Functional performance testing shall demonstrate the ~~installation and operation of~~ components, systems, and system-to-system interfacing relationships ~~are installed and operate in~~ accordance with approved ~~plans and specifications such that operation, function, and maintenance serviceability for each of the commissioned systems is confirmed~~ construction documents. Testing shall include ~~all modes and the sequence of operation, including and be conducted~~ under full-load, part-load and the following ~~emergency~~ conditions:

Commented [BK(328)]
C148-2018

1. All modes as described in the *sequence of operation*;
2. Redundant or *automatic* back-up mode;
3. Performance of alarms; and
4. Mode of operation upon a loss of power and restoration of power.

~~C408.2.3.2 Controls. HVAC control systems shall be tested to document that control devices, components, equipment, and systems are calibrated and adjusted and operate in accordance with approved plans and specifications. Sequences of operation shall be functionally tested to document they operate in accordance with approved plans and specifications.~~

~~C408.2.3.3 Economizers. Air economizers shall undergo a functional test to determine that they operate in accordance with manufacturer's specifications.~~

Commented [BK(329)]
C148-2018

~~C408.4~~**C408.3 Service water heating systems commissioning.** Service water heating equipment and controls subject to Section C404 shall be included in the commissioning process required by Section C408.1. The commissioning process shall minimally include equipment and components installed to meet all energy code requirements for devices to "start," "automatically turn off," "automatically adjust," "limit operation," and "limit the temperature" and "be configured to." all

energy code requirements for which the code states that equipment or controls shall "be capable of" or "configured to" perform specific functions.

Exception: Service water heating systems are exempt from the commissioning process in buildings where the largest service water heating system capacity is less than 200,000 Btu/h (58,562 W) and where there are no pools or permanent spas.

C408.4.1 Functional performance testing. Functional performance testing specified in Sections C408.4.1.1 through C408.4.1.3 shall be conducted. Written procedures which clearly describe the individual systematic test procedures, the expected systems' response or acceptance criteria for each procedure, the actual response or findings, and any pertinent discussion shall be followed. Testing shall affirm operation with the system under 50 percent water heating load.

C408.4.1.1 C408.3.1 Equipment System testing. Equipment Functional performance testing shall demonstrate the installation and operation of components, systems that heaters, piping, distribution systems, and system-to-system interfacing relationships are installed and operate in accordance with approved plans and specifications such that operation, function, and maintenance serviceability for each of the commissioned systems is confirmed construction documents. Testing shall include all modes and the sequence of operation, including under full load, part load and be conducted under at least 50 percent water heating load, part-load and the following emergency conditions:

1. Normal operation;
2. Redundant or automatic back-up mode;
3. Performance of alarms; and
4. Mode of operation upon a loss of power and restoration of power.

C408.4.1.2 Controls. Service water heating controls shall be tested to document that control devices, components, equipment, and systems are calibrated, adjusted and operate in accordance with approved plans and specifications. Sequences of operation shall be functionally tested to document they operate in accordance with approved plans and specifications.

C408.4.1.3 Pools and spas. Service water heating equipment, time switches, and heat recovery equipment which serve pools and permanent spas shall undergo a functional test to determine that they operate in accordance with manufacturer's specifications.

C408.3 C408.4 Electrical power-Controlled receptacle and lighting systems-control system commissioning. Electrical power-Controlled receptacles and lighting systems-control systems subject to Section C405 shall be included in the commissioning process required by Section C408.1. The commissioning process shall minimally include all energy code requirements for which the code requires specific daylight responsive controls, "control functions," and where the code states that equipment shall be "configured to" perform specific functions. The configuration and function of controlled receptacles and lighting control systems required by this code shall be tested and shall comply with Section C408.3.1.

Exception: Lighting control systems are exempt from the commissioning process in buildings where:

1. The total installed lighting load is less than 20 kW, and
2. Where the lighting load controlled by occupancy sensors or automatic daylighting controls is less than 10 kW.

C408.3.1 C408.4.1 Functional System testing. Functional performance testing shall demonstrate that occupant sensors, time switches, manual overrides, night sweep-off, daylight responsive control, and controlled receptacles are installed and operate in accordance with approved construction documents. Prior to passing final inspection, the certified commissioning professional shall provide evidence that the lighting control systems have been tested to ensure that control hardware and software are calibrated, adjusted, programmed and in proper working condition in accordance with the construction documents and manufacturer's instructions. Written procedures which clearly describe the individual systematic test procedures, the expected systems' response or acceptance criteria for each procedure, the actual response or findings, and any pertinent discussion shall be followed. Functional testing shall comply with Section C408.3.1.1 through C408.3.1.3 for the applicable control type. Testing shall include the sequence of operation and be conducted under the following conditions:

1. Normal operation;
2. Redundant or automatic back-up mode;
3. Performance of alarms; and
4. Mode of operation upon a loss of power and restoration of power.

C408.3.1.1 Occupant sensor controls. Where occupancy sensors are provided, the following procedures shall be performed:

1. Certify that the occupant sensor has been located and aimed in accordance with manufacturer recommendations.

Commented [BK(330)]
C148-2018

Commented [BK(331)]
C150-2018

Commented [BK(332)]
C148-2018

2. ~~For projects with seven or fewer occupant sensors, each sensor shall be tested. For projects with more than seven occupant sensors, testing shall be done for each unique combination of sensor type and space geometry. Where multiples of each unique combination of sensor type and space geometry are provided, no fewer than the greater of one or 10 percent of each combination shall be tested unless the code official or design professional requires a higher percentage to be tested. Where 30 percent or more of the tested controls fail, all remaining identical combinations shall be tested.~~
3. ~~For each occupant sensor to be tested, verify the following:~~
 - a. ~~Where occupant sensors include status indicators, verify correct operation.~~
 - b. ~~The controlled lights turn off or down to the permitted level within the required time.~~
 - c. ~~For auto-on occupant sensors, the lights turn on to the permitted level within the required time.~~
 - d. ~~For manual-on occupant sensors, the lights turn on only when manually activated.~~
 - e. ~~The lights are not incorrectly turned on by movement in adjacent areas or by HVAC operation.~~

Commented [BK(333)]
C148-2018

C408.3.1.2 Time switch controls. ~~Where automatic time switches are provided, the following procedures shall be performed:~~

1. ~~Confirm that the automatic time switch control is programmed with accurate weekday, weekend and holiday schedules, and set up and preference program settings.~~
2. ~~Provide documentation to the owner of automatic time switch programming, including weekday, weekend, holiday schedules and set up and preference program settings.~~
3. ~~Verify the correct time and date in the time switch.~~
4. ~~Verify that any battery backup is installed and energized.~~
5. ~~Verify that the override time limit is set to not more than two hours.~~
6. ~~Simulate occupied conditions. Verify and document the following:~~
 - a. ~~All lights can be turned on and off by their respective area control switch.~~
 - b. ~~The switch only operates lighting in the enclosed space in which the switch is located.~~
7. ~~Simulate unoccupied condition. Verify the following:~~
 - a. ~~All nonexempt lighting turns off.~~
 - b. ~~Manual override switch allows only the lights in the enclosed space where the override switch is located to turn on or remain on until the next scheduled shut off occurs.~~
8. ~~Additional testing as specified by the certified commissioning professional.~~

Commented [BK(334)]
C148-2018

C408.3.1.3 Daylight responsive controls. ~~Where daylight responsive controls are provided, the following procedures shall be performed:~~

1. ~~All control devices have been properly located, field calibrated and set for accurate setpoints and threshold light levels.~~
2. ~~Daylight controlled lighting loads adjusted to light level setpoints in response to available daylight.~~
3. ~~The locations of calibration adjustment equipment are readily accessible only to authorized personnel.~~

C408.3.2 Documentation requirements. ~~The construction documents shall specify that documents certifying that the installed lighting controls meet documented performance criteria of Section C405 be provided to the building owner within 90 days from the date of receipt of the certificate of occupancy.~~

Commented [BK(335)]
C148-2018

C408.4 Service water heating systems commissioning. ~~Service water heating equipment and controls subject to Section C404 shall be included in the commissioning process required by Section C408.1. The commissioning process shall minimally include all energy code requirements for which the code states that equipment or controls shall "be capable of" or "configured to" perform specific functions.~~

Commented [BK(336)]
C148 - moved to
C408.3

Exception: ~~Service water heating systems are exempt from the commissioning process in buildings where the largest service water heating system capacity is less than 200,000 Btu/h (58,562 W) and where there are no pools or permanent spas.~~

C408.4.1 Functional performance testing. ~~Functional performance testing specified in Sections C408.4.1.1 through C408.4.1.3 shall be conducted. Written procedures which clearly describe the individual systematic test procedures, the expected systems' response or acceptance criteria for each procedure, the actual response or findings, and any pertinent discussion shall be followed. Testing shall affirm operation with the system under 50 percent water heating load.~~

C408.4.1.1 Equipment. ~~Equipment functional performance testing shall demonstrate the installation and operation of components, systems, and system to system interfacing relationships in accordance with approved plans and~~

~~specifications such that operation, function, and maintenance serviceability for each of the commissioned systems is confirmed. Testing shall include all modes and sequence of operation, including under full load, part load and the following emergency conditions:~~

- ~~1. Redundant or automatic back-up mode;~~
- ~~2. Performance of alarms; and~~
- ~~3. Mode of operation upon a loss of power and restoration of power.~~

~~**C408.4.1.2 Controls.** Service water heating controls shall be tested to document that control devices, components, equipment, and systems are calibrated, adjusted and operate in accordance with approved plans and specifications. Sequences of operation shall be functionally tested to document they operate in accordance with approved plans and specifications.~~

~~**C408.4.1.3 Pools and spas.** Service water heating equipment, time switches, and heat recovery equipment which serve pools and permanent spas shall undergo a functional test to determine that they operate in accordance with manufacturer's specifications.~~

C408.5 Systems installed to meet Section C406 or C407. Equipment, components, controls or configuration settings for ~~mechanical, service water heating, electrical power or lighting systems~~ which are included in the project to comply with Section C406 or C407 shall be included in the commissioning process required by Section C408.1.

Commented [BK(337)]
C148-2018

C408.5.1 System testing. Functional performance testing for these appliances, equipment, components, controls and/or configuration settings shall demonstrate operation, function and maintenance serviceability for each of the commissioned systems in accordance with the approved construction documents.

Commented [BK(338)]
C148-2018

C408.6 Metering system commissioning. Energy metering systems required by Section C409 shall comply with Section C408.6 and be included in the commissioning process required by Section C408.1. The commissioning process shall include all energy metering equipment and controls required by Section C409.

C408.6.1 Functional performance System testing. Functional performance testing shall demonstrate that energy source meters, end-use meters, data acquisition systems, and energy displays are installed and operate in accordance with approved construction documents. ~~be conducted by following written procedures which clearly describe the individual systematic test procedures, the expected systems' response or acceptance criteria for each procedure, the actual response or findings, and any pertinent discussion. Functional testing shall document that energy source meters, energy end-use meters, the energy metering data acquisition system, and required energy consumption display are calibrated, adjusted and operate in accordance with approved plans and specifications.~~ At a minimum, testing shall confirm that:

Commented [BK(339)]
C148-2018

1. The metering system devices and components work properly under low and high load conditions.
2. The metered data is delivered in a format that is compatible with the data collection system.
3. The energy display is ~~accessible in a location with access~~ to building operation and management personnel.
4. The energy display meets code requirements regarding views required in Section C409.4.3. The display shows energy data in identical units (e.g., kWh).

C408.7 Refrigeration system commissioning. All installed refrigeration systems subject to Section C410 shall be included in the commissioning process required by Section C408.1.

Exceptions:

1. Self-contained refrigeration systems are exempt from the commissioning process.
2. Total installed capacity for refrigeration is equal to or less than 240 kBtu/h.

C408.7.1 System Testing. Functional performance testing shall demonstrate that compressors, heat exchangers, piping, distribution systems, and system-to-system interfacing relationships are installed and operate in accordance with approved construction documents. Testing shall include the *sequence of operation* and be conducted under full-load-at, part-load and the following conditions:

1. Normal mode;
2. Redundant or automatic back-up mode;
3. Performance of alarms; and
4. Mode of operation upon a loss of power and restoration of power.

Commented [BK(340)]
C150-2018

SECTION C409 ENERGY METERING AND ENERGY CONSUMPTION MANAGEMENT

C409.1 General. All new buildings and additions, regardless of size, shall have the capability of and configured to meter on-site renewable energy production in accordance with Section C409.2.4 and the end-use energy usage for electric vehicle charging in accordance with Section C409.3.3. New buildings and additions with a gross conditioned floor area over 50,000 square feet shall comply with Section C409. Buildings shall be equipped to measure, monitor, record and display energy consumption data for each energy source and end use category per the provisions of this section, to enable effective energy management.

Commented [BK(341)]
157-2018

Exceptions:

1. Tenant spaces smaller than 50,000 ft² within buildings if the tenant space has its own utility service and utility meters.
2. Buildings in which there is no gross conditioned floor area over 25,000 square feet, including building common area, that is served by its own utility services and meters.

C409.1.1 Alternate metering methods. Where approved by the building official, energy use metering systems may differ from those required by this section, provided that they are permanently installed and that the source energy measurement, end use category energy measurement, data storage and data display have similar accuracy to and are at least as effective in communicating actionable energy use information to the building management and users, as those required by this section.

C409.1.2 Conversion factor. Any threshold stated in kW shall include the equivalent BTU/h heating and cooling capacity of installed equipment at a conversion factor of 3,412 Btu per kW at 50 percent demand.

C409.1.3 Dwelling units. See Sections C404.9 and C405.7 for additional metering requirements for Group R-2 dwelling units.

Commented [BK(342)]
154-2018

C409.2 Energy source metering. Buildings shall have a meter at each energy source. For each energy supply source listed in Section C409.2.1 through C409.2.4, meters shall collect data for the whole building or for each separately metered portion of the building where not exempted by the exception to Section C409.1.

Exceptions:

1. Energy source metering is not required where end use metering for an energy source accounts for all usage of that energy type within a building, and the data acquisition system accurately totals the energy delivered to the building or separately metered portion of the building.
2. Solid fuels such as coal, firewood or wood pellets that are delivered via mobile transportation do not require metering.

C409.2.1 Electrical energy. This category shall include all electrical energy supplied to the building and its associated site, including site lighting, parking, recreational facilities, and other areas that serve the building and its occupants.

C409.2.2 Gas and liquid fuel supply energy. This category shall include all natural gas, fuel oil, propane and other gas or liquid fuel energy supplied to the building and site.

C409.2.3 District energy. This category shall include all net energy extracted from district steam systems, district chilled water loops, district hot water systems, or other energy sources serving multiple buildings.

C409.2.4 Site-generated renewable energy. This category shall include all net energy generated from on-site solar, wind, geothermal, tidal or other natural sources. For buildings exempt from data collection systems, the data from these meters is permitted to either be stored locally using a manual totalizing meter or other means at the meter or fed into a central data collection system.

Commented [BK(343)]
157-2018

C409.3 End-use metering. Meters shall be provided to collect energy use data for each end-use category listed in Sections C409.3.1 through ~~C409.3.2~~C409.3.3. These meters shall collect data for the whole building or for each separately metered portion of the building where not exempted by the exception to Section C409.1. Not more than 10 percent of the total connected load of any of the end-use metering categories in Sections C409.3.1 through C409.3.5 is permitted to be excluded from that end-use data collection. Not more than 10 percent of the total connected load of any of the end-use metering categories in Sections C409.3.1 through C409.3.5 is permitted to consist of loads not part of that category. Multiple meters may be used for any end-use category, provided that the data acquisition system totals all of the energy used by that category.

Commented [BK(344)]
156-2018

Exceptions:

1. HVAC and service water heating equipment serving only an individual dwelling unit or sleeping unit does not require end-use metering.
2. Separate metering is not required for fire pumps, stairwell pressurization fans or other life safety systems that

operate only during testing or emergency.

3. End use metering is not required for individual tenant spaces not exceeding 2,500 square feet in floor area when a dedicated source meter meeting the requirements of Section C409.4.1 is provided for the tenant space.

C409.3.1 HVAC system energy use. This category shall include all energy including electrical, gas, liquid fuel, district steam and district chilled water that is used by boilers, chillers, pumps, fans and other equipment used to provide space heating, space cooling, dehumidification and ventilation to the building, but not including energy that serves process loads, water heating or miscellaneous loads as defined in Section C409.3. Multiple HVAC energy sources, such as gas, electric and steam, are not required to be summed together.

Exceptions:

1. All 120 volt equipment.
2. 208/120 volt equipment in a building where the main service is 480/277 volt power.
3. Electrical energy fed through variable frequency drives that are connected to the energy metering data acquisition center.

C409.3.2 Service water heating energy use. This category shall include all energy used for heating of domestic and service hot water, but not energy used for space heating.

Exception: Service water heating energy use less than 50 kW does not require end-use metering.

C409.3.3 Electric vehicle charging energy use. This category shall include all energy used for electrical vehicle charging. For buildings exempt from data collection systems, the data from these meters is permitted to either be stored locally using a manual totalizing meter or other means at the meter or fed into a central data collection system.

Commented [BK(345)]
157-2018

C409.4 Measurement devices, data acquisition system and energy display.

C409.4.1 Meters. Meters and other measurement devices required by this section shall have local displays or be configured to automatically communicate energy data to a data acquisition system. Source meters may be any digital-type meters. Current sensors or flow meters are allowed for end use metering, provided that they have an accuracy of $\pm 5\%$. All required metering systems and equipment shall provide at least hourly data that is fully integrated into the data acquisition and display system per the requirements of Section C409.

C409.4.2 Data acquisition system. The data acquisition system shall store the data from the required meters and other sensing devices for a minimum of 36 months. For each energy supply and end use category required by C409.2 and C409.3, it shall provide real-time energy consumption data and logged data for any hour, day, month or year.

C409.4.3 Energy display. For each building subject to Section C409.2 and C409.3, either a readily accessible and visible display in a location with ready access, or a web page or other electronic document accessible available to building management or to a third-party energy data analysis service for access shall be provided in the building accessible available for access by building operation and management personnel. The display shall graphically provide the current energy consumption rate for each whole building energy source, plus each end use category, as well as the average total and peak values for any day, week, month and/or year.

Commented [BK(346)]
156-2018

C409.4.4 Commissioning. The entire system shall be commissioned in accordance with Section C408. Deficiencies found during testing shall be corrected and retested and the commissioning report shall be updated to confirm that the entire metering and data acquisition and display system is fully functional. Energy metering and energy consumption management systems shall be commissioned in accordance with Section C408.

Commented [BK(347)]
C147-2018

C409.5 Metering for existing buildings.

C409.5.1 Existing buildings that were constructed subject to the requirements of this section. Where new or replacement systems or equipment are installed in an existing building that was constructed subject to the requirements of this section, metering shall be provided for such new or replacement systems or equipment so that their energy use is included in the corresponding end-use category defined in Section C409.2.3. This includes systems or equipment added in conjunction with additions or alterations to existing buildings.

C409.5.1.1 Small existing buildings. Metering and data acquisition systems shall be provided for additions over 25,000 square feet to buildings that were constructed subject to the requirements of this section, in accordance with the requirements of Sections C409.2 and C409.3.

SECTION C410 REFRIGERATION SYSTEM REQUIREMENTS

C410.1 General (prescriptive). Walk-in coolers, walk-in freezers, refrigerated warehouse coolers, refrigerated warehouse

freezers, and refrigerated display cases shall comply with this Section.

Refrigerated warehouse coolers and refrigerated warehouse freezers shall comply with Section C402. Section C402.1.5, Component performance alternative, may be used if granted prior approval by the jurisdiction

C410.1.1 Refrigeration equipment performance. Refrigeration equipment shall have an energy use in kWh/day not greater than the values of Tables C410.21.1(1) and C410.21.1(2) when tested and rated in accordance with AHRI Standard 1200. The energy use shall be verified through certification under an approved certification program or, where a certification program does not exist, the energy use shall be supported by data furnished by the equipment manufacturer.

TABLE C410.1.1(1)
MINIMUM EFFICIENCY REQUIREMENTS: COMMERCIAL REFRIGERATION

EQUIPMENT TYPE	APPLICATION	ENERGY USE LIMITS (kWh per day) ^a	TEST PROCEDURE
Refrigerator with solid doors	Holding Temperature	$0.10 \times V + 2.04$	AHRI 1200
Refrigerator with transparent doors		$0.12 \times V + 3.34$	
Freezers with solid doors		$0.40 \times V + 1.38$	
Freezers with transparent doors		$0.75 \times V + 4.10$	
Refrigerator/freezers with solid doors		The greater of $0.12 \times V + 3.34$ or 0.70	
Commercial refrigerators	Pulldown	$0.126 \times V + 3.51$	

^a V = Volume of the chiller for frozen compartment as defined in AHAM-HRF-1.

TABLE C410.1.1(2)
MINIMUM EFFICIENCY REQUIREMENTS: COMMERCIAL REFRIGERATORS AND FREEZERS

Equipment Class ^c	EQUIPMENT TYPE			ENERGY USE LIMITS (kWh per day) ^{a,b}	TEST PROCEDURE
	Family Code	Operating Mode	Rating Temperature		
VOP.RC.M	Vertical open	Remote condensing	Medium	$0.82 \times TDA + 4.07$	AHRI 1200
SVO.RC.M	Semivertical open	Remote condensing	Medium	$0.83 \times TDA + 3.18$	
HZO.RC.M	Horizontal open	Remote condensing	Medium	$0.35 \times TDA + 2.88$	
VOP.RC.L	Vertical open	Remote condensing	Low	$2.27 \times TDA + 6.85$	
HZO.RC.L	Horizontal open	Remote condensing	Low	$0.57 \times TDA + 6.88$	
VCT.RC.M	Vertical transparent door	Remote condensing	Medium	$0.22 \times TDA + 1.95$	
VCT.RC.L	Vertical transparent door	Remote condensing	Low	$0.56 \times TDA + 2.61$	
SOC.RC.M	Service over counter	Remote condensing	Medium	$0.51 \times TDA + 0.11$	
VOP.SC.M	Vertical open	Self-contained	Medium	$1.74 \times TDA + 4.71$	
SVO.SC.M	Semivertical open	Self-contained	Medium	$1.73 \times TDA + 4.59$	
HZO.SC.M	Horizontal open	Self-contained	Medium	$0.77 \times TDA + 5.55$	
HZO.SC.L	Horizontal open	Self-contained	Low	$1.92 \times TDA + 7.08$	

Equipment Class ^c	EQUIPMENT TYPE			ENERGY USE LIMITS (kWh per day) ^{a,b}	TEST PROCEDURE
	Family Code	Operating Mode	Rating Temperature		
VCT.SC.I	Vertical transparent door	Self-contained	Ice cream	0.67 x TDA + 3.29	AHRI 1200
VCS.SC.I	Vertical solid door	Self-contained	Ice cream	0.38 x V + 0.88	
HCT.SC.I	Horizontal transparent door	Self-contained	Ice cream	0.56 x TDA + 0.43	
SVO.RC.L	Semivertical open	Remote condensing	Low	2.27 x TDA + 6.85	
VOP.RC.I	Vertical open	Remote condensing	Ice cream	2.89 x TDA + 8.7	
SVO.RC.I	Semivertical open	Remote condensing	Ice cream	2.89 x TDA + 8.7	
HZO.RC.I	Horizontal open	Remote condensing	Ice cream	0.72 x TDA + 8.74	
VCT.RC.I	Vertical transparent door	Remote condensing	Ice cream	0.66 x TDA + 3.05	
HCT.RC.M	Horizontal transparent door	Remote condensing	Medium	0.16 x TDA + 0.13	
HCT.RC.L	Horizontal transparent door	Remote condensing	Low	0.34 x TDA + 0.26	
HCT.RC.I	Horizontal transparent door	Remote condensing	Ice cream	0.4 x TDA + 0.31	
VCS.RC.M	Vertical solid door	Remote condensing	Medium	0.11 x V + 0.26	
VCS.RC.L	Vertical solid door	Remote condensing	Low	0.23 x V + 0.54	
VCS.RC.I	Vertical solid door	Remote condensing	Ice cream	0.27 x V + 0.63	
HCS.RC.M	Horizontal solid door	Remote condensing	Medium	0.11 x V + 0.26	
HCS.RC.L	Horizontal solid door	Remote condensing	Low	0.23 x V + 0.54	
HCS.RC.I	Horizontal solid door	Remote condensing	Ice cream	0.27 x V + 0.63	
SOC.RC.L	Service over counter	Remote condensing	Low	1.08 x TDA + 0.22	
SOC.RC.I	Service over counter	Remote condensing	Ice cream	1.26 x TDA + 0.26	
VOP.SC.L	Vertical open	Self-contained	Low	4.37 x TDA + 11.82	AHRI 1200
VOP.SC.I	Vertical open	Self-contained	Ice cream	5.55 x TDA + 15.02	
SVO.SC.L	Semivertical open	Self-contained	Low	4.34 x TDA + 11.51	
SVO.SC.I	Semivertical open	Self-contained	Ice cream	5.52 x TDA + 14.63	
HZO.SC.I	Horizontal open	Self-contained	Ice cream	2.44 x TDA + 9.0	
SOC.SC.I	Service over counter	Self-contained	Ice cream	1.76 x TDA + 0.36	
HCS.SC.I	Horizontal solid door	Self-contained	Ice cream	0.38 x V + 0.88	

- a V = Volume of the case, as measured in accordance with Appendix C of AHRI 1200.
- b TDA = Total display area of the case, as measured in accordance with Appendix D of AHRI 1200.
- c Equipment class designations consist of a combination [(in sequential order separated by periods (AAA).(BB).(C))]] of:
 - (AAA) An equipment family code where:
 - VOP = Vertical open
 - SVO = Semi-vertical open
 - HZO = Horizontal open
 - VCT = Vertical transparent doors
 - VCS = Vertical solid doors
 - HCT = Horizontal transparent doors
 - HCS = Horizontal solid doors
 - SOC = Service over counter
 - (BB) An operating mode code:
 - RC = Remote condensing
 - SC = Self-contained
 - (C) A rating temperature code:
 - M = Medium temperature (38°F)
 - L = Low temperature (0°F)
 - I = Ice cream temperature (15°F)

For example, "VOP.RC.M" refers to the "vertical-open, remote-condensing, medium-temperature" equipment class.

C410.2 Walk-in coolers, walk-in freezers, refrigerated warehouse coolers and refrigerated warehouse freezers.

Refrigerated warehouse coolers, refrigerated warehouse freezers, and all walk-in coolers and walk-in freezers including site assembled, site constructed and prefabricated units shall comply with the following:

1. Automatic door-closers shall be provided that fully close walk-in doors that have been closed to within 1 inch (25 mm) of full closure.

Exception: Automatic closers are not required for doors more than 45 inches (1143 mm) in width or more than 7 feet (2134 mm) in height.
2. Doorways shall be provided with strip doors, curtains, spring-hinged doors or other method of minimizing infiltration when doors are open.
3. *Walk-in coolers* and *refrigerated warehouse coolers* shall be provided with wall, ceiling, and door insulation of not less than R-25 or have wall, ceiling and door assembly *U*-factors no greater than *U*-0.039. *Walk-in freezers* and *refrigerated warehouse freezers* shall be provided with wall, ceiling and door insulation of not less than R-32 or have wall, ceiling and door assembly *U*-factors no greater than *U*-0.030.

Exception: Insulation is not required for glazed portions of doors or at structural members associated with the walls, ceiling or door frame.
4. The floor of walk-in coolers shall be provided with floor insulation of not less than R-25 or have a floor assembly U-factor no greater than U-0.040. The floor of *walk-in freezers* shall be provided with floor insulation of not less than R-28 or have a floor assembly *U*-factor no greater than *U*-0.035.

Exception: Insulation is not required in the floor of a walk-in-cooler that is mounted directly on a slab on grade.
5. Transparent fixed windows and reach-in doors for *walk-in freezers* and windows in *walk-in freezer* doors shall be provided with triple-pane glass, with the interstitial spaces filled with inert gas, or be provided with heat-reflective treated glass.
6. Transparent fixed windows and reach-in doors for *walk-in coolers* and windows for *walk-in cooler* doors shall be provided with double-pane or triple-pane glass, with interstitial spaces filled with inert gas, or be provided with heat-reflective treated glass.
7. Evaporator fan motors that are less than 1 hp (0.746 kW) and less than 460 volts shall be provided with electronically commutated motors, brushless direct-current motors, or 3-phase motors.
8. Condenser fan motors that are less than 1 hp (0.746 kW) shall use electronically commutated motors, permanent split capacitor-type motors or 3-phase motors.
9. Antisweat heaters that are not provided with antisweat heater controls shall have a total door rail, glass and frame heater power draw of not greater than 7.1 W/ft² (76 W/m²) of door opening for *walk-in freezers* and not greater than 3.0 W/ft² (32 W/m²) of door opening for *walk-in coolers*.
10. Where antisweat heater controls are provided, they shall be capable of reducing the energy use of the antisweat heater as a function of the relative humidity in the air outside the door or to the condensation on the inner glass pane.
11. Lights in *walk-in coolers*, *walk-in freezers*, *refrigerated warehouse coolers* and *refrigerated warehouse freezers* shall either be provided with light sources with an efficacy of not less than 40 lumens per watt, including ballast losses, or shall be provided with a device that turns off the lights within 15 minutes of when the *walk-in cooler* or *walk-in freezer* space is not occupied.

Commented [BK(348)]
158-2018

Commented [BK(349)]
158-2018

Commented [BK(350)]
158-2018

Commented [BK(351)]
158-2018

C410.2.1 Performance standards. Site-assembled and site-constructed walk-in coolers and walk-in freezers shall meet the requirements of Tables C410.2.1.1(1), C410.2.1.1(2) and C410.2.1.1(3).

TABLE C410.2.1.1(1)
WALK-IN COOLER AND FREEZER DISPLAY DOORS EFFICIENCY REQUIREMENTS

<u>Class Description</u>	<u>Class</u>	<u>Maximum Energy Consumption (kWh/day)^a</u>
<u>Display Door, Medium Temperature</u>	<u>DD, M</u>	<u>$0.04 \times A_{dd} + 0.41$</u>
<u>Display Door, Low Temperature</u>	<u>DD, L</u>	<u>$0.15 \times A_{dd} + 0.29$</u>

a. A_{dd} is the surface area of the display door

TABLE C410.2.1.1(2)
WALK-IN COOLER AND FREEZER NON-DISPLAY DOORS EFFICIENCY REQUIREMENTS

<u>Class Description</u>	<u>Class</u>	<u>Maximum Energy Consumption (kWh/day)^a</u>
<u>Passage Door, Medium Temperature</u>	<u>PD, M</u>	<u>$0.05 \times A_{nd} + 1.7$</u>
<u>Passage Door, Low Temperature</u>	<u>PD, L</u>	<u>$0.14 \times A_{nd} + 4.8$</u>
<u>Freight Door, Medium Temperature</u>	<u>FD, M</u>	<u>$0.04 \times A_{nd} + 1.9$</u>
<u>Freight Door, Low Temperature</u>	<u>FD, L</u>	<u>$0.12 \times A_{nd} + 5.6$</u>

a. A_{nd} is the surface area of the display door

TABLE C410.2.1.1(3)
WALK-IN COOLER AND FREEZER REFRIGERATION SYSTEMS EFFICIENCY REQUIREMENTS

<u>Class Description</u>	<u>Class</u>	<u>Minimum Annual Walk-in Energy Factor AWEF (Btu/hW-h)</u>
<u>Dedicated Condensing, Medium Temperature, Indoor System</u>	<u>DC.M.I</u>	<u>5.61</u>
<u>Dedicated Condensing, Medium Temperature, Indoor System, >9,000 Btu/h Capacity</u>	<u>DC.M.I, >9,000</u>	<u>5.61</u>
<u>Dedicated Condensing, Medium Temperature, Outdoor System</u>	<u>DC.MI</u>	<u>7.60</u>
<u>Dedicated Condensing, Medium Temperature, Outdoor System, >9,000 Btu/h Capacity</u>	<u>DC.M.I, >9,000</u>	<u>7.60</u>

C410.2.2 Refrigerated display cases. Site-assembled or site-constructed refrigerated display cases shall comply with the following:

- Lighting and glass doors in refrigerated display cases shall be controlled by one of the following:
 - ~~4.1.1.~~ Time switch controls to turn off lights during nonbusiness hours. Timed overrides for display cases shall turn the lights on for up to 1 hour and shall automatically time out to turn the lights off.
 - ~~4.2.1.2.~~ Motion sensor controls on each display case section that reduce lighting power by at least 50 percent within 3 minutes after the area within the sensor range is vacated.
- Low-temperature display cases shall incorporate temperature-based defrost termination control with a time-limit default. The defrost cycle shall terminate first on an upper temperature limit breach and second upon a time limit breach.
- Antisweat heater controls shall reduce the energy use of the antisweat heater as a function of the relative humidity in the air outside the door or to the condensation on the inner glass pane.

C410.3 Refrigeration systems. Refrigerated display cases, walk-in coolers or walk-in freezers that are served by remote compressor and remote condensers not located in a condensing unit, shall comply with Sections C410.3.1, C410.3.2, and ~~C403.5.3~~C403.9.7.

Exception: Systems where the working fluid in the refrigeration cycle goes through both subcritical and supercritical states (transcritical) or that use ammonia refrigerant are exempt.

C410.3.1 Condensers serving refrigeration systems. Fan-powered condensers shall comply with the following:

- ~~a.1.~~ The design *saturated condensing temperatures* for air-cooled condensers shall not exceed the design dry-bulb temperature plus 10°F (5.6°C) for *low-temperature refrigeration systems*, and the design dry-bulb temperature plus 15°F (8°C) for *medium temperature refrigeration systems* where the *saturated condensing temperature* for blend refrigerants shall be determined using the average of liquid and vapor temperatures as converted from the condenser drain pressure.
- ~~b.2.~~ Condenser fan motors that are less than 1 hp (0.75 kW) shall use electronically commutated motors, permanent split-capacitor-type motors or 3-phase motors.
- ~~e.3.~~ Condenser fans for air-cooled condensers, evaporatively cooled condensers, air- or water-cooled fluid coolers or cooling towers shall reduce fan motor demand to not more than 30 percent of design wattage at 50 percent of design air volume, and incorporate one of the following continuous variable speed fan control approaches:
 - ~~a.3.1.~~ Refrigeration system condenser control for air-cooled condensers shall use variable setpoint control logic to reset the condensing temperature setpoint in response to ambient dry-bulb temperature.
 - ~~b.3.2.~~ Refrigeration system condenser control for evaporatively cooled condensers shall use variable setpoint control logic to reset the condensing temperature setpoint in response to ambient wet-bulb temperature.
- ~~d.4.~~ Multiple fan condensers shall be controlled in unison.
- ~~e.5.~~ The minimum condensing temperature setpoint shall be not greater than 70°F (21°C).

C410.3.2 Compressor systems. Refrigeration compressor systems shall comply with the following:

1. Compressors and multiple-compressor system suction groups shall include control systems that use floating suction pressure control logic to reset the target suction pressure temperature based on the temperature requirements of the attached refrigeration display cases or walk-ins.
Exception: Controls are not required for the following:
 1. Single-compressor systems that do not have variable capacity capability.
 2. Suction groups that have a design saturated suction temperature of 30°F (-1.1°C) or higher, suction groups that comprise the high stage of a two-stage or cascade system, or suction groups that primarily serve chillers for secondary cooling fluids.
2. Liquid subcooling shall be provided for all low-temperature compressor systems with a design cooling capacity equal to or greater than 100,000 Btu/hr (29.3 kW) with a design-saturated suction temperature of -10°F (-23°C) or lower. The subcooled liquid temperature shall be controlled at a maximum temperature setpoint of 50°F (10°C) at the exit of the subcooler using either compressor economizer (interstage) ports or a separate compressor suction group operating at a saturated suction temperature of 18°F (-7.8°C) or higher.
~~a.2.1.~~ Insulation for liquid lines with a fluid operating temperature less than 60°F (15.6°C) shall comply with Table C403.2.10.
3. Compressors that incorporate internal or external crankcase heaters shall provide a means to cycle the heaters off during compressor operation.

C410.4 Commissioning. Refrigeration systems shall be commissioned in accordance with Section C408.

Exception: Self-contained units

Commented [BK(352)]:
C150-2018

SECTION C411
SOLAR READINESS

Commented [BK(353)]:
159-2018

C411.1 General. A solar zone shall be provided on non-residential buildings that are 20 stories or less in height above grade plane. The solar zone shall be located on the roof of the building or on another structure elsewhere on the site. The solar zone shall be in accordance with Sections C411.2 through C411.8 and the *International Fire Code*.

Exception. A solar zone is not required where the solar exposure of the building's roof area is less than 75 percent of that of an unshaded area, as defined in Section C411.5, in the same location, as measured by one of the following:

1. Incident solar radiation expressed in kWh/ft²-yr using typical meteorological year (TMY) data;
2. Annual sunlight exposure expressed in cumulative hours per year using TMY data;
3. Shadow studies indicating that the roof area is more than 25 percent in shadow, on September 21 at 10am, 11am, 12pm, 1pm, and 2pm solar time.

C411.2 Minimum area. The minimum area of the solar zone shall be determined by one of the following methods, whichever results in the smaller area:

1. 40 percent of roof area. The roof area shall be calculated as the horizontally-projected gross roof area less the area covered by skylights, occupied roof decks and planted areas.

2. 20 percent of electrical service size. The electrical service size is the rated capacity of the total of all electrical services to the building, and the required solar zone size shall be based upon 10 peak watts of photovoltaic per square foot.

Exception. Subject to the approval of the *code official*, buildings with extensive rooftop equipment that would make full compliance with this section impractical shall be permitted to reduce the size of the solar zone required by Section C411.2 to the maximum practicable area.

C411.3 Contiguous area. The solar zone is permitted to be comprised of separated sub-zones. Each sub-zone shall be at least 5 feet wide in the narrowest dimension.

C411.4 Obstructions. The solar zone shall be free of pipes, vents, ducts, HVAC equipment, skylights and other obstructions, except those serving photovoltaic systems within the solar zone. The solar zone is permitted to be located above any such obstructions, provided that the racking for support of the future system is installed at the time of construction, the elevated solar zone does not shade other portions of the solar zone, and its height is permitted by the *International Building Code*. Photovoltaic or solar water heating systems are permitted to be installed within the solar zone.

C411.5 Shading. The solar zone shall be set back from any existing or new object on the building or site that is located south, east, or west of the solar zone a distance at least two times the object's height above the nearest point on the roof surface. Such objects include but are not limited to taller portions of the building itself, parapets, chimneys, antennas, signage, rooftop equipment, trees and roof plantings. No portion of the solar zone shall be located on a roof slope greater than 2:12 that faces within 45 degrees of true north.

C411.6 Access. Areas contiguous to the solar zone shall provide access pathways and provisions for emergency smoke ventilation as required by the *International Fire Code*.

C411.7 Structural integrity. The as-designed dead load and live load for the solar zone shall be clearly marked on the record drawings and shall accommodate future photovoltaic system arrays at an assumed dead load of 4 pounds per square foot in addition to other required live and dead loads. A location for future inverters shall be designated either within or adjacent to the solar zone, with a minimum area of 2 square feet for each 1000 square feet of solar zone area, and shall accommodate an assumed dead load of 175 pounds per square foot. Where photovoltaic systems are installed in the solar zone, structural analysis shall be based upon calculated loads, not upon these assumed loads.

C411.8 Photovoltaic interconnection. Interconnection of the future photovoltaic system shall be provided for at the main service panel, either ahead of the service disconnecting means or at the end of the bus opposite the service disconnecting means, in one of the following forms:

1. A space for the mounting of a future overcurrent device, sized to accommodate the largest standard rated overcurrent device that is less than 20 percent of the bus rating.
2. Lugs sized to accommodate conductors with an ampacity of at least 20 percent of the bus rating, to enable the mounting of an external overcurrent device for interconnection.

The electrical construction documents shall indicate the following:

1. Solar zone boundaries and access pathways;
2. Location for future inverters and metering equipment; and
3. Route for future wiring between the photovoltaic panels and the inverter, and between the inverter and the main service panel.

CHAPTER 5

EXISTING BUILDINGS

SECTION C501 GENERAL

C501.1 Scope. The provisions of this chapter shall control the *alteration, repair, addition* and change of occupancy of existing buildings and structures.

C501.2 Existing buildings. Except as specified in this chapter, this code shall not be used to require the removal, *alteration* or abandonment of, nor prevent the continued use and maintenance of, an existing building or building system lawfully in existence at the time of adoption of this code.

C501.3 Maintenance. Buildings and structures, and parts thereof, shall be maintained in a safe and sanitary condition. Devices and systems which are required by this code shall be maintained in conformance with the code edition under which installed. The owner or the owner's authorized agent shall be responsible for the maintenance of buildings and structures. The requirements of this chapter shall not provide the basis for removal or abrogation of energy conservation, fire protection and safety systems and devices in existing structures.

C501.4 Compliance. *Alterations, repairs, additions* and changes of occupancy to, or relocation of, existing buildings and structures shall comply with the provisions for *alterations, repairs, additions* and changes of occupancy or relocation, respectively, in this code and in the *International Building Code*, *International Existing Building Code*, *International Fire Code*, *International Fuel Gas Code*, *International Mechanical Code*, *Uniform Plumbing Code*, and NFPA 70.

C501.4.1 U-factor requirements for retrofits. For existing building projects where an *addition or building envelope retrofit area is combined with existing-to-remain building areas to demonstrate compliance with this Code as a whole building*, the U-factors applied to existing-to-remain envelope assemblies shall be in accordance with record documents.

Exceptions:

1. If accurate record documents are not available, U-factors for the existing envelope assemblies may be in accordance with the edition of the Washington State Energy Code that was in effect at the time the building was permitted.
2. U-factors for the existing envelope assemblies as approved by the *code official*.

C501.4.2 Calculation of mechanical heating and cooling loads for retrofits. For the installation of new or replacement mechanical equipment that serves existing building areas, design loads associated with heating, cooling and ventilation of the existing building areas served shall be determined in accordance with section C403.1.1.

R-values and U-factors used to determine existing thermal envelope performance for the purpose of calculating design loads shall be in accordance with record documents or existing conditions.

Exceptions:

3. If accurate record documents are not available, R-values and U-factors used to determine existing building thermal envelope performance may be in accordance with the edition of the Washington State Energy Code that was in effect at the time the building was permitted.
4. R-values and U-factors for the existing envelope assemblies as approved by the *code official*.

C501.5 New and replacement materials. Except as otherwise required or permitted by this code, materials permitted by the applicable code for new construction shall be used. Like materials shall be permitted for *repairs*, provided no hazard to life, health or property is created. Hazardous materials shall not be used where the code for new construction would not permit their use in buildings of similar occupancy, purpose and location.

C501.6 Historic buildings. The building official may modify the specific requirements of this code for historic buildings and require alternate provisions which will result in a reasonable degree of energy efficiency. This modification may be allowed for those buildings or structures that are listed in the state or national register of historic places; designated as a historic property under local or state designation law or survey; certified as a contributing resource with a national register listed or locally designated historic district; or with an opinion or certification that the property is eligible to be listed on the national or state registers of historic places either individually or as a

Commented [BK(354)]
161-2018

Commented [BK(355)]
160-2018

contributing building to a historic district by the state historic preservation officer or the keeper of the national register of historic places.

C501.7 Commissioning. Existing building systems shall be commissioned in accordance with Section C408. For the purposes of meeting the commissioning thresholds in Section C408.1, only the new and altered system capacities are considered when determining whether the project is exempt from some portion of the commissioning process.

Commented [BK(356)]
C150-2018

SECTION C502 ADDITIONS

C502.1 General. Additions to an existing building, building system or portion thereof shall conform to the provisions of this code as they relate to new construction without requiring the unaltered portion of the existing building or building system to comply with this code. Additions shall not create an unsafe or hazardous condition or overload existing building systems. An addition shall be deemed to comply with this code if the addition alone complies or if the existing building and addition comply with this code as a single building. Additions shall comply with Sections C402, C403, C404, C405, C409.5, C410 and C502.2.

C502.2 Prescriptive compliance. Additions shall comply with Sections C502.2.1 through C502.2.6.2.

C502.2.1 Vertical fenestration. Additions with vertical fenestration that results in a total building vertical fenestration area less than or equal to that specified in Section C402.4.1 shall comply with Section C402.4. Additions with vertical fenestration that results in a total building vertical fenestration area greater than that specified in Section C402.4.1 shall comply with one of the following:

1. Vertical fenestration alternate per Section C402.4.1.1 or C402.4.1.3 for the addition area of the building only.
2. ~~Component performance option alternative~~ with target area adjustment per Section C402.1.5 for the addition area of the building only.
3. Existing building and addition area are combined to demonstrate compliance with the component performance alternative for the whole building.
4. ~~or the Total building performance option in accordance with~~ Section C407 for the addition area of the building only.
- 2.5. Total building performance for the whole building.

Commented [BK(357)]
161-2018

C502.2.2 Skylight area. Additions with skylights that result in a total building skylight area less than or equal to that specified in Section C402.4.1 shall comply with Section C402.4. Additions with skylights that result in a total building skylight area greater than that specified in Section C402.4.1 shall comply with one of the following:

1. ~~the Component performance option alternative~~ with the target area adjustment per Section C402.1.5 for the addition area of the building only.
2. Existing building and addition area combined to demonstrate compliance with the component performance alternative for the whole building.
3. ~~or the Total building performance option in accordance with in~~ Section C407 for the addition area of the building only.
4. Total building performance for the whole building.

Commented [BK(358)]
161-2018

C502.2.3 Building mechanical systems. New mechanical systems and equipment serving the building heating, cooling or ventilation needs, that are part of the addition, shall comply with Section C403.

C502.2.4 Service water heating systems. New service water-heating equipment, controls and service water heating piping shall comply with Section C404.

C502.2.5 Pools and permanent spas. New pools and permanent spas shall comply with Section C404.11.

C502.2.6 Lighting and power systems. New lighting systems that are installed as part of the addition shall comply with Section C405.

C502.2.6.1 Interior lighting power. The total interior lighting power for the addition shall comply with Section C405.4.2 for the addition alone, or the existing building and the addition shall comply as a single building.

C502.2.6.2 Exterior lighting power. The total exterior lighting power for the addition shall comply with Section C405.5.1 for the addition alone, or the existing building and the addition shall comply as a single building.

C502.2.7 Refrigeration systems. New refrigerated spaces and refrigeration equipment shall comply with Section C410.

SECTION C503 ALTERATIONS

C503.1 General. Alterations to any building or structure shall comply with the requirements of Section C503 and the code for new construction. Alterations to an existing building, building system or portion thereof shall conform to the provisions of this code as they relate to new construction without requiring the unaltered portions of the existing building or building system to comply with this code. Alterations shall be such that the existing building or structure is no less conforming with the provisions of this code than the existing building or structure was prior to the alteration. Alterations to an existing building, building system or portion thereof shall conform to the provisions of this code as they relate to new construction without requiring the unaltered portions of the existing building or building system to comply with this code. Alterations shall not create an unsafe or hazardous condition or overload existing building systems.

Commented [BK(359)]
165-2018

Exception: The following alterations need not comply with the requirements for new construction provided the energy use of the building is not increased:

1. Storm windows installed over existing fenestration.
2. Surface applied window film installed on existing single pane fenestration assemblies to reduce solar heat gain provided the code does not require the glazing fenestration to be replaced.
3. Existing ceiling, wall or floor cavities exposed during construction provided that these cavities are insulated to full depth with insulation having a minimum nominal value of R-3.0 per inch installed per Section C402.
4. Construction where the existing roof, wall or floor cavity is not exposed.
5. *Roof recover.*
6. *Air barriers* shall not be required for roof recover and roof replacement where the alterations or renovations to the building do not include alterations, renovations or repairs to the remainder of the building envelope.
7. Replacement of existing doors that separate conditioned space from the exterior shall not require the installation of a vestibule or revolving door, provided however that an existing vestibule that separates a conditioned space from the exterior shall not be removed.

C503.2 Change in space conditioning. Any noneconditioned low energy space in accordance with Section C402.1.1.1 that is altered to become *conditioned space* or *semi-heated space* shall be required to be brought into full compliance with this code. Any *semi-heated space in accordance with Section C402.1.1.2* that is altered to become *conditioned space* shall be required to be brought into full compliance with this code.

For buildings with more than one space conditioning category, the interior partition walls, ceilings, floors and fenestration that separate space conditioning areas shall comply with the thermal envelope requirements per the area with the highest level of space conditioning.

A change in space conditioning project shall be deemed to comply with this Code if the project area alone complies or if the existing building and the project area combined comply with this Code as a whole building.

Commented [BK(360)]
161-2018

Exceptions:

1. Where the component performance building envelope option alternative in Section C402.1.5 is used to comply demonstrate compliance with this Section, the Proposed total UA is allowed to be up to 110 percent of the Target Allowable total UA. This exception may be applied to the project area alone, or to the existing building and project area combined as a whole building.
2. Where the total building performance option in Section C407 is used to comply with this section, the annual energy consumption carbon emissions from energy consumption of the proposed design is allowed to be 110 percent of the annual energy consumption carbon emissions from energy consumption otherwise allowed by Section C407.3. This exception may be applied to the project area alone, or to the existing building and project area combined as a whole building.
3. Buildings or spaces that were permitted prior to the 2009 WSEC, or were originally permitted as unconditioned, may comply with this section as follows:
 - 3.1. Where the component performance alternative in Section C402.1.5 is used, the Proposed total UA is allowed to be up to 110 percent of the Allowable total UA.
 - 3.2. Where total building performance in Section C407 is used, the annual carbon emissions from energy consumption of the proposed design is allowed to be 110 percent of the annual carbon emissions from energy consumption allowed by Section C407.3.

Commented [BK(361)]
nv027-2018

Commented [BK(362)]
161-2018

Commented [BK(363)]
P141-2018

Commented [BK(364)]
P141-2018

Commented [BK(365)]
161-2018

Commented [BK(366)]
162-2018

C503.3 Building envelope. New building envelope assemblies that are part of the alteration shall comply with Sections C402.1 through C402.5 as applicable.

Exceptions: ~~1.~~ Air leakage testing is not required for alterations and repairs, unless the project includes a change in space conditioning according to Section C503.2 or a change of occupancy or use according to Section C505.1.

~~2. Where the existing building exceeds the fenestration area limitations of Section C402.4.1 prior to the alteration, the building is exempt from Section C402.4.1 provided there is not an increase in fenestration area.~~

C503.3.1 Roof replacement. Roof replacements shall comply with Table C402.1.3 or C402.1.4 where the existing roof assembly is part of the *building thermal envelope* and contains insulation entirely above the roof deck.

C503.3.2 Vertical fenestration. The addition of *vertical fenestration* that results in a total building vertical fenestration area less than or equal to that specified in Section C402.4.1 shall comply with Section C402.4. ~~3 or C407~~. Alterations that result in a total building vertical fenestration area greater than specified in Section C402.4.1 shall comply with one of the following:

1. Vertical fenestration alternate ~~per in accordance with~~ Section C402.4.1.3 for the new vertical fenestration added.
2. Vertical fenestration alternate ~~per in accordance with~~ Section C402.4.1.1 for the area adjacent to the new vertical fenestration added.
3. ~~Existing building and alteration area are combined to demonstrate compliance with the~~ component performance option with target area adjustment ~~per in accordance with~~ Section C402.1.5 ~~for the whole building.~~
4. ~~or the~~ Total building performance ~~option in accordance with~~ Section C407 for the whole building. ~~Provided the vertical fenestration area is not changed, using the same vertical fenestration area in the standard reference design as the building prior to alteration shall be an alternative to using the vertical fenestration area specified in Table C407.5.1(1).~~

Exceptions:

1. Additional envelope upgrades are included in the project so the addition of vertical fenestration does not cause a reduction in overall building energy efficiency, as approved by the *code official*.
2. Where the component performance alternative for the whole building is used to comply with this section, the Proposed total UA is allowed to be up to 110 of the Allowed total UA.
- ~~3.~~ Where total building performance for the whole building is used to comply with this Section, the annual carbon emissions from energy consumption of the proposed design is allowed to be 110 percent of the annual carbon emissions from energy consumption allowed in Section C407.3.

C503.3.2.1 Application to replacement fenestration products. Where some or all of an existing *fenestration* unit is replaced with a new *fenestration* product, including sash and glazing, the replacement *fenestration* unit shall meet the applicable requirements for *U*-factor and *SHGC* in Table C402.4.

Exception: An area-weighted average of the *U*-factor of replacement fenestration products being installed in the building for each fenestration product category listed in Table C402.4 shall be permitted to satisfy the *U*-factor requirements for each fenestration product category listed in Table C402.4. Individual fenestration products from different product categories listed in Table C402.4 shall not be combined in calculating the area-weighted average *U*-factor.

C503.3.3 Skylight area. The addition of *skylights* that results in a total building skylight area less than or equal to that specified in Section C402.4.1 shall comply with Section C402.4.

~~Alterations~~ The addition of *skylights* that results in a total building skylight area greater than that specified in Section C402.4.1 shall comply with ~~one of the following:~~

1. ~~Existing building and alteration area are combined to demonstrate compliance with the~~ component performance ~~option alternative~~ with target area adjustment ~~per in accordance with~~ Section C402.1.5 ~~for the whole building.~~
- ~~2.~~ ~~or the~~ Total building performance ~~option in accordance with~~ Section C407 for the whole building. ~~Provided the skylight area is not changed, using the same skylight area in the standard reference design as the building prior to alteration shall be an alternative to using the skylight area specified in Table C407.5.1(1).~~

Exceptions:

1. Additional envelope upgrades are included in the project so the addition of skylights does not cause a reduction in overall building energy efficiency, as approved by the *code official*.
2. Where the component performance alternative for the whole building is used to comply with this section, the Proposed total UA is allowed to be up to 110 percent of the Allowed total UA.
3. Where total building performance for the whole building is used to comply with this section, the annual carbon emissions from energy consumption of the proposed design is allowed to be 110 percent of the annual carbon emissions from energy consumption allowed in Section C407.3.

Commented [BK(367)]
161-2018

Commented [BK(368)]
161-2018

Commented [BK(369)]
161-2018

Commented [BK(370)]
161-2018

Commented [BK(371)]
161-2018

C503.4 Mechanical systems. Those parts of systems which are altered or replaced shall comply with Section C403. Additions or alterations shall not be made to an existing mechanical system that will cause the existing mechanical system to become out of compliance.

Exceptions:

1. Existing mechanical systems which are altered or where parts of the system are replaced are not required to be modified to comply with Section ~~C403.6~~C403.3.5 as long as mechanical cooling capacity is not added to ~~the a~~ system that did not have cooling capacity prior to the alteration.
2. Alternate mechanical system designs that are not in full compliance with this code may be approved when the code official determines that existing building constraints including, but not limited to, available mechanical space, limitations of the existing structure, or proximity to adjacent air intakes or exhausts make full compliance impractical. Alternate designs shall include additional energy saving strategies not prescriptively required by this code for the scope of the project including, but not limited to, demand control ventilation, energy recovery, or increased mechanical cooling or heating equipment efficiency above that required by Tables C403.2.3(1) through C403.2.3(10).
- 4-3. Only those components of existing HVAC systems that are altered or replaced shall be required to meet the requirements of Section C403.8.1, Allowable fan motor horsepower. Components replaced or altered shall not exceed the fan power limitation pressure drop adjustment values in Table C403.2.11.1(2) at design conditions. Section C403.8.1 does not require the removal and replacement of existing system ductwork.

Commented [BK(372)]
165-2018

Commented [BK(373)]
165-2018

Commented [BK(374)]
M093-2018

Commented [BK(375)]
165-2018

C503.4.1 New mechanical systems. All new mechanical systems in existing buildings, including packaged unitary equipment and packaged split systems, shall comply with Section C403.

C503.4.2 Addition of cooling capacity. Where mechanical cooling is added to a space that was not previously cooled, the mechanical system shall comply with either Section ~~C403.6~~C403.3.5 or ~~C403.3~~C403.5.

Exceptions:

- ~~1. Alternate designs that are not in full compliance with this code may be approved when the code official determines that existing building constraints including, but not limited to, available mechanical space, limitations of the existing structure, or proximity to adjacent air intakes/exhausts make full compliance impractical. Alternate designs shall provide alternate energy savings strategies including, but not limited to, Demand Control Ventilation or increased mechanical cooling or heating efficiency above that required by Tables C403.2.3(1) through C403.2.3(10).~~
1. Qualifying small equipment: This exception shall not be used for unitary cooling equipment installed outdoors or in a mechanical room adjacent to the outdoors. This exception is allowed to be used for other Economizers are not required for cooling units and split systems serving one zone with a total cooling capacity rated in accordance with Section ~~C403.2.3~~C403.3.2 of less than 33,000 Btu/h (hereafter referred to as qualifying small systems) provided that these are high-efficiency cooling equipment with SEER and EER values more than 15 percent higher than minimum efficiencies listed in Tables ~~C403.2.3~~C403.3.2 (1) through (3), in the appropriate size category, using the same test procedures. Equipment shall be listed in the appropriate certification program to qualify for this exception. The total capacity of all qualifying small equipment without economizers shall not exceed 72,000 Btu/h per building, or 5 percent of ~~its the~~ building total air economizer capacity, whichever is greater.

Notes and exclusions for Exception 1:

1.1. ~~That The~~ portion of the equipment serving Group R occupancies is not included in determining the total capacity of all units without economizers in a building.

1.2. Redundant units are not counted in the capacity limitations.

1.3. This exception shall not be used for the initial tenant improvement of a shell-and-core permit or building or space, for the initial tenant improvement or for total building performance, in accordance with Section C407

2-1.4. This exception shall not be used for unitary cooling equipment installed outdoors or in a mechanical room adjacent to the outdoors

2. Chilled water terminal units connected to systems with chilled water generation equipment with IPLV values more than 25 percent higher than minimum part load equipment efficiencies listed in Table ~~C403.2.3~~C403.3.2(7), in the appropriate size category, using the same test procedures. Equipment shall be listed in the appropriate certification program to qualify for this exception. The total capacity of all systems without economizers shall not exceed 480,000 Btu/h per building, or 20 percent of ~~its the~~ building total air economizer capacity, whichever is greater.

Notes and exclusions for Exception 1:

2.1. ~~That The~~ portion of the equipment serving Group R occupancy is not included in determining the total capacity of all units without economizers in a building.

3-2.2. This exception shall not be used for the initial permit (this includes any initial permit for the space including, but not limited to, the shell and core permit, built to suit permit, and tenant improvement permit)

of a shell-and-core building or space, or for total building performance ~~method~~ in accordance with Section C407.

Commented [BK(376)]
165-2018

C503.4.3 Alterations or replacement of existing cooling systems. Alterations to, or replacement of, existing mechanical cooling systems shall not decrease the building total economizer capacity unless the system complies with either Section ~~C403.2.6~~C403.3.5 or C403.35. ~~In addition, for existing mechanical cooling systems that do not comply with either Section C403.2.6 or C403.3, including both the individual~~ System alterations or replacement shall comply with Table C503.4 when the individual cooling unit size limits and the total building total capacity limits ~~on units of all cooling equipment~~ without economizer; ~~other alterations shall comply with Table C503.4 do not comply with Sections C403.3.5 or C403.5.~~

C503.4.4 Controls for cooling equipment replacement. When space cooling equipment is replaced, controls shall comply with all requirements under Section ~~C403.6~~C403.3.5 and related subsections, ~~or provide for integrated operation with economizer in accordance with and~~ Section C403.35.1. ~~for integrated economizer control.~~

C503.4.5 Cooling equipment relocation. Existing equipment currently in use may be relocated within the same floor or same tenant space if removed and reinstalled within the same permit.

Commented [BK(377)]
165-2018

C503.5 Service hot water systems. New service hot water systems that are part of the alteration shall comply with Section C404.

C503.6 Lighting, controlled receptacles and motors. Alterations or the addition of lighting, controlled receptacles and motors shall comply with Sections C503.6.1 through C503.6.6.

C503.6.1 Luminaire additions and alterations. Alterations that add or replace 50 percent or more of the luminaires in a space enclosed by walls or ceiling-height partitions, replace 50 percent or more of parking garage luminaires, or replace 50 percent or more of the total installed wattage of exterior luminaires shall comply with Sections C405.4 and C405.5. Where less than 50 percent of the fixtures in an interior space enclosed by walls or ceiling-height partitions or in a parking garage are ~~new~~added or replaced, or less than 50 percent of the installed exterior wattage is ~~altered~~replaced, the installed lighting wattage shall be maintained or reduced.

C503.6.2 Rewiring and recircuiting. Where new wiring is being installed to serve added fixtures and/or fixtures are being relocated to a new circuit, controls shall comply with Sections C405.2.1, C405.2.3, C405.2.4, C405.2.5, and C405.2.7, ~~C405.3~~, and as applicable C408.3. ~~In addition, office areas less than 300 ft² enclosed by walls or ceiling height partitions, and all meeting and conference rooms, and all school classrooms, shall be equipped with occupancy sensors that comply with Section C405.2.1 and C408.3~~New lighting control devices shall comply with the requirements of Section C405.2.

C503.6.3 New or moved lighting panel. Where a new lighting panel (or a moved lighting panel) with all new raceway and conductor wiring from the panel to the fixtures is being installed, controls shall also comply with, in addition to the requirements of Section C503.6.2, ~~the other all remaining~~ requirements in Sections C405.2 and C408.3.

C503.6.4 Newly-created rooms. Where new walls or ceiling-height partitions are added to an existing space and create a new enclosed space, but the lighting fixtures are not being changed, other than being relocated, the new enclosed space shall have controls that comply with Sections C405.2.1, C 405.2.2, C405.2.3, C405.2.4, C405.2.5 and C408.3.

C503.6.5 Motors. Those motors which are altered or replaced shall comply with Section C405.8.

C503.6.6 Controlled receptacles. Where electric receptacles are added or replaced, controlled receptacles shall be provided in accordance with Section C405.10.

Exceptions:

1. Where an alteration project impacts an area smaller than 5,000 square feet, controlled receptacles are not required.
2. Where existing systems furniture or partial-height relocatable office cubicle partitions are reconfigured or relocated within the same area, controlled receptacles are not required in the existing systems furniture or office cubicle partitions.
- 4.3. Where new or altered receptacles meet the exception to Section C405.10, they are not required to be controlled receptacles or be located within 12 inches of non-controlled receptacles.

Commented [BK(378)]
170-2018

C503.7 Refrigeration systems. Those parts of systems which are altered or replaced shall comply with Section C410. Additions or alterations shall not be made to an existing refrigerated space or system that will cause the existing mechanical system to become out of compliance. All new refrigerated spaces or systems in existing buildings, including refrigerated display cases, shall comply with Section C410.

**TABLE C503.4
ECONOMIZER COMPLIANCE OPTIONS FOR MECHANICAL ALTERATIONS**

Unit Type	Option A	Option B (alternate to A)	Option C (alternate to A)	Option D (alternate to A)
	Any alteration with new or replacement equipment	Replacement unit of the same type with the same or smaller output capacity	Replacement unit of the same type with a larger output capacity	New equipment added to existing system or replacement unit of a different type
1. Packaged Units	Efficiency: min. ^{4a} Economizer: C403.4.1403.25b	Efficiency: min. ^{4a} Economizer: C403.4.1403.25b3	Efficiency: min. ^{4a} Economizer: C403.4.1403.25b3	Efficiency: min. ^{4a} Economizer: C403.4.1403.52b4
2. Split Systems	Efficiency: min. ^{4a} Economizer: C403.4.1403.25b	<u>For units < 60,000 Btuh:</u> Efficiency: + 10/5% ^{5e} Economizer: shall not decrease existing economizer capability <u>Otherwise:</u> <u>Efficiency: min.^a</u> <u>Economizer: C403.5b</u>	Only For new units < 54,000 Btuh <u>For units < 60,000 Btuh</u> replacing unit installed prior to 1991 (one of two): Efficiency: + 10/5% ^{5e} Economizer: 50% ^{6f} For units > 54,000 Btuh or any units installed after 1991: <u>Option A Otherwise:</u> <u>Efficiency: min.^a</u> <u>Economizer: C403.5b</u>	Efficiency: min. ^{4a} Economizer: C403.4.1403.524b
3. Water Source Heat Pump	Efficiency: min. ^{4a} Economizer: C403.4.1403.25b	(two of three): Efficiency: + 10/5% ^{5c} for units < 72,000 Btuh Flow control valve ⁷ <u>valve</u> ^g Economizer: 50% ^{6f} <u>Otherwise:</u> <u>Efficiency: min.^a</u> <u>Economizer: C403.5b</u>	(three of three): Efficiency: + 10/5% ^{5e} Flow control valve ⁷ <u>valve</u> ^g Economizer: 50% ^{6f} (except for certain pre-1991 systems ⁸ <u>systems</u> ^h) <u>Otherwise:</u> <u>Efficiency: min.^a</u> <u>Economizer: C403.5b</u>	Efficiency: min. ^{4a} Economizer: C403.4.1403.524b (except for certain pre-1991 systems ⁸ <u>systems</u> ^h)
4. Hydronic Water Economizer using Air-Cooled Heat Rejection Equipment (Dry Cooler)	Efficiency: min. ^{4a} Economizer: 4433 <u>C403.5b</u>	Efficiency: + 10 5% ^{5d} Economizer: shall not decrease existing economizer capacity	<u>Efficiency: min.^a</u> <u>Economizer:</u> C403.5b <u>Option A</u>	Efficiency: min. ^{4a} Economizer: C403.4.1403.524b
5. Air-Handling Unit (including fan coil units) where the system has an air-cooled chiller	Efficiency: min. ^{4a} Economizer: C403.4.1403.25b	Economizer: shall not decrease existing economizer capacity	Option A <u>Efficiency: min.^a</u> <u>Economizer: C403.5b</u> (except for certain pre-1991 systems ⁸ <u>systems</u> ^h)	Option A <u>Efficiency: min.^a</u> <u>Economizer: C403.5b</u> (except for certain pre-1991 systems ⁸ <u>systems</u> ^h)
6. Air- Handling Unit (including fan coil units) and Water-cooled Process Equipment, where the system has a water-cooled	Efficiency: min. ^{4a} Economizer: C403.4.1403.25b	Economizer: shall not decrease existing economizer capacity	Option A <u>Efficiency: min.^a</u> <u>Economizer: C403.5b</u> (except for certain pre-1991 systems ⁸ <u>systems</u> ^h and certain 1991-2004-2016 systems ⁹ <u>systems</u> ⁱ .)	Efficiency: min. ^{4a} Economizer: C403.4.1403.524 (except for certain pre-1991 systems ⁸ <u>systems</u> ^h and certain 1991-2004-2016 systems ⁹ <u>systems</u> ⁱ)

Commented [BK(379)]
169

Commented [BK(380)]
169

Commented [BK(381)]
169

Commented [BK(382)]
169

Commented [BK(383)]
169

Commented [BK(384)]
169

Commented [BK(385)]
169

Commented [BK(386)]
169

Unit Type	Option A Any alteration with new or replacement equipment	Option B (alternate to A) Replacement unit of the same type with the same or smaller output capacity	Option C (alternate to A) Replacement unit of the same type with a larger output capacity	Option D (alternate to A) New equipment added to existing system or replacement unit of a different type
chiller ^{4d} chiller ^j				
7. Cooling Tower	Efficiency: min. ^{4a} Economizer: C403.4.1403.5 ^{2b}	No requirements	Option A Efficiency: min.^a Economizer: C403.5^b	Option A Efficiency: min.^a Economizer: C403.5^b
8. Air-Cooled Chiller	Efficiency: min. ^{4a} Economizer: C403.4.1403.5 ^{2b}	Efficiency: + 5 10% ⁴⁴ Economizer: shall not decrease existing economizer capacity	Efficiency (two of two): (1) + 10% ^{4b,k,l} and (2) multistage Economizer: shall not decrease existing economizer capacity	Efficiency: min. ^{4a} Economizer: C403.4.1403.5 ^{2,4b}
9. Water-Cooled Chiller	Efficiency: min. ^{4a} Economizer: C403.4.1403.5 ^{2b}	Efficiency: (one of two): (1) Part load IPLV + 10 15% ^{42 or n} or (2) plate frame heat exchanger ⁴⁵ exchanger ^o Economizer: shall not decrease existing economizer capacity	Efficiency: (two of two): (1) Part load IPLV + 15 15% ^{44,n} and (2) plate-frame heat exchanger ⁴⁵ exchanger ^o Economizer: shall not decrease existing economizer capacity	Efficiency: min. ^{4a} Economizer: C403.4.1403.5 ^{2,4b}
10. Boiler	Efficiency: min.⁴ Economizer: C403.4.1 ²	Efficiency: + 8%⁴⁶ Economizer: shall not decrease existing economizer capacity	Efficiency: + 8%⁴⁶ Economizer: shall not decrease existing economizer capacity	Efficiency: min.⁴ Economizer: C403.4.1 ^{2,4}

Commented [BK(387)]
169

Commented [BK(388)]
169

Commented [BK(389)]
169

Commented [BK(390)]
169

Commented [BK(391)]
169

Commented [BK(392)]
169

Commented [BK(393)]
169

Commented [BK(394)]
169

- ^{4a}. Minimum equipment efficiency shall comply with Section C403.2.3403.3.2 and Tables C403.2.3403.3.2(1) through C403.2.3403.3.2(9).
- ^{2b}. ~~All separate new equipment and replacement equipment~~(System and building shall comply have air economizer complying with Section C403.4.1403.5 (including both the individual unit size limits and the total building capacity limits on units without economizer). It is acceptable to comply using one of the exceptions to Section C403.4.1403.5.
- ^{3c}. ~~All equipment replaced in an existing building shall have air economizer complying with Sections C403.3.1 and C403.4.1 unless both the individual unit size and the total capacity of units without air economizer in the building is less than that allowed in Exception 1 to Section C403.3.1Reserved.~~
- ^{4d}. ~~All separate new equipment added to an existing building shall have air economizer complying with Sections C403.3.1 and C403.4.1 unless both the individual unit size and the total capacity of units without air economizer in the building is less than that allowed in Exception 1 to Section C403.4.1Equipment shall have a capacity-weighted average cooling system efficiency that is 5 percent better than the requirements in Tables C403.3.2(1) and C403.3.2(2) (1.05 x values in Tables C403.3.2(1) and C403.3.2(2)).~~
- ^{5c}. Equipment shall have a capacity-weighted average cooling system efficiency: ~~that is 10 percent better than the requirements in Tables C403.3.2(1)A and C403.3.2(2) (1.10 x values in Tables C403.3.2(1)A and C403.3.2(2)).~~
- ~~a. for units with a cooling capacity below 54,000 Btuh, a minimum of 10% greater than the requirements in Tables C403.2.3(1) and C403.2.3(2)(1.10 x values in Tables C403.2.3(1) and C403.2.3(2)).~~
- ~~b. for units with a cooling capacity of 54,000 Btuh and greater, a minimum of 5% greater than the requirements in Tables C403.2.3(1) and C403.2.3(2) (1.05 x values in Tables C403.2.3(1) and C403.2.3(2)).~~
- ^{6f}. Minimum of 50% ~~percent~~ air economizer that is ducted in a fully enclosed path directly to every heat pump unit in each zone, except that ducts may terminate within 12 inches of the intake to an HVAC unit provided that they are physically fastened so that the outside air duct is directed into the unit intake. If this is an increase in the amount of outside air supplied to this unit, the outside air supply system shall be capable of providing this additional outside air and equipped with economizer control.
- ^{7g}. Water-source heat pump systems shall have a flow control valve to eliminate flow through the heat pumps that are not in operation ~~with and~~ variable speed pumping control complying with Section C403.4.3 for that heat pump.
- When the total capacity of all units with flow control valves exceeds 15 ~~percent~~% of the total system capacity, a variable frequency drive shall be installed on the main loop pump.

- As an alternate to this requirement, ~~have a the~~ capacity-weighted average cooling system efficiency ~~that is 5% greater shall be 5 percent better~~ than the requirements in footnote 5-e for water-source heat pumps (i.e. a minimum of 15%/10% greater percent better than the requirements in Tables ~~C403.2.3(1) and C403.2.3~~ C403.3.2(2) (1.15/1.10 x values in Tables ~~C403.2.3(1) and C403.2.3~~ C403.3.2(2))).
- 8h. ~~Systems installed prior to 1991 without fully utilized capacity are allowed to comply with Option B, provided that the individual unit cooling capacity does not exceed 90,000 Btuh.~~ Water economizer equipment shall have a capacity-weighted average cooling system efficiency that is 10 percent better than the requirements in Tables C403.3.2(8) and C403.3.2(9) (1.10 x values in Tables C403.3.2(8) and C403.3.2(9)).
- 9i. Air economizer ~~is~~ not required for systems installed with water economizer plate and frame heat exchanger complying with previous codes between 1991 and June ~~2013~~ 2016, provided that the total fan coil load does not exceed the existing or added capacity of the heat exchangers.
- 10j. For water-cooled process equipment where the manufacturers specifications require colder temperatures than available with waterside economizer, that portion of the load is exempt from the economizer requirements.
- 11k. The air-cooled chiller shall have an IPLV efficiency that is a minimum of ~~5% 10 percent~~ greater than the IPLV requirements in EER in Table C~~403.2.3~~ C403.3.2(7) (~~1.05~~ 1.10 x IPLV values in EER in Table C~~403.2.3~~ C403.3.2(7)).
- 12l. The air-cooled chiller shall:
 - ~~a. have an IPLV efficiency that is a minimum of 10% greater than the IPLV requirements in Table C403.2.3(7) (1.10 x IPLV values in Table C403.2.3(7)), and~~
 - ~~b. be multistage with a minimum of two compressors.~~
- 13m. The water-cooled chiller shall have ~~an full load and part load~~ IPLV efficiency that is a minimum of ~~40% 5 percent~~ greater than the IPLV requirements in Table C~~403.2.3~~ C403.3.2(7) (1.10 x IPLV values in Table C~~403.2.3~~ C403.3.2(7)).
- 14n. The water-cooled chiller shall have an IPLV ~~efficiency value~~ that is a minimum of 15% ~~greater percent lower~~ than the IPLV requirements in Table C~~403.2.3~~ C403.3.2(7), (1.15 x IPLV values in Table C~~403.2.3~~ C403.3.2(7)). Water-cooled centrifugal chillers designed for non-standard conditions shall have an NPLV value that is at least 15 percent lower than the adjusted maximum NPLV rating in kW per ton defined in Section C403.3.2.1 (1.15 x NPLV).
- 15o. Economizer cooling shall be provided by adding a plate-frame heat exchanger on the waterside with a capacity that is a minimum of 20% of the chiller capacity at standard AHRI rating conditions.
- 16p. ~~The replacement boiler shall have an efficiency that is a minimum of 8% higher than the value in Table C403.2.3(5) (1.08 x value in Table C403.2.3(5)), except for electric boilers.~~ Reserved.
- q. Systems installed prior to 1991 without fully utilized capacity are allowed to comply with Option B, provided that the individual unit cooling capacity does not exceed 90,000 Btuh.

Commented [BK(395)]
169

Commented [BK(396)]
169

Commented [BK(397)]
169

SECTION C504 REPAIRS

C504.1 General. Buildings and structures, and parts thereof, shall be repaired in compliance with Section C501.3 and this section. Work on nondamaged components that is necessary for the required *repair* of damaged components shall be considered part of the *repair* and shall not be subject to the requirements for *alterations* in this chapter. Routine maintenance required by Section C501.3, ordinary repairs exempt from *permit*, and abatement of wear due to normal service conditions shall not be subject to the requirements for *repairs* in this section.

C504.2 Application. For the purposes of this code, the following shall be considered repairs.

- 4.1. Glass only replacements in an existing sash and frame.
- 5.2. *Roof repairs.*
- 6.3. Air barriers shall not be required for *roof repair* where the repairs to the building do not include *alterations*, renovations or *repairs* to the remainder of the building envelope.
- 7.4. Replacement of existing doors that separate conditioned space from the exterior shall not require the installation of a vestibule or revolving door, provided however that an existing vestibule that separates a conditioned space from the exterior shall not be removed.
- 8.5. *Repairs* where only the bulb and/or ballast within the existing luminaires in a space are replaced provided that the replacement does not increase the installed interior lighting power.

SECTION C505 CHANGE OF OCCUPANCY OR USE

C505.1 General. Spaces undergoing a change in occupancy shall be brought up to full compliance with this code in the following cases:

1. Any space that is converted from an F, S or U occupancy to an occupancy other than F, S or U.
2. Any space that is converted to a Group R dwelling unit or portion thereof, from another use or occupancy.
3. Any Group R dwelling unit or portion thereof permitted prior to July 1, 2002, that is converted to a commercial use or occupancy.

~~Where the use in a space changes from one use in Table C405.4.2 (1) or (2) to another use in Table C405.4.2 (1) or (2), the installed lighting wattage shall comply with Section C405.4.~~ A change in occupancy project shall be deemed to comply with this code if the project area alone complies or if the existing building and the project area combined comply with this code as a whole building.

Exceptions:

1. ~~Where the component performance alternative in Section C402.1.5 is used to~~ comply demonstrate compliance with this section, the Proposed total UA is allowed to be up to 110 percent of the ~~target~~ Allowable total UA. ~~This exception may be applied to the project area alone, or to the existing building and project area combined as a whole building.~~
2. ~~Where the total building performance option in Section C407 for the whole building is used to comply with this section, the annual carbon emissions from energy consumption~~ energy consumption of the proposed design is allowed to be 110 percent of the annual ~~energy consumption~~ carbon emissions from energy consumption, otherwise allowed by Section C407.3. ~~This exception may be applied to the project area alone, or to the existing building and project area combined as a whole building.~~
3. ~~Where the space undergoing a change in occupancy or use is in a building with a fenestration area that exceeds the limitations of Section C402.4.1, the space is exempt from Section C402.4.1 provided there is not an increase in fenestration area. Buildings or spaces that were permitted prior to the 2009 WSEC, or were originally permitted as unconditioned, may comply with this section as follows:~~
 - 3.1. ~~Where the component performance alternative in Section C402.1.5 is used, the Proposed total UA is allowed to be up to 110 percent of the Allowable total UA.~~
 - 4.3.2. ~~Where total building performance in Section C407 is used, the annual carbon emissions from energy consumption of the proposed design is allowed to be 110 percent of the annual carbon emissions from energy consumption allowed by Section C407.3.~~

~~Where the use in a space changes from one use in Table C405.4.2 (1) or (2) to another use in Table C405.4.2 (1) or (2), the installed lighting wattage shall comply with Section C405.4.~~

Commented [BK(398)]
161-2018

Commented [BK(399)]
161-2018

Commented [BK(400)]
nv027-2018

Commented [BK(401)]
161-2018

Commented [BK(402)]
161-2018

Commented [BK(403)]
162-2018

Commented [BK(404)]
162-2018

Chapter 6

REFERENCED STANDARDS

New Standards in 2018 IECC:

ASHRAE 55-2013	Thermal Environment Conditions for Human Occupancy	Table C407.5.1 (Schedules)
ASTM E1827-11	Standard Test Method for Determining Airtightness of Building Using an Orifice Blower Door	C402.5.1.2
CTI 201 RS(15)	Performance Rating of Evaporative Heat Rejection Equipment	Table C403.3.2(8)

Updated Standards:

AAMA/WDMA/CSA 101/IS.2?A C440- 14 ¹⁷	North American Fenestration Standard/Specifications for Windows, Doors and Unit Skylights	
AHAM HRF-1- 2007 ²⁰¹⁷	Energy, Performance and Capacity of Household Refrigerators, Refrigerator-Freezers and Freezers	
AHR1 210/240— 2008 ²⁰¹⁶	Performance Rating of Unitary Air-conditioning and Air-source Heat Pump Equipment	
AHRI 310/380— 2004 ²⁰¹⁴	Standard for Packaged Terminal Air Conditioners and Heat Pumps	
AHRI 340/360— 2007 ²⁰¹⁵	Performance Rating of Commercial and Industrial Unitary Air-conditioning and Heat Pump Equipment	
AHRI 390— 2003 ²⁰¹⁵	Performance Rating of Single Package Vertical Air-conditioners and Heat Pumps	
AHRI 400— 2001 ²⁰¹⁵	Performance Rating of Liquid to Liquid Heat Exchangers	
AHRI 550/590— 2014 ²⁰¹⁵	Performance Rating of Water-chilling and Heat Pump Water-heating Packages Using the Vapor Compression Cycle	
AHRI 1160 (I-P)— 2009 ²⁰¹⁴	Performance Rating of Heat Pump Pool Heaters	
AHRI 1200 (I-P)— 2010 ²⁰¹³	Performance Rating of Commercial Refrigerated Display Merchandisers and Storage Cabinets	
APSP 14— 2011 ²⁰¹⁴	American National Standard for Portable Electric Spa Energy Efficiency	
ASHRAE— 2012 ²⁰¹⁶	ASHRAE HVAC Systems and Equipment Handbook	
ISO/AHRI/ASHRAE 13256-1 (2011 ²⁰¹⁷)	Water-to-Air and Brine-to-Air Heat Pumps—Testing and Rating for Performance	
ISO/AHRI/ASHRAE 13256-2 (2011 ²⁰¹⁷)	Water-to-Water and Brine-to-Water Heat Pumps—Testing and Rating for Performance	
ASHRAE 90.1— 2013 ²⁰¹⁶	Energy Standard for Buildings Except Low-rise Residential Buildings	
<u>ASHRAE 90.4—2016: Energy Standard for Data Centers</u>		
ASHRAE 140— 2011 ²⁰¹⁴	Standard Method of Test for the Evaluation of Building Energy Analysis Computer Programs	
ASME A17.1— 2013 ²⁰¹⁶	Safety Code for Elevators and Escalators	
ASTM C90— 13 ¹⁴	Specification for Load-bearing Concrete Masonry Units	

ASTM C1371—~~4015~~: Standard Test Method for Determination of Emittance of Materials Near Room Temperature Using Portable Emissometers
ASTM C1549—~~0809~~ (2014): Standard Test Method for Determination of Solar Reflectance Near Ambient Temperature Using a Portable Solar Reflectometer

ASTM D1003—~~4413~~: Standard Test Method for Haze and Luminous Transmittance of Transparent Plastics

ASTM E283—04(2012): Test Method for Determining the Rate of Air Leakage Through Exterior Windows, Curtain Walls and Doors Under Specified Pressure Differences Across the Specimen

ASTM E408—~~0813~~: Test Methods for Total Normal Emittance of Surfaces Using Inspection-meter Techniques

ASTM E903—~~9612~~: Standard Test Method Solar Absorptance, Reflectance and Transmittance of Materials Using Integrating Spheres

ASTM E1918—06(2015): Standard Test Method for Measuring Solar Reflectance of Horizontal or Low-sloped Surfaces in the Field

ANSI/CRRC-S100—~~2012~~2016: Standard Test Methods for Determining Radiative Properties of Materials

DOE 10 CFR, Part 430—~~1998~~2015: Energy Conservation Program for Consumer Products: Test Procedures and Certification and Enforcement Requirement for Plumbing Products; and Certification and Enforcement Requirements for Residential Appliances; Final Rule

DOE 10 CFR, Part 431—~~2004~~2015: Energy Efficiency Program for Certain Commercial and Industrial Equipment: Test Procedures and Efficiency Standards; Final Rules

NEMA MG1—~~2003~~2014: Motors and Generators

NFPA 70—~~4417~~: National Electrical Code

NFRC 100—~~2009~~2017: Procedure for Determining Fenestration Products *U*-factors

NFRC 200—~~2009~~2017: Procedure for Determining Fenestration Product Solar Heat Gain Coefficients and Visible Transmittance at Normal Incidence

NFRC 202-2017: Procedure for Determining Fenestration Product Visible Transmittance at Normal Incidence

NFRC 203-2017: Procedure for Determining Visible Transmittance of Tubular Daylighting Devices

NFRC 400—~~2009~~2017: Procedure for Determining Fenestration Product Air Leakage

US-FTC CFR Title 16 (~~2005~~2015): R-value Rule

Commented [BK(406)]
nv043-2018

WASHINGTON STATE ENERGY CODE, APPENDIX CHAPTERS

TABLE OF CONTENTS

Appendix A Default Heat Loss Coefficients	AE-3
A101 General.....	AE-3
A101.1 Scope	AE-3
A101.2 Description	AE-3
A101.3 Air Films	AE-3
A101.4 R-Value of Compressed Insulation	AE-3
A101.5 Building Materials	AE-3
A102 Ceilings.....	AE-5
A102.1 Default U-Factors for Ceilings	AE-5
A102.2 Component Description	AE-5
A102.2.1 Vented Attic	AE-5
A102.2.2 Vaulted Ceiling	AE-5
A102.2.3 Roof Decks	AE-5
A102.2.4 Metal Truss Framing.....	AE-5
A102.2.5 Metal Building Roof	AE-7
A102.2.6 Insulation Entirely Above Roof Deck	AE-8
A103 Above Grade Walls	AE-12
A103.1 General	AE-12
A103.2 Framing Description.....	AE-12
A103.3 Component Description	AE-12
A103.3.1 Single Stud Wall	AE-12
A103.3.2 Strap Wall	AE-17
A103.3.3 Double Stud Wall.....	AE-17
A103.3.4 Log Wall.....	AE-17
A103.3.5 Stress Skin Panel	AE-17
A103.3.6 Metal Stud Walls.....	AE-17
A103.3.7 Concrete and Masonry Walls.....	AE-17
A104 Below Grade Walls and Slabs	AE-28
A104.1 General	AE-28
A104.2 Component Description	AE-28
A104.3 Insulation Description	AE-29
A105 Floors Over Unconditioned Space.....	AE-29
A105.1 General	AE-29
A105.2 Crawlspace Description	AE-31
A105.3 Construction Description	AE-31
A106 On-Grade Slab Floors	AE-31
A106.1 General	AE-31
A106.2 Component Description	AE-32
A106.3 Insulation Description	AE-32
A107 Default U-Factors for Doors	AE-32
A107.1 Doors Without NFRC Certification	AE-32
A108 Air Infiltration	AE-36
A108.1 General	AE-36
Appendix B Default Internal Load Values and Schedules	AE-37
B101 General.....	AE-37
B102 Default Tables of Internal Loads	AE-37
B103 Default Schedules.....	AE-38
Appendix C Exterior Design Conditions	AE-49
Appendix D <u>Calculation of HVAC Total System Performance Ratio</u>	
<u>Appendix E Renewable Energy</u>	<u>AE-51</u>
<u>Appendix F Outcome-Based Energy Budget.....</u>	

APPENDIX D
CALCULATION OF HVAC TOTAL SYSTEM PERFORMANCE RATIO

Commented [BK(407)]
M050-2018

D101 Scope. This appendix establishes criteria for demonstrating compliance using the *HVAC total system performance ratio* (HVAC TSPR) for office, retail, library, and education occupancies. For those occupancies, HVAC systems shall comply with Section C403 and this appendix as required by Section C403.1.1.

D201 Compliance. Compliance based on *total system performance ratio* requires that the provisions of Section C403.3 are met and the *total system performance ratio* of the *proposed design* is more than or equal to the *total system performance ratio* of the *standard reference design*. The TSPR is calculated according to the following formula:

$$\text{HVAC TSPR} = \frac{\text{annual heating and cooling load}}{\text{annual carbon emissions from energy consumption of the building HVAC systems}}$$

Where:

Annual carbon emissions from energy consumption of the building HVAC systems \equiv sum of the annual carbon emissions in pounds for heating, cooling, fans, energy recovery, pumps, and heat rejection calculated by multiplying site energy consumption by the carbon emission factors from Table C407.1

Annual heating and cooling load \equiv sum of the annual heating and cooling loads met by the building HVAC system in thousands of Btus.

TABLE C407.1
CARBON EMISSIONS FACTORS

Type	CO ₂ e (lb/unit)	Unit
Electricity	0.55	kWh
Natural Gas	11.70	Therm
Oil	19.2	Gallon
Propane	10.5	Gallon

D300 Simulation Program

D301 General.

D302 Calculation of the HVAC TSPR for the *Standard Reference Design*. The simulation program shall calculate the HVAC TSPR based only on the input for the *proposed design* and the requirements of this appendix. The calculation procedure shall not allow the user to directly modify the building component characteristics of the *standard reference design*.

D303 Specific approval. Performance analysis tools meeting the applicable subsections of Appendix E and tested according to ASHRAE Standard 140 shall be permitted to be *approved*. Tools are permitted to be *approved* based on meeting a specified threshold for a jurisdiction. The *code official* shall be permitted to approve tools for a specified application or limited scope.

D400 Climatic Data. The simulation program shall perform the simulation using hourly values of climatic data, such as temperature and humidity, using TMY3 data for the site as specified here:

<https://buildingenergyscore.energy.gov/resources>

D500 Documentation. Documentation conforming to the provisions of this section shall be provided to the *code official*.

D501 Compliance report. Building permit submittals shall include:

1. A report produced by the simulation software that includes the following.
 - 1.1. Address of the building;
 - 1.2. Name of individual completing the compliance report; and
 - 1.3. Name and version of the compliance software tool.
 - 1.4. The dimensions, floor heights and number of floors for each *block*.
 - 1.5. By *block* the U-factor, C-factor, or F-factor for each simulated opaque envelope component and the U-factor

- and SHGC for each fenestration component.
- 1.6. By block or by surface for each block, the fenestration area.
- 1.7. By block a list of the HVAC equipment simulated in the *proposed design* including the equipment type, fuel type, equipment efficiencies and system controls.
- 1.8. The *total system performance ratio* for both the *standard reference design* and the *proposed design*;
- 2. A mapping of the actual building HVAC component characteristics and those simulated in the *proposed design* showing how individual pieces of HVAC equipment identified above have been combined into average inputs as required by Section D601.11 including:
 - 2.1. fans
 - 2.2. hydronic pumps
 - 2.3. air handlers
 - 2.4. packaged cooling equipment
 - 2.5. furnaces
 - 2.6. heat pumps
 - 2.7. boilers
 - 2.8. chillers
 - 2.9. cooling towers
 - 2.10. electric resistance coils
 - 2.11. condensing units
 - 2.12. motors for fans and pumps
 - 2.13. energy recovery devices
- For each piece of equipment identified above include the following as applicable:
 - 2.14. equipment name or tag consistent with that found on the design documents
 - 2.15. efficiency level
 - 2.16. capacity
 - 2.17. input power for fans and pumps
- 3. Floor plan of the building identifying how portions of the buildings are assigned to the simulated *blocks* and areas of the building that are not covered under the requirements of Section C403.1.1.

D600 Calculation Procedure. Except as specified by this appendix, the *standard reference design* and *proposed design* shall be configured and analyzed using identical methods and techniques.

D601 Simulation of the Proposed Building Design. The *proposed design* shall be configured and analyzed as specified in this section.

D601.1 Utility Rates. For the purpose of calculating the HVAC TSPR the following simple utility rate determined by the Washington State Department of Commerce shall be used:

- \$0.112/kWh of electricity
- \$1.158/therm of fossil fuel

D601.2 Block Geometry. The geometry of buildings shall be configured using one or more *blocks*. Each block shall define attributes including block dimensions, number of floors, floor to floor height and floor to ceiling height. Simulation software may allow the use of simplified shapes (such as rectangle, L shape, H Shape, U shape or T shape) to represent *blocks*. Where actual building shape does not match these pre-defined shapes, simplifications are permitted providing the following requirements are met.

- 1. The conditioned floor area and volume of each *block* shall match the *proposed design* within 10%.
- 2. The area of each exterior envelope component from Tables C402.14 is accounted for within ten percent of the actual design.
- 3. The area of vertical fenestration and skylights is accounted for within 10% percent of the actual design.
- 4. The orientation of each component in two and three above is accounted for within 45 degrees of the actual design.

The creation of additional *blocks* may be necessary to meet these requirements.

Exception. Portions of the building that are unconditioned or served by systems not covered by the requirements of Section C403.1.1 shall be omitted.

D601.2.1 Number of Blocks. One or more *blocks* may be required per building based on the following restrictions.

- 1. Each *block* can have only one occupancy type (office, education, or retail). Therefore, at least one single *block* shall be created for each unique use type.
- 2. Each *block* can be served by only one type of HVAC system. Therefore, a single *block* shall be created for each

unique HVAC system and use type combination. Multiple HVAC units of the same type may be represented in one block. Table D601.10.2 provides directions for combining multiple HVAC units or components of the same type into a single block.

3. Each block can have a single definition of floor to floor or floor to ceiling heights. Where floor heights differ by more than two feet, unique blocks should be created for the floors with varying heights.
4. Each block can include either above grade or below grade floors. For buildings with both above grade and below grade floors, separate blocks should be created for each. For buildings with floors partially above grade and partially below grade, if the total wall area of the floor(s) in consideration is $\geq 50\%$ above grade, then it should be simulated as a completely above grade block, otherwise it should be simulated as a below grade block.
5. Each wall on a façade of a block shall have similar vertical fenestration. The product of the proposed design U-factor times the area of windows (UA) on each façade of a given floor cannot differ by more than 15% of the average UA for that façade in each block. The product of the proposed design SHGC times the area of windows (USHGC) on each façade of a given floor cannot differ by more than 15% of the average USHGC for that façade in each block. If either of these conditions are not met, additional blocks shall be created consisting of floors with similar fenestration.
6. For a building model with multiple blocks, the blocks should be configured together to have the same adjacencies as the actual building design.

D601.3 Thermal Zoning. Each floor in a block shall be modeled as a single thermal zone or as five thermal zones consisting of four perimeter zones and a core zone. Below grade floors shall be modeled as a single thermal block. If any façade in the block is less than 45' in length, there shall only be a single thermal zone per floor. Otherwise each floor shall be modeled with five thermal zones. A perimeter zone shall be created extending from each façade to a depth of 15'. Where facades intersect, the zone boundary shall be formed by a 45 degree angle with the two facades. The remaining area on each floor shall be modeled as a core zone with no exterior walls.

D601.4 Occupancy.

D601.4.1 Occupancy Type. The occupancy type for each block shall be consistent with the building area type as determined in accordance with C405.4.2.1. Portions of the building that are building area types other than office, school (education), library, or retail shall not be included in the simulation.

D601.4.2 Occupancy Schedule, Density, and Heat Gain. The occupant density, heat gain, and schedule shall be for office, retail, library, or school as specified by ASHRAE Standard 90.1 Normative Appendix C.

D601.5 Envelope Components.

D601.5.1 Roofs. Roofs will be modeled with insulation above a steel roof deck. The roof U-factor and area shall be modeled as in the proposed design. If different roof thermal properties are present in a single block, an area weighted U-factor shall be used. Roof solar absorptance shall be modeled at 0.70 and emittance at 0.90.

D601.5.2 Above Grade Walls. Walls will be modeled as steel frame construction. The U-factor and area of above grade walls shall be modeled as in the proposed design. If different wall constructions exist on the façade of a block an area-weighted U-factor shall be used.

D601.5.3 Below Grade Walls. The C-factor and area of below grade walls shall be modeled as in the proposed design. If different slab on grade floor constructions exist in a block, an area-weighted C-factor shall be used.

D601.5.4 Above Grade Exterior Floors. Exterior floors shall be modeled as steel frame. The U-factor and area of floors shall be modeled as in the proposed design. If different wall constructions exist in the block an area-weighted U-factor shall be used.

D601.5.5 Slab on Grade Floors. The F-factor and area of slab on grade floors shall be modeled as in the proposed design. If different below grade wall constructions exist in a block, an area-weighted F-factor shall be used.

D601.5.6 Vertical Fenestration. The window area and area weighted U-factor and SHGC shall be modeled for each façade based the proposed design. Each exterior surface in a block must comply with D601.2.1 item 5. Windows will be combined in to a single window centered on each façade based on the area and sill height input by the user.

D601.5.7 Skylights The skylight area and area weighted U-factor and SHGC shall be modeled for each floor based the proposed design. Skylights will be combined in to a single skylight centered on the roof of each zone based on the area and sill height input by the user.

D601.6 Lighting. Interior lighting power density shall be equal to the allowance in Table C405.4.2(1) for office, retail, library, or school. The lighting schedule shall be for office, retail, library, or school as specified by ASHRAE Standard 90.1 Normative Appendix C. The impact of lighting controls is assumed to be captured by the lighting schedule and no

explicit controls shall be modeled. Exterior lighting shall not be modeled.

D601.7 Miscellaneous equipment. The miscellaneous equipment schedule power and shall be for office, retail, library, or school as specified by ASHRAE Standard 90.1 Normative Appendix C. The impact of miscellaneous equipment controls is assumed to be captured by the equipment schedule and no explicit controls shall be modeled.

D601.8 Elevators. Elevators shall not be modeled.

601.9 SWH Equipment. SWH shall not be modeled.

D601.10 On-site Renewable Energy Systems. On-site Renewable Energy Systems shall not be modeled.

D601.11 HVAC Equipment. HVAC systems shall meet the requirements of Section C403 Mechanical Systems.

D601.11.1 Supported HVAC Systems. At a minimum, the HVAC systems shown in Table D601.11.1 shall be supported by the simulation program.

TableD601.11.1
Proposed Building HVAC Systems Supported by HVAC TSPR Simulation Software

<u>System No.</u>	<u>System Name</u>	<u>System Abbreviation</u>
<u>1</u>	<u>Packaged Terminal Air Conditioner</u>	<u>PTAC</u>
<u>2</u>	<u>Packaged Terminal Air Heat Pump</u>	<u>PTHP</u>
<u>3</u>	<u>Packaged Single Zone Gas Furnace</u>	<u>PSZGF</u>
<u>4</u>	<u>Packaged Single Zone Heat Pump (air to air only)</u>	<u>PSZHP</u>
<u>5</u>	<u>Variable Refrigerant Flow (air cooled only)</u>	<u>VRF</u>
<u>6</u>	<u>Four Pipe Fan Coil</u>	<u>FPFC</u>
<u>7</u>	<u>Water Source Heat Pump</u>	<u>WSHP</u>
<u>8</u>	<u>Ground Source Heat Pump</u>	<u>GSHP</u>
<u>9</u>	<u>Packaged Variable Air Volume (dx cooling)</u>	<u>PVAV</u>
<u>10</u>	<u>Variable Air Volume (hydronic cooling)</u>	<u>VAV</u>
<u>11</u>	<u>Variable Air Volume with Fan Powered Terminal Units</u>	<u>VAVFPTU</u>
<u>12</u>	<u>Dedicated Outdoor Air System (in conjunction with systems 1-8)</u>	<u>DOAS</u>

D601.11.2 Proposed Building HVAC System Simulation. The HVAC systems shall be modeled as in the proposed design with clarifications and simplifications as described in Table D601.11.2. System parameters not described in the following sections shall be simulated to meet the minimum requirements of Section C403. All zones within a *block* shall be served by the same HVAC system type as described in Section D601.2.1 item 2. Where multiple system components serve a *block*, average values weighed by the appropriate metric as described in this section shall be used. Heat loss from ducts and pipes shall not be modeled.

Exception: Where the building permit applies to only a portion of an HVAC system and remaining components will be designed under a future building permit, the future components shall be modeled to meet, but not exceed the requirements of Section C403.

**TABLE D601.11.2
PROPOSED BUILDING SYSTEM PARAMETERS**

<u>Category</u>	<u>Parameter</u>	<u>Fixed or User Defined</u>	<u>Required</u>	<u>Applicable Systems</u>
<u>HVAC System Type</u>	<u>System Type</u>	<u>User Defined</u>	<u>Selected from Table D601.11.1</u>	<u>All</u>
<u>System Sizing</u>	<u>Design Day Information</u>	<u>Fixed</u>	<u>99.6% heating design and 1% dry-bulb and 1% wet-bulb cooling design</u>	<u>All</u>
	<u>Zone Coil Capacity</u>	<u>Fixed</u>	<u>Sizing factors used are 1.25 for heating equipment and 1.15 for cooling equipment</u>	<u>All</u>
	<u>Supply Airflow</u>	<u>Fixed</u>	<u>Based on a supply-air-to-room-air temperature set-point difference of 20°F</u>	<u>1-11</u>
		<u>Fixed</u>	<u>Equal to required outdoor air ventilation</u>	<u>12</u>
<u>Outdoor Ventilation Air</u>	<u>Outdoor Ventilation Air Flow Rate</u>	<u>Fixed</u>	<u>As specified in ASHRAE Standard 90.1 Normative Appendix C, adjusted for proposed DCV control</u>	<u>All</u>
<u>System Operation</u>	<u>Space temperature Setpoints</u>	<u>Fixed</u>	<u>As specified in ASHRAE Standard 90.1 Normative Appendix C</u>	<u>1-11</u>
	<u>Fan Operation – Occupied</u>	<u>User Defined</u>	<u>Runs continuously during occupied hours or cycled to meet load</u>	<u>1-11</u>
	<u>Fan Operation – Occupied</u>	<u>Fixed</u>	<u>Fan runs continuously during occupied hours</u>	<u>12</u>
	<u>Fan Operation - Night Cycle</u>	<u>Fixed</u>	<u>Fan cycles on to meet setback temperatures</u>	<u>1-11</u>
<u>Packaged Equipment Efficiency</u>	<u>DX Cooling Efficiency</u>	<u>User Defined</u>	<u>Cooling COP without fan energy calculated in accordance with ASHRAE Standard 90.1 Section 11.5.2c.^b</u>	<u>1, 2, 3, 4, 5, 7, 8, 9, 11, 12</u>
	<u>Heat Pump Efficiency</u>	<u>User Defined</u>	<u>Heating COP without fan energy calculated in accordance with ASHRAE Standard 90.1 Section 11.5.2c.^c</u>	<u>2, 4, 5, 7, 8</u>
	<u>Furnace Efficiency</u>	<u>User Defined</u>	<u>Furnace thermal efficiency^c</u>	<u>3, 11</u>
<u>Heat Pump Supplemental Heat</u>	<u>Control</u>	<u>Fixed</u>	<u>Supplemental electric heat locked out above 40°F. Runs in conjunction with compressor between 40°F and 0°F.</u>	<u>2, 4</u>
<u>System Fan Power</u>	<u>Design Fan Power (W/cfm)</u>	<u>User Defined</u>	<u>Input electric power for all fans in required to operate at fan system design conditions divided by the supply airflow rate</u>	<u>All</u>
	<u>Single Zone System Fan Power During Deadband (W/cfm)</u>	<u>User Defined</u>	<u>W/cfm during deadband for VAV or multispeed single zone fans</u>	<u>3, 4, 5, 6, 7, 8</u>
<u>Variable Air Volume Systems</u>	<u>Part Load Fan Controls</u>	<u>User Defined</u>	<u>VFD included. User specifies presence of static pressure reset.</u>	<u>9, 10, 11</u>
	<u>Supply Air Temperature Controls</u>	<u>User defined</u>	<u>If not SAT reset constant at 55°F. SAT reset results in 60°F SAT during low load conditions</u>	<u>9, 10, 11</u>
	<u>Minimum Terminal Unit airflow percentage</u>	<u>User Defined</u>	<u>Average minimum terminal unit airflow percentage for block weighted by cfm</u>	<u>9, 10, 11</u>
	<u>Terminal Unit Heating Source</u>	<u>User Defined</u>	<u>Electric or hydronic</u>	<u>9, 10, 11</u>
	<u>Fan Powered Terminal Unit (FPTU) Type</u>	<u>User Defined</u>	<u>Series or parallel FPTU</u>	<u>11</u>
	<u>Parallel FPTU Fan</u>	<u>Fixed</u>	<u>Sized for 50% peak primary air at 0.35 W/cfm</u>	<u>11</u>

<u>Category</u>	<u>Parameter</u>	<u>Fixed or User Defined</u>	<u>Required</u>	<u>Applicable Systems</u>
	<u>Series FPTU Fan</u>	<u>Fixed</u>	<u>Sized for 50% peak primary air at 0.35 W/cfm</u>	<u>11</u>
<u>Economizer</u>	<u>Economizer Presence</u>	<u>User Defined</u>	<u>Yes or No</u>	<u>3, 4, 9, 10, 11</u>
	<u>Economizer High Limit</u>	<u>Fixed</u>	<u>75°F fixed dry-bulb</u>	<u>3, 4, 9, 10, 11</u>
<u>Energy Recovery</u>	<u>Sensible Effectiveness</u>	<u>User Defined</u>	<u>Heat exchanger sensible effectiveness at design heating and cooling conditions</u>	<u>3, 4, 9, 10, 11, 12</u>
	<u>Latent Effectiveness</u>	<u>User Defined</u>	<u>Heat exchanger latent effectiveness at design heating and cooling conditions</u>	<u>3, 4, 9, 10, 11, 12</u>
	<u>Economizer Bypass</u>	<u>User Defined</u>	<u>If ERV is bypassed during economizer conditions</u>	<u>3, 4, 9, 10, 11, 12</u>
	<u>Energy Recovery Temp Control</u>	<u>User Defined</u>	<u>If bypass, target supply air temperature</u>	<u>3, 4, 9, 10, 11, 12</u>
	<u>Fan Power Reduction during Bypass (W/cfm)</u>	<u>User Defined</u>	<u>If ERV system include bypass, static pressure setpoint and variable speed fan, fan power can be reduced during economizer conditions</u>	<u>3, 4, 9, 10, 11, 12</u>
<u>Demand Controlled Ventilation</u>	<u>DCV Application</u>	<u>User Defined</u>	<u>Percent of block floor area under DCV control</u>	<u>3, 4, 9, 10, 11, 12</u>
<u>DOAS</u>	<u>DOAS Fan Power W/cfm</u>	<u>User Defined</u>	<u>Fan input power in W/cfm of supply airflow^a</u>	<u>12</u>
	<u>DOAS Supplemental Heating and Cooling</u>	<u>User Defined</u>	<u>Heating source, cooling source</u>	<u>12</u>
	<u>DOAS Supply Air Temperature Control</u>	<u>User Defined</u>	<u>SAT setpoint if DOAS includes supplemental heating or cooling and active temperature controls</u>	<u>12</u>
<u>Heating Plant</u>	<u>Boiler Efficiency^d</u>	<u>User Defined</u>	<u>Boiler thermal efficiency</u>	<u>1, 6, 7, 9, 10, 11, 12</u>
	<u>Heating Water Pump Power (W/gpm)</u>	<u>User Defined</u>	<u>Pump input W/gpm heating water flow</u>	<u>1, 6, 7, 9, 10, 11, 12</u>
	<u>Heating Water Loop Temperature</u>	<u>Fixed</u>	<u>180°F supply, 130°F return</u>	<u>1, 6, 9, 10, 11</u>
<u>Chilled Water Plant</u>	<u>Chiller Compressor Type</u>	<u>User Defined</u>	<u>Screw/Scroll, Centrifugal or Reciprocating</u>	<u>6, 10, 11, 12</u>
	<u>Chiller Condenser Type</u>	<u>User Defined</u>	<u>Air cooled or water cooled</u>	<u>6, 10, 11, 12</u>
	<u>Chiller Full Load Efficiency^d</u>	<u>User Defined</u>	<u>Chiller COP</u>	<u>6, 10, 11, 12</u>
	<u>Chilled Water loop Configuration</u>	<u>User Defined</u>	<u>Variable flow primary only, constant flow primary – variable flow secondary</u>	<u>6, 10, 11, 12</u>
	<u>Chilled Water Pump Power (W/gpm)</u>	<u>User Defined</u>	<u>Pump input W/gpm chilled water flow</u>	<u>6, 10, 11, 12</u>
	<u>Chilled Water Temperature Reset Included</u>	<u>User Defined</u>	<u>Yes/No</u>	<u>6, 10, 11, 12</u>
	<u>Chilled Water Temperature Reset Schedule (if</u>	<u>Fixed</u>	<u>Outdoor air reset: CHW supply temperature of 44°F at 80°F outdoor air dry bulb and above, CHW supply temperature of 54°F at 60°F outdoor air dry bulb temperature and below,</u>	<u>6, 10, 11, 12</u>

<u>Category</u>	<u>Parameter</u>	<u>Fixed or User Defined</u>	<u>Required</u>	<u>Applicable Systems</u>
	<u>included)</u>		<u>ramped linearly between</u>	
	<u>Condenser Water Pump Power (W/gpm)</u>	<u>User Defined</u>	<u>Pump input W/gpm condenser water flow</u>	<u>6, 7, 8, 9, 10, 11, 12</u>
	<u>Condenser Water Pump Control</u>	<u>User Defined</u>	<u>Constant speed or variable speed</u>	<u>6, 7, 10, 11, 12</u>
	<u>Cooling Tower Efficiency</u>	<u>User Defined</u>	<u>gpm/hp tower fan</u>	<u>6, 10, 11, 12</u>
<u>Cooling Tower</u>	<u>Cooling Tower Fan Control</u>	<u>User Defined</u>	<u>Constant or variable speed</u>	<u>6, 10, 11, 12</u>
	<u>Cooling Tower Approach and Range</u>	<u>User Defined</u>	<u>Design cooling tower approach and range temperature</u>	<u>6, 10, 11, 12</u>
<u>Heat Pump Loop Flow Control</u>	<u>Loop flow and Heat Pump Control Valve</u>	<u>Fixed</u>	<u>Two position Valve with VFD on Pump. Loop flow at 3 gpm/ton</u>	<u>7, 8</u>
<u>Heat Pump Loop Temperature Control</u>		<u>Fixed</u>	<u>Set to maintain temperature between 50°F and 70°F</u>	<u>7</u>
<u>GLHP Well Field</u>		<u>Fixed</u>	<u>Bore depth = 250'</u> <u>Bore length 200'/ton for greater of cooling or heating load</u> <u>Bore spacing = 15'</u> <u>Bore diameter = 5"</u> <u>¾" Polyethylene pipe</u> <u>Ground and grout conductivity = 4.8 Btu-in/h-ft²-°F</u>	<u>8</u>

- Where multiple fan systems serve a single block fan power is based on weighted average using on supply air cfm.
- Where multiple cooling systems serve a single block, COP is based on a weighted average using cooling capacity.
- Where multiple heating systems serve a single block, thermal efficiency or heating COP is based on a weighted average using heating capacity.
- Where multiple boilers or chillers serve a heating water or chilled water loop efficiency is based on a weighted average for using heating or cooling capacity.

D602 Simulation of the Standard Reference Design. The standard reference design shall be configured and analyzed as specified in this section.

D602.1 Utility Rates. Same as proposed.

D602.2 Blocks. Same as proposed.

D602.3 Thermal Zoning. Same as proposed.

D602.4 Occupancy Type, Schedule, Density, and Heat Gain. Same as proposed.

D602.5 Envelope Components. Same as proposed.

D602.6 Lighting. Same as proposed.

D602.7 Miscellaneous equipment. Same as proposed.

D602.8 Elevators. Not modeled. Same as proposed.

D602.9 SWH Equipment. Not modeled. Same as proposed.

D602.10 On-site Renewable Energy Systems. Not modeled. Same as proposed.

D602.11 HVAC Equipment. The standard reference design HVAC equipment consists of separate space conditioning systems and dedicated outside air systems as described in Table D602.11 for the appropriate building occupancies.

**TABLE D602.11
STANDARD REFERENCE DESIGN HVAC SYSTEMS**

<u>Parameter</u>	<u>Building Type</u>			
	<u>Large Office^a</u>	<u>Small Office and Libraries^a</u>	<u>Retail</u>	<u>School</u>
<u>System Type</u>	<u>Water-source Heat Pump</u>	<u>Packaged air-source Heat Pump</u>	<u>Packaged air-source Heat Pump</u>	<u>Packaged air-source Heat Pump</u>
<u>Fan control^b</u>	<u>Cycle on load</u>	<u>Cycle on load</u>	<u>Cycle on load</u>	<u>Cycle on load</u>
<u>Space condition fan power (W/cfm)</u>	<u>0.528</u>	<u>0.528</u>	<u>0.522</u>	<u>0.528</u>
<u>Heating/Cooling sizing factor^c</u>	<u>1.25/1.15</u>	<u>1.25/1.15</u>	<u>1.25/1.15</u>	<u>1.25/1.15</u>
<u>Supplemental heating availability</u>	<u>NA</u>	<u><40°F</u>	<u><40°F</u>	<u><40°F</u>
<u>Modeled cooling COP (Net of fan)^d</u>	<u>4.46</u>	<u>3.83</u>	<u>4.25</u>	<u>3.83</u>
<u>Modeled heating COP (Net of fan)^d</u>	<u>4.61</u>	<u>3.81</u>	<u>3.57</u>	<u>3.81</u>
<u>Cooling Source</u>	<u>DX (heat pump)</u>	<u>DX (heat pump)</u>	<u>DX (heat pump)</u>	<u>DX (heat pump)</u>
<u>Heat source</u>	<u>Heat Pump</u>	<u>Heat Pump</u>	<u>Heat Pump</u>	<u>Heat Pump</u>
<u>OSA Economizer^e</u>	<u>No</u>	<u>No</u>	<u>Yes</u>	<u>Yes</u>
<u>Occupied ventilation source^f</u>	<u>DOAS</u>	<u>DOAS</u>	<u>DOAS</u>	<u>DOAS</u>
<u>DOAS Fan Power (W/cfm of outside air)</u>	<u>0.819</u>	<u>0.819</u>	<u>0.730</u>	<u>0.742</u>
<u>DOAS temperature control^{g, h}</u>	<u>Bypass</u>	<u>Wild</u>	<u>Bypass</u>	<u>Bypass</u>
<u>ERV efficiency (sensible only)</u>	<u>70%</u>	<u>70%</u>	<u>70%</u>	<u>70%</u>
<u>WSHP Loop Heat Rejection</u>	<u>Cooling Towerⁱ</u>	<u>NA</u>	<u>NA</u>	<u>NA</u>
<u>WSHP Loop Heat Source</u>	<u>Gas Boiler^j</u>	<u>NA</u>	<u>NA</u>	<u>NA</u>
<u>WSHP Loop Temperature Control^k</u>	<u>50°F to 70°F</u>	<u>NA</u>	<u>NA</u>	<u>NA</u>
<u>WSHP circulation Pump W/gpm^l</u>	<u>16</u>	<u>NA</u>	<u>NA</u>	<u>NA</u>
<u>WSHP Loop Pumping Control^m</u>	<u>HP Valves & pump VSD</u>	<u>NA</u>	<u>NA</u>	<u>NA</u>

a. Offices <50,000 ft² use “Small Office” parameters; otherwise use “Large Office” parameters.

b. Space conditioning system shall cycle on to meet heating and cooling setpoint schedules as specified in ASHRAE Standard 90.1 Normative Appendix C. One space conditioning system is modeled in each zone. Conditioning system fan operation is not necessary for ventilation delivery.

c. The equipment capacities (i.e. system coil capacities) for the *standard reference design* building design shall be based on design day sizing runs and shall be oversized by 15% for cooling and 25% for heating.

d. COPs shown are direct heating or cooling performance and do not include fan energy use. See 90.1 appendix G (G3.1.2.1) for separation of fan from COP in packaged equipment for units where the efficiency rating includes fan energy (e.g., SEER, EER, HSPF, COP).

e. Economizer on space conditioning systems shall be simulated when outdoor air conditions allow free cooling. Economizer high limit shall be based on differential dry-bulb control. DOAS system continues to operate during economizer mode.

f. Airflow equal to the outside air ventilation requirements is supplied and exhausted through a separate DOAS system including a supply fan, exhaust fan, and sensible only heat exchanger. No additional heating or cooling shall be provided by the DOAS. A single DOAS system will be provided for each *block*. The DOAS supply and return fans shall run whenever the HVAC system is scheduled to operate in accordance with ASHRAE Standard 90.1 Normative Appendix C.

g. “Wild” DOAS control indicates no active control of the supply air temperature leaving the DOAS system. Temperature will

- fluctuate based only on entering and leaving conditions and the effectiveness of ERV.
- h. "Bypass" DOAS control includes modulating dampers to bypass ERV with the intent to maintain supply air temperature at a maximum of 60°F when outside air is below 75°F. Once outside air is above 75°F bypass dampers will be fully closed.
 - i. Includes a single axial fan cooling tower with variable-speed fans at 40.2 gpm per/hp, sized for an approach of 10°F and a range of 10°F.
 - j. Includes a single natural draft boiler with 80% E_c.
 - k. Loop boiler and heat rejection shall be controlled to maintain loop temperature entering heat pumps between 50°F and 70°F.
 - l. Pump motor input power shall be 16 W/gpm.
 - m. Loop flow shall be variable with variable speed drive pump and unit fluid flow shutoff at each heat pump when its compressor cycles off.
-

APPENDIX F

OUTCOME-BASED ENERGY BUDGET

The provisions contained in this appendix are not mandatory unless specifically referenced in the adopting ordinance.

F101.1 General. This section is an outcome-based energy budget compliance requirement pursuant to RCW Chapter 19.27A.160 to incrementally move toward achieving by 2031 a 70 percent reduction in annual net energy use compared with 2006 baseline. As an outcome-based energy budget, this requirement uses a building's actual energy use to determine compliance.

F101.2 Scope. Buildings permitted under this section shall document one year of net energy use below an energy budget within three years after occupancy and every five years thereafter. Buildings and sites shall also be designed with the ability to offset in the future all estimated energy needs through renewable energy generation with minimum 40 percent on-site, maximum 40 percent off-site, and maximum 20 percent through green power purchase. Buildings that exceed the energy budget by up to 20 percent shall offset the excess amount through a green power purchase agreement. Buildings that exceed the energy budget by more than 20 percent shall, using a posted performance bond or financial security, offset the excess amount over 20 percent by installing renewable energy or with an energy retrofit.

F101.3 Building permit submittal. Building designs shall establish on the Washington State Outcome-Based Energy Budget Form (Figure F101.3):

1. The anticipated building energy use is lower than the energy budget.
2. The energy generation ability in the future is greater than or equal to the anticipated building energy use.

F101.3.1 Anticipated building energy use. The total yearly energy use from all metered fuel sources is the anticipated building energy use. Any energy used from district energy, combined heat and power, renewable energy, or captured waste heat systems must be metered. Buildings with any non-metered energy sources are not permitted for compliance with this section. All secondary spaces and services (examples: exterior building and site lighting, surface parking, garages, exterior swimming pools, and vehicle recharging stations) associated with the building shall be included in the overall energy use total. The anticipated site Energy Use Intensity (EUI) for each fuel source shall be reported in units of kWh/ft²/yr or kBtu/ ft²/yr using the conversions listed below:

Metered Fuel Source	to kWh:	to kBTU
Electric	kWh x 1	kWh x 3.412
Gas	Therm x 29.308	Therm x 100
Propane	Cubic Foot x 0.738	Cubic Foot x 2.5185
Fuel Oil	Gallon x 43.872	Gallon x 149.6905

F101.3.2 Building use and occupancy types. Building use and occupancy types permitted are indicated in Table F101.3.2.

F101.3.3 Maximum site energy budget. Table F101.3.2 indicates the site EUI budget for each building use and occupancy type along with the building enclosure requirements for all use and occupancy types.

F101.3.3.1 Mixed-use buildings. For buildings that contain more than one building use or occupancy type, the overall energy budget shall be based on the individual floor area percentage totals of each use times the individual energy budget and summing the results of all individual areas.

F101.3.3.2 Energy budget level options. Development teams may commit to a future, more stringent energy budget level from Table F101.3.2. Actual energy use and energy generation ability will be evaluated on this lower budget level.

F101.3.3.3 Energy modeling. A proposed building energy model is required for compliance with Section F101.3.2. A baseline energy model is not required. The proposed design model must show estimated energy use below the energy.

F101.3.4 Energy generation ability. Permit documents shall indicate the location, space allocated, and connection pathways for future installation of all potential energy generation systems. Only items defined by the *Washington State Energy Code* as *On-Site Renewable Energy* shall be used to meet energy generation requirements.

F101.3.4.1 Energy Generation Categories. The development team shall complete the Washington State Outcome-Based Energy Budget Form (Figure F101.3) to show the total renewable energy generation ability in the following categories:

1. Building Integral: Renewable energy generation sources attached to the building. This value, combined with the on-site value, shall be at least 40 percent of the energy budget.
2. On-site: Renewable energy generation sources located on the building site property. This value, combined with the building integral value, shall be at least 40 percent of the energy budget.
3. Off-site: Renewable energy generation sources not located on the building site. This amount is limited to 40 percent of the energy budget. A specific off-site location does not need to be identified.
4. Green Power: Renewable energy purchased through the electric utility provider for the building. This amount is limited to 20 percent of the energy budget.

F101.3.4.2 Energy generation ability for building sites within a 2030 district. The development team for building sites within a designated 2030 District recognized by Architecture 2030 may use the Architecture 2030 Challenge 70 percent energy reduction target from the 2003 baseline as the energy budget. Building locations meeting this criteria and choosing this energy budget are exempt from the building integral and on-site requirements in Section F101.3.4.1. Green power remains capped at 20 percent. The generation requirements may be split, in any amount, among the building integral, on-site, or off-site categories. Actual energy use will be evaluated against the Architecture 2030 Challenge 70 percent energy reduction budget.

F101.4 Actual energy use submittal. The building owner or representative shall submit energy use documentation summary from all energy source providers or from an energy benchmarking service to the building code official. Code compliance is achieved with net energy use below the energy budget for any continuous 12-month span within the first three years of occupancy.

F101.4.1 Energy use monitoring period and occupancy. The energy use monitoring timeframe shall start on the first full-month billing cycle of the utility or energy source provider(s) six months after a certificate of occupancy is issued. Buildings shall be deemed substantially occupied when a minimum 85 percent of the floor area, including all common areas, is occupied. The energy monitoring start time may be delayed up to an additional 6 months from certificate of occupancy (up to 12 months total) if 85 percent occupancy is not yet achieved. Buildings not 85 percent occupied after 12 months shall start the monitoring period for the portions occupied with an energy budget based on the spaces occupied and all common areas combined.

F101.4.2 Change of occupancy use during monitoring period. If an area within the building changes from one occupancy use to another with a different target EUI energy budget or if the building occupancy level drops below 85 percent, the target EUI energy budget shall be recalculated to become the new energy budget against which the building energy use shall be compared for compliance.

F101.4.3 Energy metering. All building spaces and uses subject to an energy budget or a portion of the energy budget shall be metered separately for all energy uses.

F101.4.4 Energy budget responsibility. The building owner is responsible for the compliance of the whole building. At the building owner's discretion, responsibility for the energy use budget may be divided and transferred into portions attributable to the occupant, operator or controller of each energy budget space. Common area spaces not under the control of an occupant or tenant may not be transferred.

F101.4.5 Energy budget liability. A member of the design or construction team may not be held liable for the failure of a building to meet the energy budget requirement established for the project provided the design or construction team made a good-faith attempt to achieve the energy budget requirement set for the building.

F101.5 Actual energy use above the energy budget. Buildings exceeding the energy budget are not in compliance with the energy code and the building owner shall complete one of the following measures within one year:

1. Owners of buildings with actual energy use that exceeds the energy budget by up to 20 percent may offset the excess energy amount through annual green power purchase agreement from the utility provider at a rate of 1.1 times the excess energy amount until future code compliance is demonstrated.
2. Owners of buildings with actual energy use that exceeds the energy budget by more than 20 percent and up to 40 percent shall complete item 1 and either install on-building, on-site, or off-site energy generation equipment or invest in an energy conservation retrofit using the performance bond or financial security for energy amount remaining above 20 percent.

3. Owners of buildings with actual energy use that exceeds the energy budget by more than 40 percent shall complete item 1, item 2, and post a replacement performance bond or financial security equal to the first bond or security amount.

F101.5.1 Continued energy monitoring. Upon completing the necessary compliance measure(s) in Section F101.5 the building owner is provided another three-year timeframe to achieve and document net energy use below the energy budget for any continuous 12-month span. Owners of buildings that remain more than 20 percent above the energy budget shall repeat the measures in Section F101.5, up to three times maximum, using the performance bond or financial security to install energy generation equipment or to install an energy retrofit and post a new performance bond equal to the first.

F101.5.2 Tradable certificate for energy savings. As an alternate to the requirements of Section F101.5 a building owner may, when this market-based instrument becomes available, purchase a Tradable Certificate for Energy Savings (TCES) or ‘white certificates’ from a building or entity with energy savings. The building owner shall purchase TCES’s equal to 1.1 times the amount that the building’s actual energy use exceeds the energy budget.

F101.6 Performance bond or financial security. A building developer must secure and submit to the code official a performance bond or an irrevocable financial security letter of credit from a State of Washington financial institution prior to certificate of occupancy issuance. The bond or security shall have a value equal to the cost of installing a photovoltaic (PV) System with a generating capacity equal to 20 percent of the energy budget or \$4.00 per square foot of gross conditioned floor area, whichever is lower. The bond or security shall be used only to install renewable energy on the building or for investment into energy conservation measures as part of an energy retrofit. The bond or security may also be held for one additional three-year energy-monitoring period if green power is purchased. Upon demonstrated compliance with the energy budget, the bond or security requirement shall be released.

F101.6.1 Failure to submit energy use data. Building owners that fail to submit energy use data at the end of the three-year monitoring period shall forfeit the full amount of the performance bond or financial security as payment to the local jurisdiction. Building owners that fail to submit energy use data at the end of each continuing five year monitoring period shall be fined an amount equal to the original bond or financial security by the local jurisdiction.

F101.7 Continued energy budget certification. After achieving code compliance buildings shall be required every five years to document a continuous 12-month span with net energy use that is lower than the required energy budget. Owners of buildings with actual energy use that is at least 2.5 percent below their energy budget (from year permitted baseline, not voluntary year) may sell, when a future market-based instrument becomes available, their unused energy equivalents in the form of a ‘white certificate’ or Tradable Certificate for Energy Savings.

F101.8 Local amendments. Local jurisdictions may amend the current code cycle EUI maximum energy budget by adopting a more-stringent future code year value stated in Table F101.3.2.

**TABLE F101.3.2
WASHINGTON STATE OUTCOME-BASED ENERGY BUDGET**

Zone 4C:

	Site EUI	Base	Current	Future			
Building Occupancy/ Use	ft²/year	2003	2018	2021	2024	2027	2030
A-3							
Library	kWh kBtu	30.5 104	14.6 49.9	13.3 45.3	11.9 40.6	10.5 35.9	9.1 31.2
B							
Office/Bank	kWh kBtu	19.7 67.3	8.5 28.9	7.8 26.7	7.2 24.5	6.6 22.4	5.9 20.2
Medical Office (non-diagnostic)	kWh kBtu	14.8 50.4	7.1 24.2	6.4 21.9	5.8 19.6	5.1 17.4	4.4 15.1
E							
School K-12	kWh	17.1	8.2	7.4	6.7	5.9	5.1

	<u>kBtu</u>	<u>58.4</u>	<u>28.0</u>	<u>25.4</u>	<u>22.8</u>	<u>20.2</u>	<u>17.5</u>
<u>1-2</u>							
<u>Hospital (in-patient)</u>	<u>kWh</u> <u>kBtu</u>	<u>51.6</u> <u>176.1</u>	<u>24.8</u> <u>84.5</u>	<u>22.5</u> <u>76.6</u>	<u>20.1</u> <u>68.7</u>	<u>17.8</u> <u>60.8</u>	<u>15.5</u> <u>52.8</u>
<u>M</u>							
<u>Grocery / Food Market</u>	<u>kWh</u> <u>kBtu</u>	<u>66.6</u> <u>227.4</u>	<u>32.0</u> <u>109.1</u>	<u>29.0</u> <u>98.9</u>	<u>26.0</u> <u>88.7</u>	<u>23.0</u> <u>78.5</u>	<u>20.0</u> <u>68.2</u>
<u>Retail</u>	<u>kWh</u> <u>kBtu</u>	<u>25.7</u> <u>87.5</u>	<u>12.3</u> <u>42.0</u>	<u>11.2</u> <u>38.1</u>	<u>10.0</u> <u>34.1</u>	<u>8.9</u> <u>30.2</u>	<u>7.7</u> <u>26.3</u>
<u>S-1</u>							
<u>Parking</u>							
<u>Enclosed garage</u>	<u>kWh</u> <u>kBtu</u>	<u>3.8</u> <u>13.0</u>	<u>2.3</u> <u>8.0</u>	<u>2.0</u> <u>7.0</u>	<u>1.7</u> <u>5.9</u>	<u>1.4</u> <u>4.9</u>	<u>1.1</u> <u>3.9</u>
<u>Open garage</u>	<u>kWh</u> <u>kBtu</u>	<u>2.3</u> <u>7.8</u>	<u>1.4</u> <u>4.8</u>	<u>1.2</u> <u>4.2</u>	<u>1.0</u> <u>3.6</u>	<u>0.9</u> <u>3.0</u>	<u>0.7</u> <u>2.3</u>
<u>S-2</u>							
<u>Non-Refrigerated Distribution/Shipping</u>	<u>kWh</u> <u>kBtu</u>	<u>8.6</u> <u>29.2</u>	<u>4.1</u> <u>14.0</u>	<u>3.7</u> <u>12.7</u>	<u>3.3</u> <u>11.4</u>	<u>3.0</u> <u>10.1</u>	<u>2.6</u> <u>8.8</u>
<u>R-2 Multi-Family (3+ stories)</u>							
<u>Lobby/Common Area</u>	<u>kWh</u> <u>kBtu</u>	<u>29.0</u> <u>99</u>	<u>17.5</u> <u>59.7</u>	<u>15.3</u> <u>52.2</u>	<u>13.1</u> <u>44.7</u>	<u>10.9</u> <u>37.2</u>	<u>8.7</u> <u>29.7</u>
<u>Studio/Micro-Unit</u>	<u>kWh</u> <u>kBtu</u>	<u>9238</u> <u>31520</u>	<u>3284</u> <u>11205</u>	<u>3156</u> <u>10768</u>	<u>3028</u> <u>10331</u>	<u>2900</u> <u>9893</u>	<u>2771</u> <u>9456</u>
<u>One Bedroom</u>	<u>kWh</u> <u>kBtu</u>	<u>18476</u> <u>63040</u>	<u>6568</u> <u>22411</u>	<u>6312</u> <u>21536</u>	<u>6055</u> <u>20661</u>	<u>5799</u> <u>19787</u>	<u>5543</u> <u>18912</u>
<u>Two Bedroom</u>	<u>kWh</u> <u>kBtu</u>	<u>27714</u> <u>94560</u>	<u>9852</u> <u>33616</u>	<u>9468</u> <u>32304</u>	<u>9083</u> <u>30992</u>	<u>8699</u> <u>29680</u>	<u>8314</u> <u>28368</u>
<u>Three Bedroom</u>	<u>kWh</u> <u>kBtu</u>	<u>36952</u> <u>126080</u>	<u>13136</u> <u>44821</u>	<u>12624</u> <u>43072</u>	<u>12111</u> <u>41323</u>	<u>11598</u> <u>39573</u>	<u>11086</u> <u>37824</u>
<u>Additional Bedroom</u>	<u>kWh</u> <u>kBtu</u>	<u>9238</u> <u>31520</u>	<u>3284</u> <u>11205</u>	<u>3156</u> <u>10768</u>	<u>3028</u> <u>10331</u>	<u>2900</u> <u>9893</u>	<u>2771</u> <u>9456</u>

<u>All Occupancies/Use Types</u>	<u>2003</u>	<u>2018</u>	<u>2021</u>	<u>2024</u>	<u>2027</u>	<u>2030</u>
	<u>U-Factor</u>					
<u>Vertical Fenestration</u>						
<u>Non-metal</u>		<u>0.28</u>	<u>0.27</u>	<u>0.25</u>	<u>0.24</u>	<u>0.23</u>
<u>Metal - Fixed</u>		<u>0.33</u>	<u>0.31</u>	<u>0.28</u>	<u>0.26</u>	<u>0.23</u>
<u>Metal - Operable</u>		<u>0.34</u>	<u>0.32</u>	<u>0.29</u>	<u>0.26</u>	<u>0.23</u>
<u>Roof</u>		<u>0.016</u>	<u>0.015</u>	<u>0.014</u>	<u>0.013</u>	<u>0.012</u>
<u>Wall (above/below grade)</u>		<u>0.031</u>	<u>0.028</u>	<u>0.024</u>	<u>0.021</u>	<u>0.018</u>
<u>Floors</u>		<u>0.024</u>	<u>0.023</u>	<u>0.021</u>	<u>0.020</u>	<u>0.018</u>
	<u>F-value</u>					
<u>Slab on Grade</u>		<u>0.41</u>	<u>0.39</u>	<u>0.36</u>	<u>0.34</u>	<u>0.32</u>
	<u>CFM75/ft²</u>					
<u>Air Leakage</u>		<u>0.25</u>	<u>0.17</u>	<u>0.14</u>	<u>0.11</u>	<u>0.08</u>

Zone 5B:

	Site EUI	Base	Current	Future			
Building Occupancy/ Use	ft ² /year	2003	2018	2021	2024	2027	2030
<u>A-3</u>							
<u>Library</u>	<u>kWh</u> <u>kBtu</u>	<u>31.9</u> <u>108.8</u>	<u>15.3</u> <u>52.2</u>	<u>13.9</u> <u>47.3</u>	<u>12.4</u> <u>42.4</u>	<u>11.0</u> <u>37.5</u>	<u>9.6</u> <u>32.6</u>
<u>B</u>							
<u>Office/Bank</u>	<u>kWh</u> <u>kBtu</u>	<u>20.1</u> <u>68.6</u>	<u>9.1</u> <u>30.9</u>	<u>8.3</u> <u>28.3</u>	<u>7.5</u> <u>25.8</u>	<u>6.8</u> <u>23.2</u>	<u>6.0</u> <u>20.6</u>
<u>Medical Office (non-diagnostic)</u>	<u>kWh</u> <u>kBtu</u>	<u>15.0</u> <u>51.3</u>	<u>7.2</u> <u>24.6</u>	<u>6.5</u> <u>22.3</u>	<u>5.9</u> <u>20.0</u>	<u>5.2</u> <u>17.7</u>	<u>4.5</u> <u>15.4</u>
<u>E</u>							
<u>School K-12</u>	<u>kWh</u> <u>kBtu</u>	<u>18.3</u> <u>62.4</u>	<u>8.8</u> <u>30.0</u>	<u>8.0</u> <u>27.2</u>	<u>7.1</u> <u>24.3</u>	<u>6.3</u> <u>21.5</u>	<u>5.5</u> <u>18.7</u>
<u>I-2</u>							
<u>Hospital (in-patient)</u>	<u>kWh</u> <u>kBtu</u>	<u>48.5</u> <u>165.5</u>	<u>23.3</u> <u>79.4</u>	<u>21.1</u> <u>72.0</u>	<u>18.9</u> <u>64.5</u>	<u>16.7</u> <u>57.1</u>	<u>14.6</u> <u>49.7</u>
<u>M</u>							
<u>Grocery / Food Market</u>	<u>kWh</u> <u>kBtu</u>	<u>66.3</u> <u>226.1</u>	<u>31.8</u> <u>108.5</u>	<u>28.8</u> <u>98.4</u>	<u>25.8</u> <u>88.2</u>	<u>22.9</u> <u>78.0</u>	<u>19.9</u> <u>67.8</u>
<u>Retail</u>	<u>kWh</u> <u>kBtu</u>	<u>28.4</u> <u>97.0</u>	<u>13.6</u> <u>46.6</u>	<u>12.4</u> <u>42.2</u>	<u>11.1</u> <u>37.8</u>	<u>9.8</u> <u>33.5</u>	<u>8.5</u> <u>29.1</u>
<u>S-1</u>							
<u>Parking</u>							
<u>Enclosed garage</u>	<u>kWh</u> <u>kBtu</u>	<u>3.8</u> <u>13.0</u>	<u>2.3</u> <u>8.0</u>	<u>2.0</u> <u>7.0</u>	<u>1.7</u> <u>5.9</u>	<u>1.4</u> <u>4.9</u>	<u>1.1</u> <u>3.9</u>
<u>Open garage</u>	<u>kWh</u> <u>kBtu</u>	<u>2.3</u> <u>7.8</u>	<u>1.4</u> <u>4.8</u>	<u>1.2</u> <u>4.2</u>	<u>1.0</u> <u>3.6</u>	<u>0.9</u> <u>3.0</u>	<u>0.7</u> <u>2.3</u>
<u>S-2</u>							
<u>Non-Refrigerated Distribution/Shipping</u>	<u>kWh</u> <u>kBtu</u>	<u>10.5</u> <u>35.8</u>	<u>5.0</u> <u>17.2</u>	<u>4.6</u> <u>15.6</u>	<u>4.1</u> <u>14.0</u>	<u>3.6</u> <u>12.4</u>	<u>3.1</u> <u>10.7</u>
<u>R-2 Multi-Family (3+ stories)</u>							
<u>Lobby/Common Area</u>	<u>kWh</u> <u>kBtu</u>	<u>29.0</u> <u>99</u>	<u>18.8</u> <u>64.2</u>	<u>16.3</u> <u>55.6</u>	<u>13.8</u> <u>46.9</u>	<u>11.2</u> <u>38.3</u>	<u>8.7</u> <u>29.7</u>
<u>Studio/Micro-Unit</u>	<u>kWh</u> <u>kBtu</u>	<u>9238</u> <u>31520</u>	<u>3495</u> <u>11925</u>	<u>3314</u> <u>11308</u>	<u>3133</u> <u>10691</u>	<u>2952</u> <u>10073</u>	<u>2771</u> <u>9456</u>
<u>One Bedroom</u>	<u>kWh</u> <u>kBtu</u>	<u>18476</u> <u>63040</u>	<u>6990</u> <u>23851</u>	<u>6628</u> <u>22616</u>	<u>6267</u> <u>21381</u>	<u>5905</u> <u>20147</u>	<u>5543</u> <u>18912</u>
<u>Two Bedroom</u>	<u>kWh</u> <u>kBtu</u>	<u>27714</u> <u>94560</u>	<u>10485</u> <u>35776</u>	<u>9943</u> <u>33924</u>	<u>9400</u> <u>32072</u>	<u>8857</u> <u>30220</u>	<u>8314</u> <u>28368</u>
<u>Three Bedroom</u>	<u>kWh</u> <u>kBtu</u>	<u>36952</u> <u>126080</u>	<u>13980</u> <u>47701</u>	<u>13257</u> <u>45232</u>	<u>12533</u> <u>42763</u>	<u>11809</u> <u>40293</u>	<u>11086</u> <u>37824</u>
<u>Additional Bedroom</u>	<u>kWh</u> <u>kBtu</u>	<u>9238</u> <u>31520</u>	<u>3495</u> <u>11925</u>	<u>3314</u> <u>11308</u>	<u>3133</u> <u>10691</u>	<u>2952</u> <u>10073</u>	<u>2771</u> <u>9456</u>

All Occupancies/Use Types	2003	2018	2021	2024	2027	2030
	<u>U-Factor</u>					
<u>Vertical Fenestration</u>						
<u>Non-metal</u>		<u>0.25</u>	<u>0.23</u>	<u>0.21</u>	<u>0.18</u>	<u>0.16</u>

<u>Metal - Fixed</u>		<u>0.31</u>	<u>0.27</u>	<u>0.23</u>	<u>0.20</u>	<u>0.16</u>
<u>Metal - Operable</u>		<u>0.32</u>	<u>0.28</u>	<u>0.24</u>	<u>0.20</u>	<u>0.16</u>
<u>Roof</u>		<u>0.016</u>	<u>0.015</u>	<u>0.014</u>	<u>0.013</u>	<u>0.012</u>
<u>Wall (above/below grade)</u>		<u>0.031</u>	<u>0.028</u>	<u>0.024</u>	<u>0.021</u>	<u>0.018</u>
<u>Floors</u>		<u>0.024</u>	<u>0.023</u>	<u>0.021</u>	<u>0.020</u>	<u>0.018</u>
	<u>F-value</u>					
<u>Slab on Grade</u>		<u>0.41</u>	<u>0.39</u>	<u>0.36</u>	<u>0.34</u>	<u>0.32</u>
	<u>CFM75/ft²</u>					
<u>Air Leakage</u>		<u>0.25</u>	<u>0.17</u>	<u>0.14</u>	<u>0.11</u>	<u>0.08</u>

FIGURE F101.3.2
WASHINGTON STATE OUTCOME-BASED ENERGY BUDGET FORM

WASHINGTON STATE OUTCOME-BASED ENERGY BUDGET FORM

(reserved for graphics)

Building
occupancy/use

Conditioned floor area
SF

Code maximum site EUI energy budget

Predicted EUI

Electric

Gas

Propane

Oil

Other (source/generation)

Generation Potential EUI

Building Integral

On-site

Offsite

Purchase

Percentage better than energy budget

Percentage potential EUI above predicted EUI

PROJECT SUMMARY

Building Name

Address

City

Owner

Address

City, State, Zip

PROJECT CERTIFICATION

Name

Firm

Date

(seal)